
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Thursday, August 11, 2016

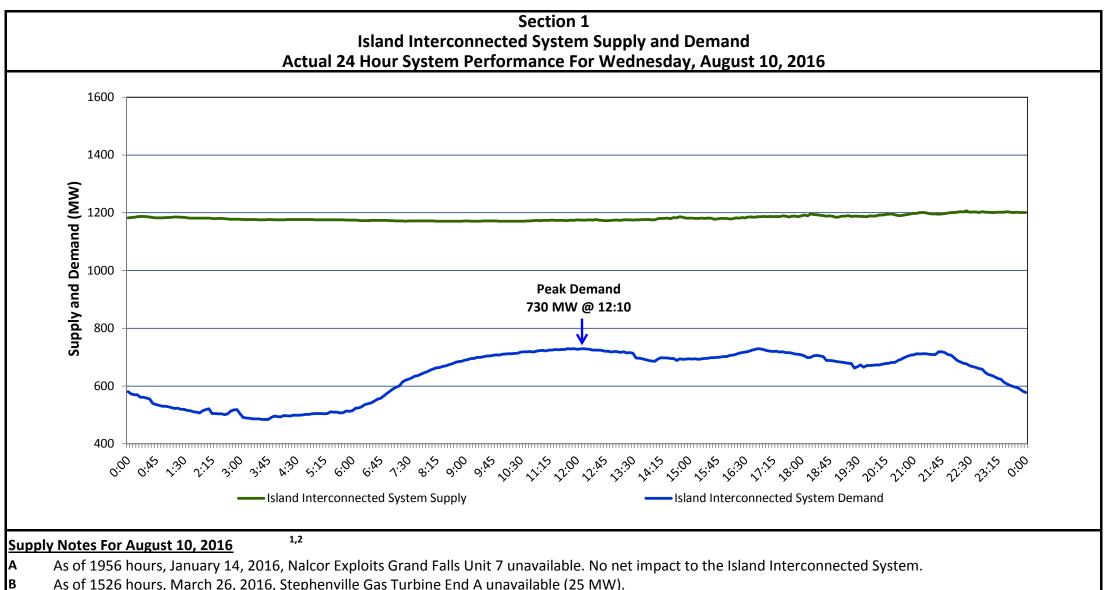

- As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).
- С As of 1029 hours, April 15, 2016, Holyrood Unit 3 unavailable (150 MW).
- D As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 3 unavailable (76.5 MW).
- Ε As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 4 unavailable (76.5 MW).
- F As of 1425 hours, June 16, 2016, Holyrood Unit 2 unavailable. Previously derated to 120 MW (170 MW).
- G As of 0833 hours, June 30, 2016, Bay d'Espoir Unit 7 unavailable (154.4 MW).
- н As of 0846 hours, July 12, 2016, St. Anthony Diesel Plant G6 (unit 544) unavailable (2 MW).
- As of 1316 hours, July 15, 2016, Nalcor Exploits Grand Falls Unit 4 unavailable. Net impact to the Island Interconnected System is 7 MW.
- As of 1610 hours, July 16, 2016, Holyrood Unit 1 derated to 120 MW (170 MW).
- As of 1125 hours, July 18, 2016, Hardwoods Turbine unavailable. Previously derated to 38 MW (50 MW). К
- As of 1628 hours, August 09, 2016, Stephenville Gas Turbine End B unavailable (25 MW).

2			Temperature		Island System Daily Peak	
hu, Aug 11, 2016 Island System Outlook ³		Seven-Day Forecast	(°	C)	Demand (MW)	
				Morning	Evening	Forecast
Available Island System Supply: ⁵	1,185	MW	Thursday, August 11, 2016	18	19	760
NLH Generation: ⁴	915	MW	Friday, August 12, 2016	19	19	760
NLH Power Purchases: ⁶	95	MW	Saturday, August 13, 2016	15	16	755
Other Island Generation:	175	MW	Sunday, August 14, 2016	14	15	750
Current St. John's Temperature:	16	°C	Monday, August 15, 2016	14	16	785
Current St. John's Windchill:	N/A	°C	Tuesday, August 16, 2016	16	17	780
7-Day Island Peak Demand Forecast:	785	MW	Wednesday, August 17, 2016	16	16	785
otes: 1. Generation outages for running and c			e included. These are not unusual for power set to system equipment whenever possible to	-		-
 customer supply. The power system of low and sufficient supply reserves are 2. Due to the Island Interconnected Syst load must be interrupted for short pe under frequency load shedding, is needed. 	e available. How em being isolat riods to bring g cessary to ensu	ever, from ed from t eneration re the inte	n time to time equipment outages are necess ne larger North American grid, when there is a output equal to customer demand. This auto grity and reliability of system equipment. Un stomer load interruptions are generally less th	a sudden loss of larg matic action of pow der frequency even	ge generating u ver system prot	nits some customer's ection, referred to as

Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak						
Wed, Aug 10, 2016	Actual Island Peak Demand ⁸	12:10	730 MW			
Thu, Aug 11, 2016	Forecast Island Peak Demand		760 MW			