


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, August 30, 2016

Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Monday, August 29, 2016

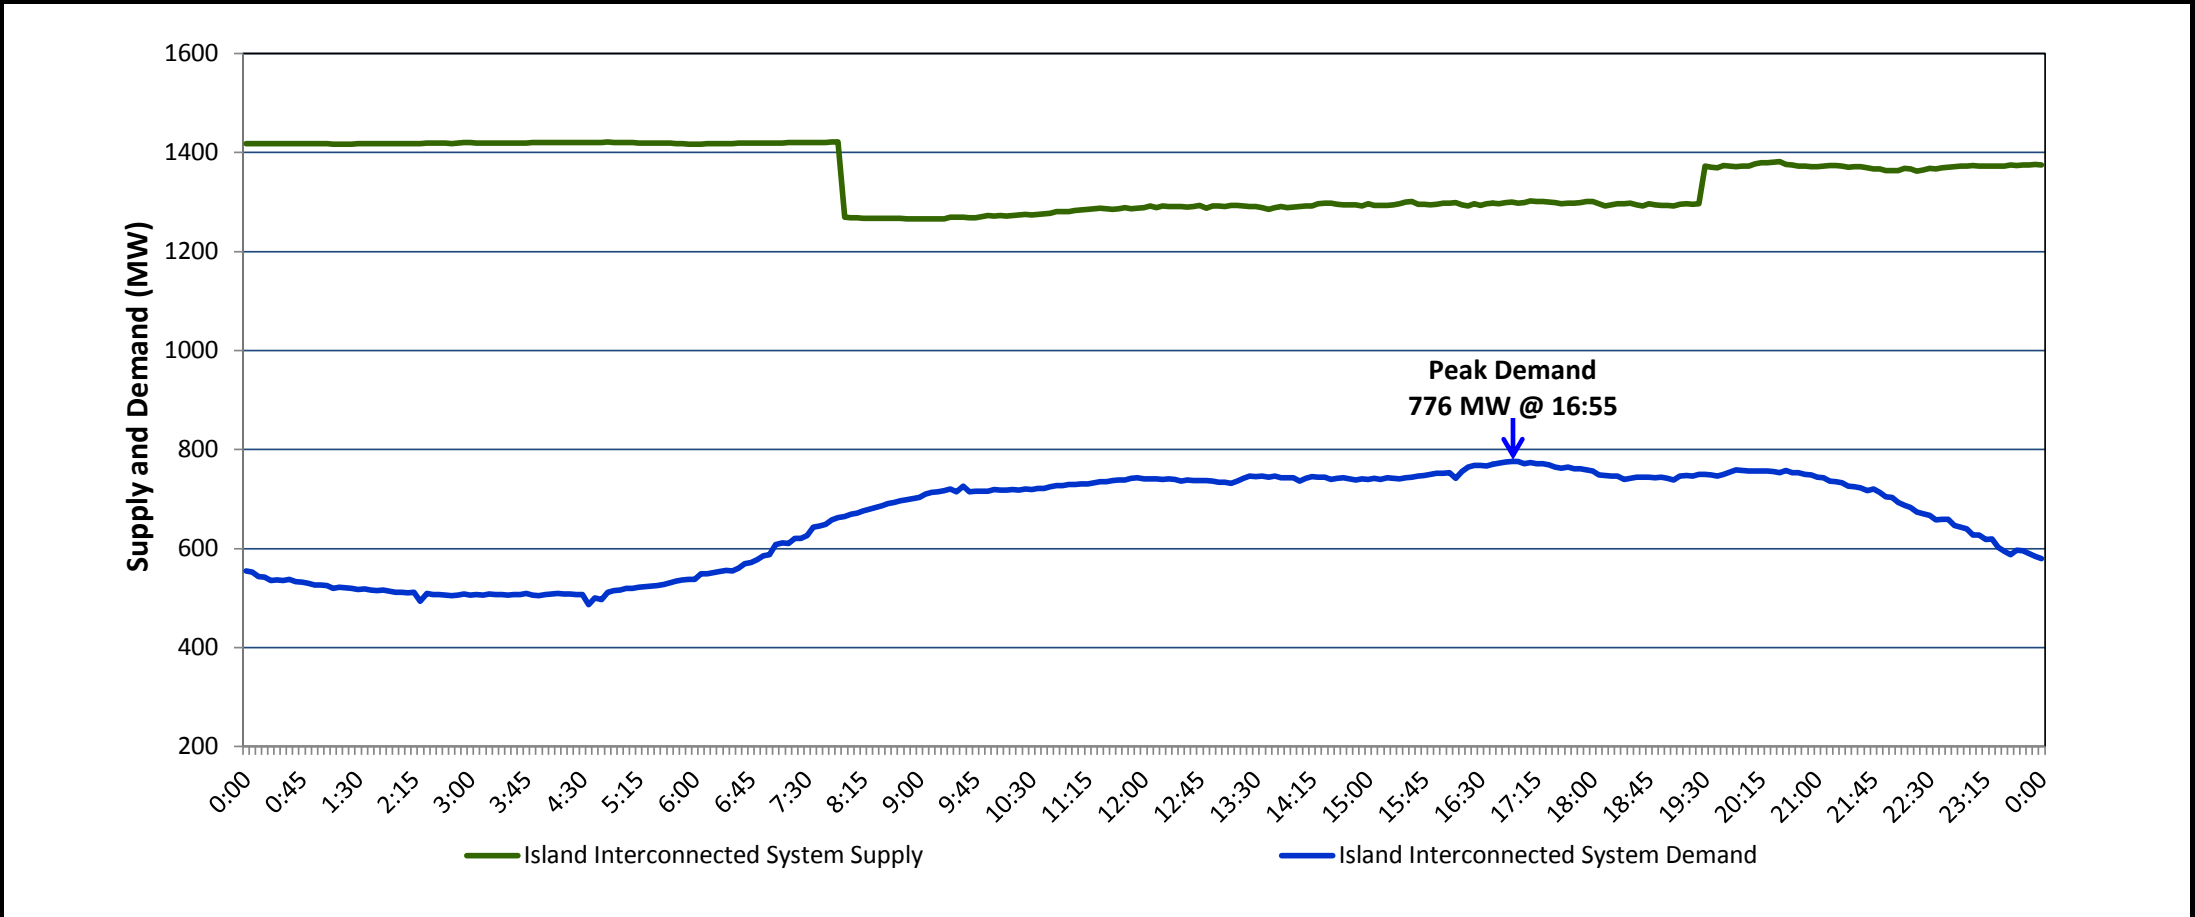

Supply Notes For August 29, 2016		1,2
A	As of 1956 hours, January 14, 2016, Nalcor Exploits Grand Falls Unit 7 unavailable. No net impact to the Island Interconnected System.	
B	As of 1526 hours, March 26, 2016, Stephenville Gas Turbine End A unavailable (25 MW).	
C	As of 0822 hours, June 05, 2016, Bay d'Espoir Unit 4 unavailable (76.5 MW).	
D	As of 1425 hours, June 16, 2016, Holyrood Unit 2 unavailable. Previously derated to 120 MW (170 MW).	
E	As of 1316 hours, July 15, 2016, Nalcor Exploits Grand Falls Unit 4 unavailable. Net impact to the Island Interconnected System is 7 MW.	
F	As of 1125 hours, July 18, 2016, Hardwoods Turbine unavailable. Previously derated to 38 MW (50 MW).	
G	As of 1451 hours, August 22, 2016, Nalcor Exploits Bishop's Falls plant unavailable. Net impact to the Island Interconnected System is 15 MW.	
H	As of 1733 hours, August 26, 2016, Holyrood Unit 3 derated to 135 MW (150 MW).	
I	As of 1341 hours, August 27, 2016, Holyrood Unit 1 unavailable. Previously derated to 120 MW (170 MW).	
J	At 0757 hours, August 29, 2016, Bay d'Espoir Unit 5 unavailable (76.5 MW).	
K	At 0757 hours, August 29, 2016, Bay d'Espoir Unit 6 unavailable (76.5 MW).	
L	At 1925 hours, August 29, 2016, Bay d'Espoir Unit 6 available (76.5 MW).	

Section 2
Island Interconnected Supply and Demand

Tue, Aug 30, 2016			Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)
						Morning	Evening	Forecast
Available Island System Supply: ⁵			1,380	MW	Tuesday, August 30, 2016	15	9	880
NLH Generation: ⁴			1,110	MW	Wednesday, August 31, 2016	12	14	835
NLH Power Purchases: ⁶			105	MW	Thursday, September 01, 2016	13	14	780
Other Island Generation:			165	MW	Friday, September 02, 2016	12	13	840
Current St. John's Temperature:			14	°C	Saturday, September 03, 2016	10	10	830
Current St. John's Windchill:			N/A	°C	Sunday, September 04, 2016	9	13	805
7-Day Island Peak Demand Forecast:			880	MW	Monday, September 05, 2016	18	18	785

Supply Notes For August 30, 2016		3
M	At 0536 hours, August 30, 2016, Nalcor Exploits Grand Falls Unit 5 unavailable. No net impact to the Island Interconnected System.	

Notes:	1.	Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
	2.	Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
	3.	As of 0800 Hours.
	4.	Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
	5.	Gross output from all Island sources (including Note 4).
	6.	NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

Mon, Aug 29, 2016	Actual Island Peak Demand ⁸	16:55	776 MW
Tue, Aug 30, 2016	Forecast Island Peak Demand		880 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).