


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, March 14, 2017**

**Section 1  
Island Interconnected System Supply and Demand  
Actual 24 Hour System Performance For Sunday, March 12, 2017**

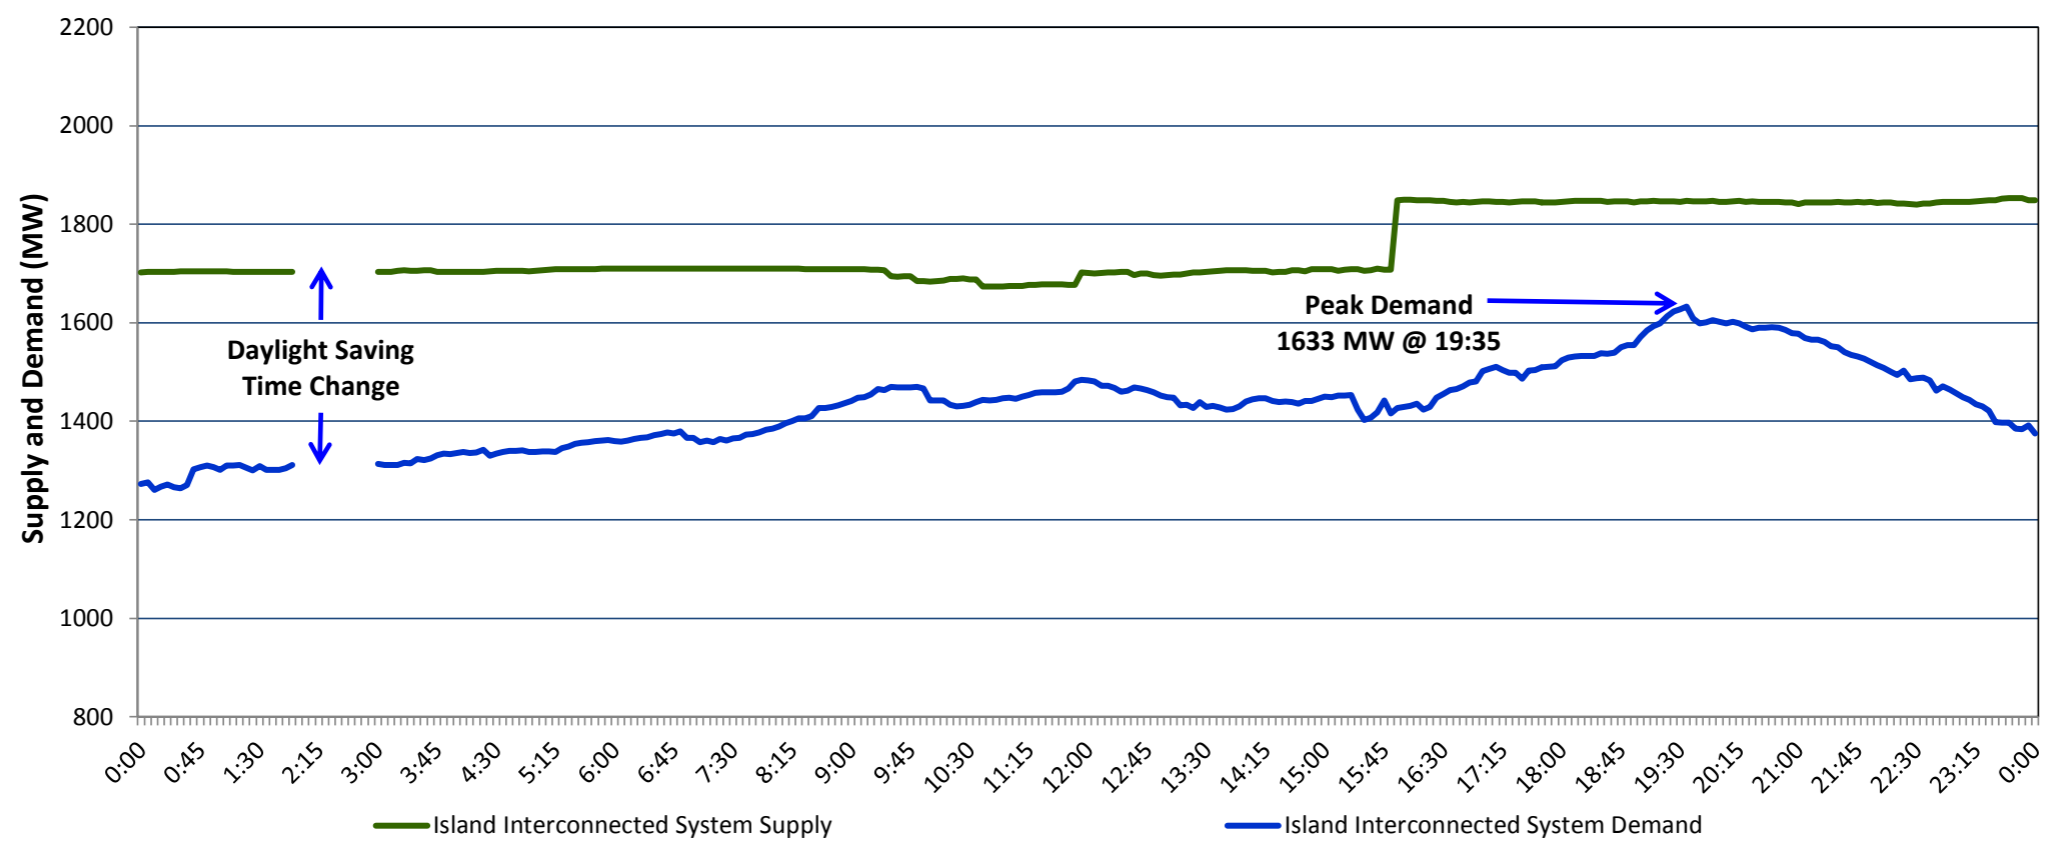

**Supply Notes For March 12, 2017**

- 1,2
- A As of 0700 hours, March 06, 2017, Holyrood Unit 2 available at 140 MW (170 MW).
  - B As of 1222 hours, March 11, 2017, Paradise River Unit unavailable (8 MW).
  - C At 0928 hours, March 12, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
  - D At 0950 hours, March 12, 2017, Holyrood Diesels unavailable (10 MW).
  - E At 1036 hours, March 12, 2017, Holyrood Unit 3 available at 135 MW (150 MW).
  - F At 1155 hours, March 12, 2017, Hardwoods Gas Turbine available 25 MW (50 MW).
  - G At 1547 hours, March 12, 2017, Holyrood Unit 1 available 140 MW (170 MW).
  - H At 2300 hours, March 12, 2017, Holyrood Combustion Turbine available at full capacity (123.5 MW).

**Section 2  
Island Interconnected Supply and Demand**

Mon, Mar 13, 2017	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,850 MW	Monday, March 13, 2017	-5	-3	1,520	1,411
NLH Generation: <sup>4</sup>	1,550 MW	Tuesday, March 14, 2017	-4	-4	1,435	1,327
NLH Power Purchases: <sup>6</sup>	100 MW	Wednesday, March 15, 2017	-2	6	1,425	1,317
Other Island Generation:	200 MW	Thursday, March 16, 2017	6	0	1,320	1,214
Current St. John's Temperature:	-5 °C	Friday, March 17, 2017	-3	-3	1,360	1,253
Current St. John's Windchill:	-12 °C	Saturday, March 18, 2017	-6	-4	1,365	1,258
7-Day Island Peak Demand Forecast:	1,520 MW	Sunday, March 19, 2017	-1	-2	1,265	1,159

**Supply Notes For March 13, 2017**

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.
  7. Adjusted for CBP&P, Praxair and Vale interruptible load as well as the impact of voltage reduction, when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Sun, Mar 12, 2017	Actual Island Peak Demand <sup>8</sup>	19:35	1,633 MW
Mon, Mar 13, 2017	Forecast Island Peak Demand		1,520 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).