


Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, August 10, 2017

Section 1  
Island Interconnected System Supply and Demand  
Actual 24 Hour System Performance For Wednesday, August 09, 2017

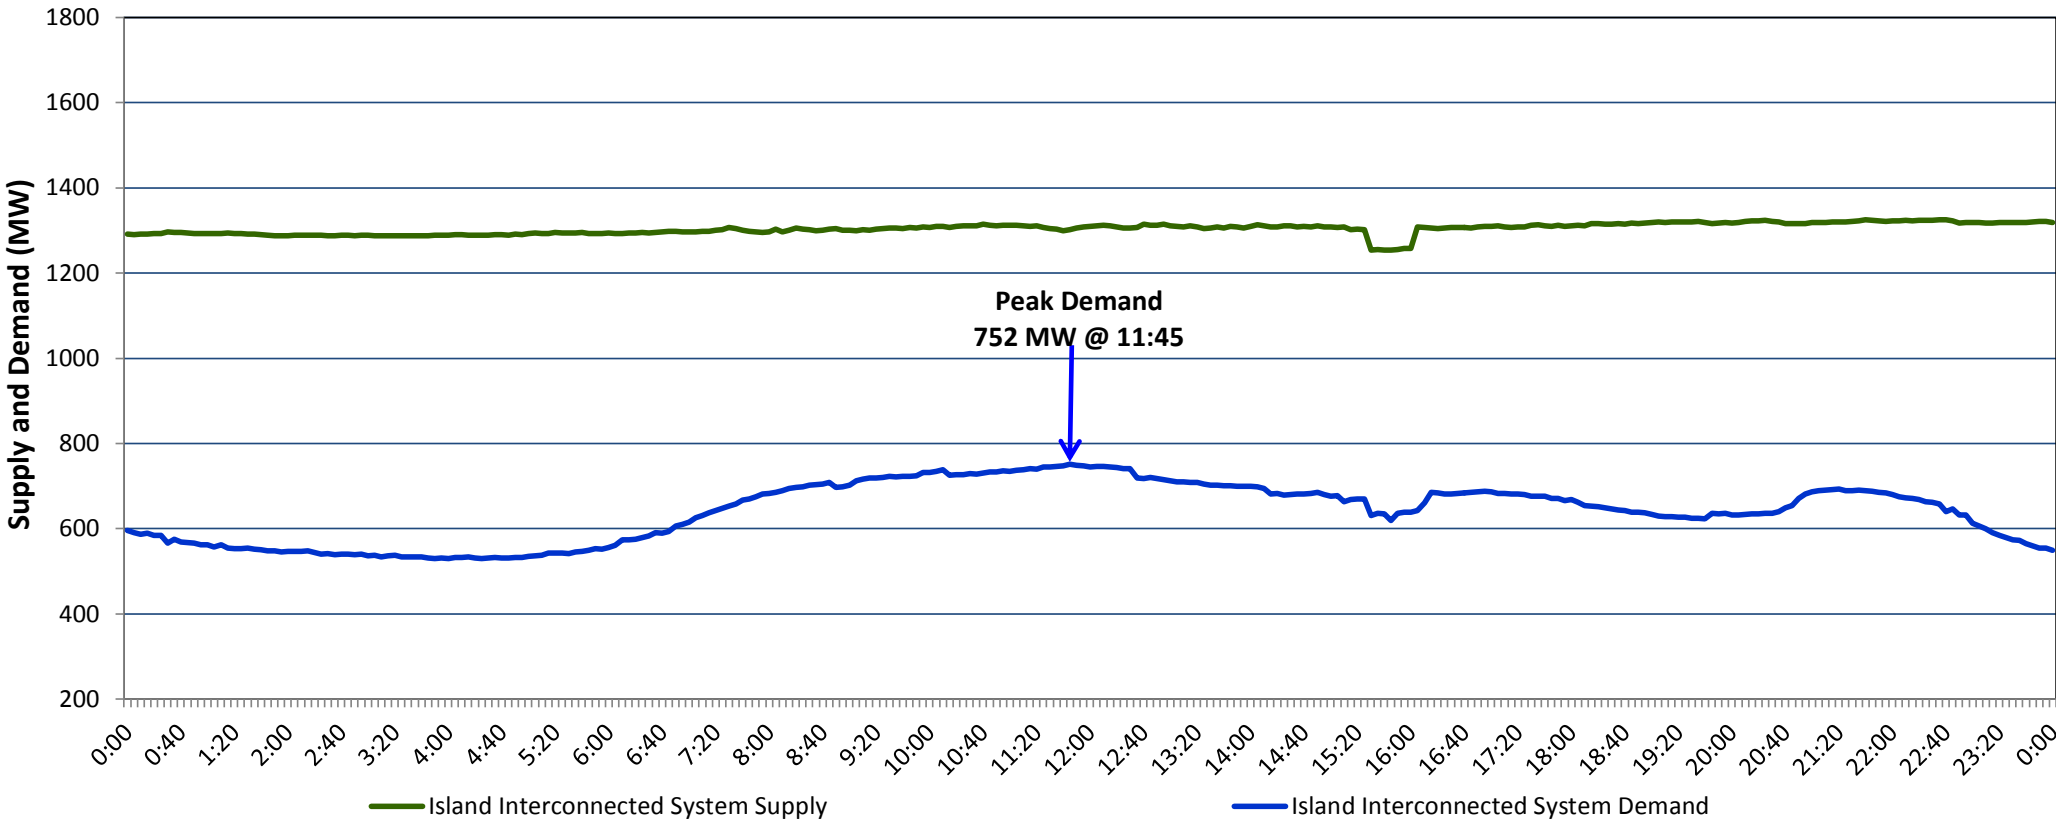

Supply Notes For August 09, 2017

- A As of 1858 hours, June 22, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 0938 hours, June 23, 2017, Holyrood Unit 1 unavailable due to planned outage 120 MW (170 MW).
- C As of 1018 hours, July 07, 2017, Granite Canal Unit unavailable due to planned outage (40 MW).
- D As of 1314 hours, July 11, 2017, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- E As of 1058 hours, July 23, 2017, Bay d'Espoir Unit 1 unavailable due to planned outage (76. 5 MW).
- F As of 0827 hours, July 31, 2017, Holyrood Unit 2 unavailable due to planned outage 165 MW (170 MW).
- G As of 0827 hours, July 31, 2017, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- H As of 1250 hours, August 06, 2017, Upper Salmon Unit unavailable due to planned outage (84 MW).
- I At 1527 hours, August 09, 2017, Hardwoods Gas Turbine unavailable (50 MW).
- J At 1603 hours, August 09, 2017, Hardwoods Gas Turbine available (50 MW).

Section 2  
Island Interconnected Supply and Demand

Thu, Aug 10, 2017	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)  Forecast
			Morning	Evening	
Available Island System Supply: <sup>5</sup>	1,265 MW	Thursday, August 10, 2017	15	18	770
NLH Generation: <sup>4</sup>	975 MW	Friday, August 11, 2017	19	20	775
NLH Power Purchases: <sup>6</sup>	90 MW	Saturday, August 12, 2017	18	17	765
Other Island Generation:	200 MW	Sunday, August 13, 2017	17	15	765
Current St. John's Temperature:	15 °C	Monday, August 14, 2017	14	17	815
Current St. John's Windchill:	N/A °C	Tuesday, August 15, 2017	16	17	795
7-Day Island Peak Demand Forecast:	815 MW	Wednesday, August 16, 2017	16	16	780

Supply Notes For August 10, 2017

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
  - As of 0800 Hours.
  - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - Gross output from all Island sources (including Note 4).
  - NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak

Wed, Aug 09, 2017	Actual Island Peak Demand <sup>8</sup>	11:45	752 MW
Thu, Aug 10, 2017	Forecast Island Peak Demand		770 MW

Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).