


Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Monday, February 26, 2018

Section 1

Island Interconnected System Supply, Demand & Exports

Actual 24 Hour System Performance For Friday, February 23, 2018

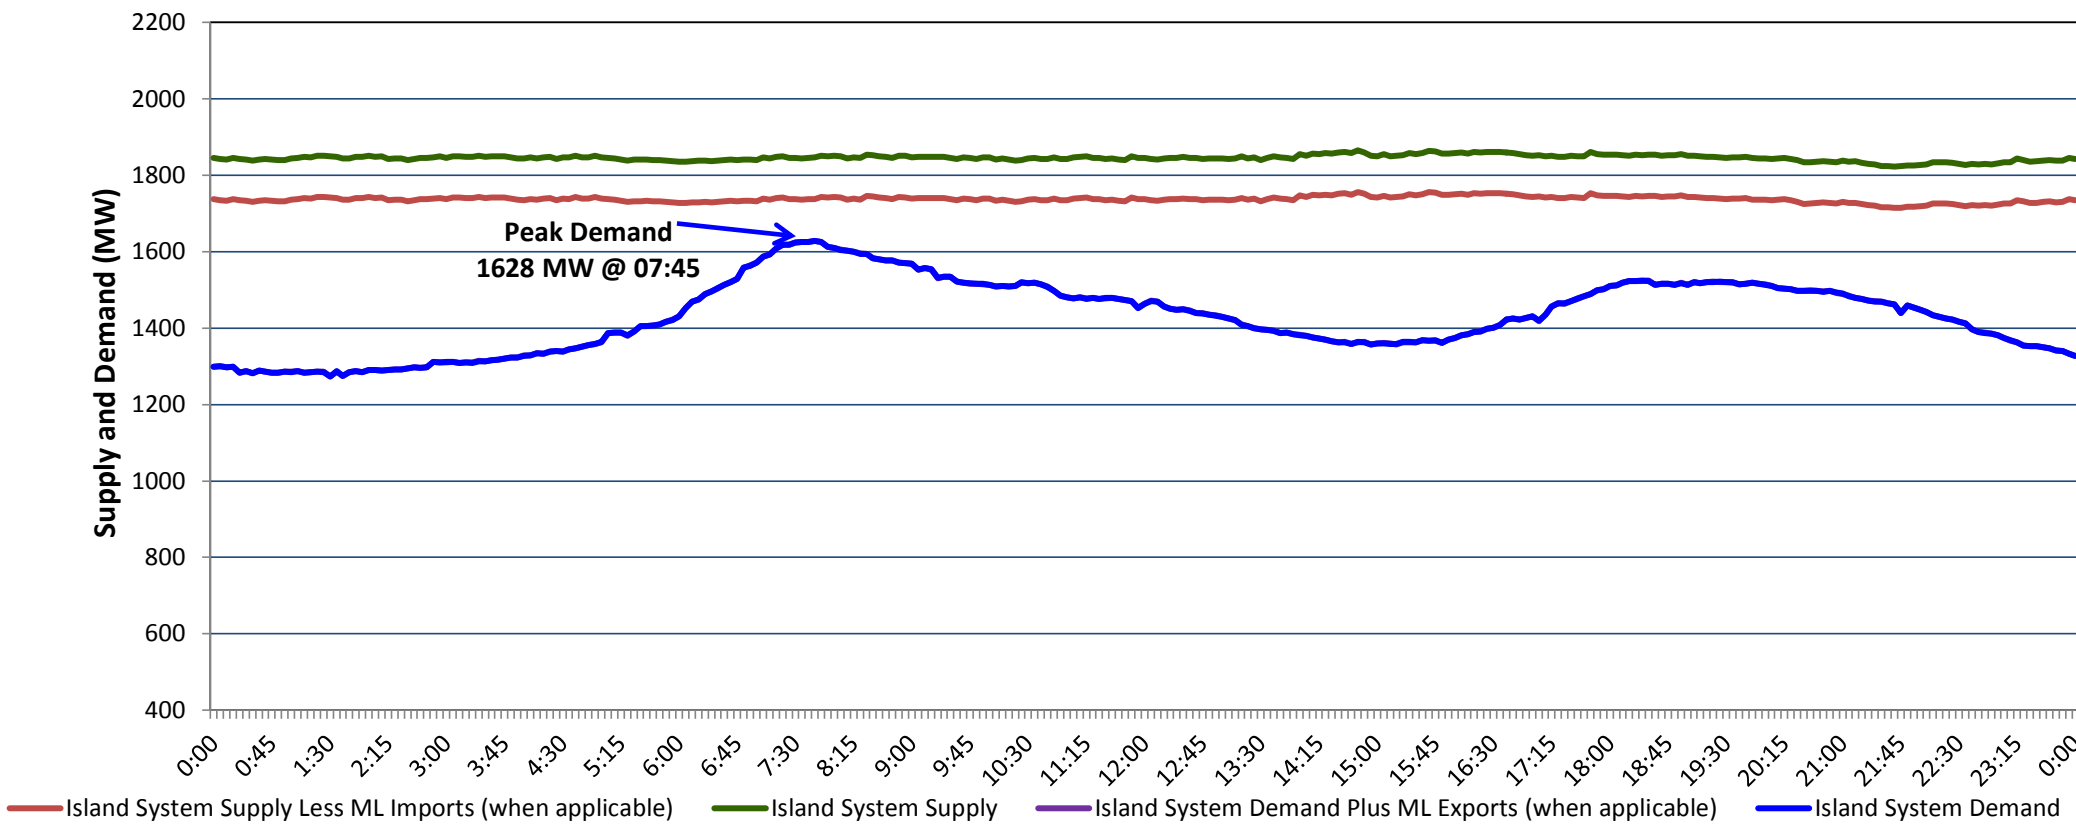

Supply Notes For February 23, 2018

- A
- As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B
- As of 0810 hours, February 18, 2018, Holyrood Unit 3 available at 108 MW (150 MW).
- C
- As of 0829 hours, February 22, 2018, Holyrood Unit 2 available at 108 MW (170 MW).
- D
- As of 1659 hours, February 22, 2018, Holyrood Unit 1 unavailable 140 MW (170 MW).

1,2

Section 2

Island Interconnected Supply and Demand

Sat, Feb 24, 2018	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening		
Available Island System Supply: ⁵	1,963	MW		Saturday, February 24, 2018	-7	-2	1,495	1,288
NLH Generation: ⁴	1,395	MW		Sunday, February 25, 2018	-10	-9	1,565	1,456
NLH Power Purchases: ⁶	255	MW		Monday, February 26, 2018	-8	-4	1,520	1,347
Maritime Link Imports:	108	MW		Tuesday, February 27, 2018	-1	-2	1,380	1,273
Other Island Generation:	205	MW		Wednesday, February 28, 2018	0	-1	1,390	1,283
Current St. John's Temperature & Windchill:	-6 °C	-14 °C		Thursday, March 01, 2018	1	2	1,335	1,228
7-Day Island Peak Demand Forecast:	1,565	MW		Friday, March 02, 2018	2	1	1,235	1,125

Supply Notes For February 24, 2018

3

- Notes:
1.
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
2.
- Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
3.
- As of 0800 Hours.
4.
- Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
5.
- Gross output from all Island sources (including Note 4).
6.
- NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
7.
- Adjusted for CBP&P, Vale and Praxair interruptible load, Maritime Link Exports and the impact of voltage reduction (when applicable).

Section 3

Island Peak Demand Information

Previous Day Actual Peak and Current Day Forecast Peak

Fri, Feb 23, 2018	Actual Island Peak Demand ⁸	07:45	1,628 MW
Sat, Feb 24, 2018	Forecast Island Peak Demand		1,495 MW

- Notes:
8.
- Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).