


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, May 14, 2018**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Friday, May 11, 2018**

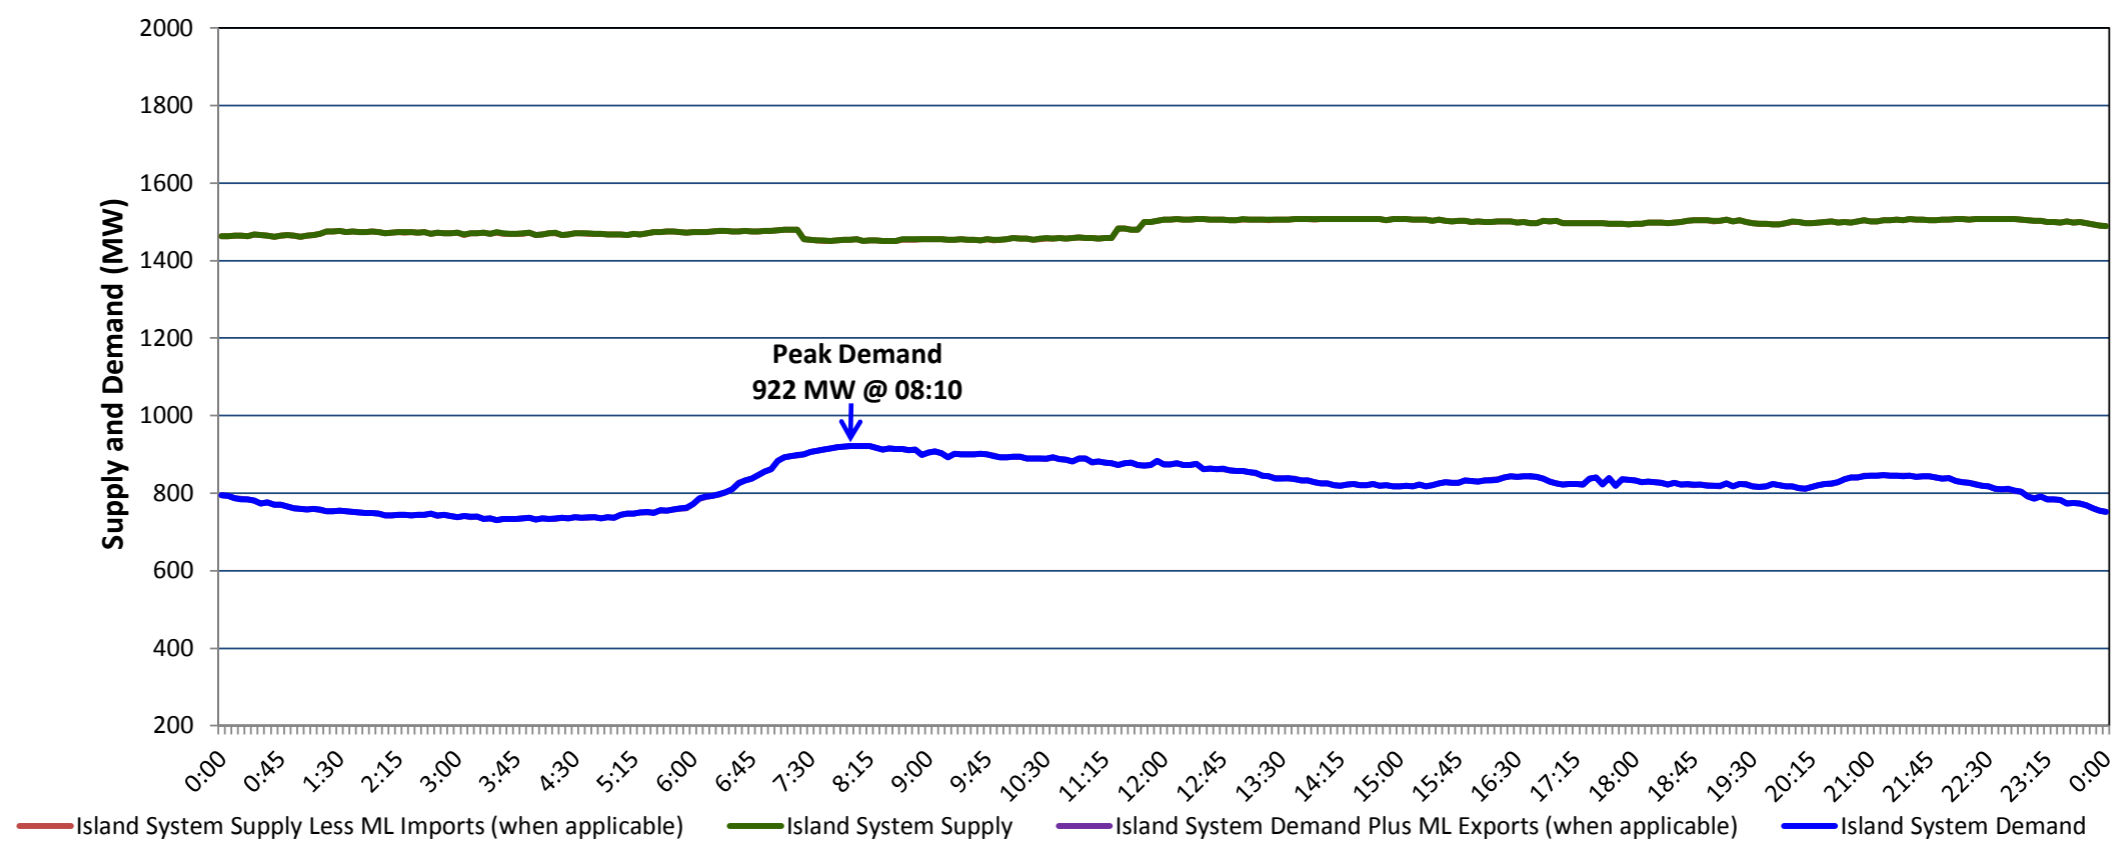

Supply Notes For May 11, 2018

1,2

- A As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 0801 hours, April 02, 2018, Holyrood Unit 3 unavailable due to planned outage 110 MW (150 MW).
- C As of 0938 hours, April 26, 2018, Holyrood Unit 2 removed from service for economic dispatch 70 MW (170 MW).
- D As of 1800 hours, April 29, 2018, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- E As of 1202 hours, May 01, 2018, Hawkes Bay Diesel Plant available at 2.5 MW (5 MW).
- F As of 2330 hours, May 05, 2018, Holyrood Unit 1 available at 122 MW (170 MW).
- G As of 0623 hours, May 08, 2018, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- H At 0721 hours, May 11, 2018, Hardwoods Gas Turbine unavailable due to planned outage 25 MW (50 MW).
- I At 1122 hours, May 11, 2018, Hardwoods Gas Turbine available at 25 MW (50 MW).
- J At 1144 hours, May 11, 2018, Hardwoods Gas Turbine available at full capacity (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Sat, May 12, 2018	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,495	MW	Saturday, May 12, 2018	3	4	990	990
NLH Generation: ⁴	1,145	MW	Sunday, May 13, 2018	3	6	1,005	1,005
NLH Power Purchases: ⁶	135	MW	Monday, May 14, 2018	6	6	1,010	1,010
Maritime Link Imports:	-	MW	Tuesday, May 15, 2018	7	11	935	935
Other Island Generation:	215	MW	Wednesday, May 16, 2018	7	5	1,035	1,035
Current St. John's Temperature & Windchill:	4 °C	N/A °C	Thursday, May 17, 2018	3	5	1,090	1,090
7-Day Island Peak Demand Forecast:	1,130	MW	Friday, May 18, 2018	2	4	1,130	1,130

Supply Notes For May 12, 2018

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
 7. Adjusted for CBPP, Vale and Praxair interruptible load, Maritime Link exports and the impact of voltage reduction, when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Fri, May 11, 2018	Actual Island Peak Demand ⁸	08:10	922 MW
Sat, May 12, 2018	Forecast Island Peak Demand		990 MW

Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).