


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, June 05, 2018

Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, June 04, 2018

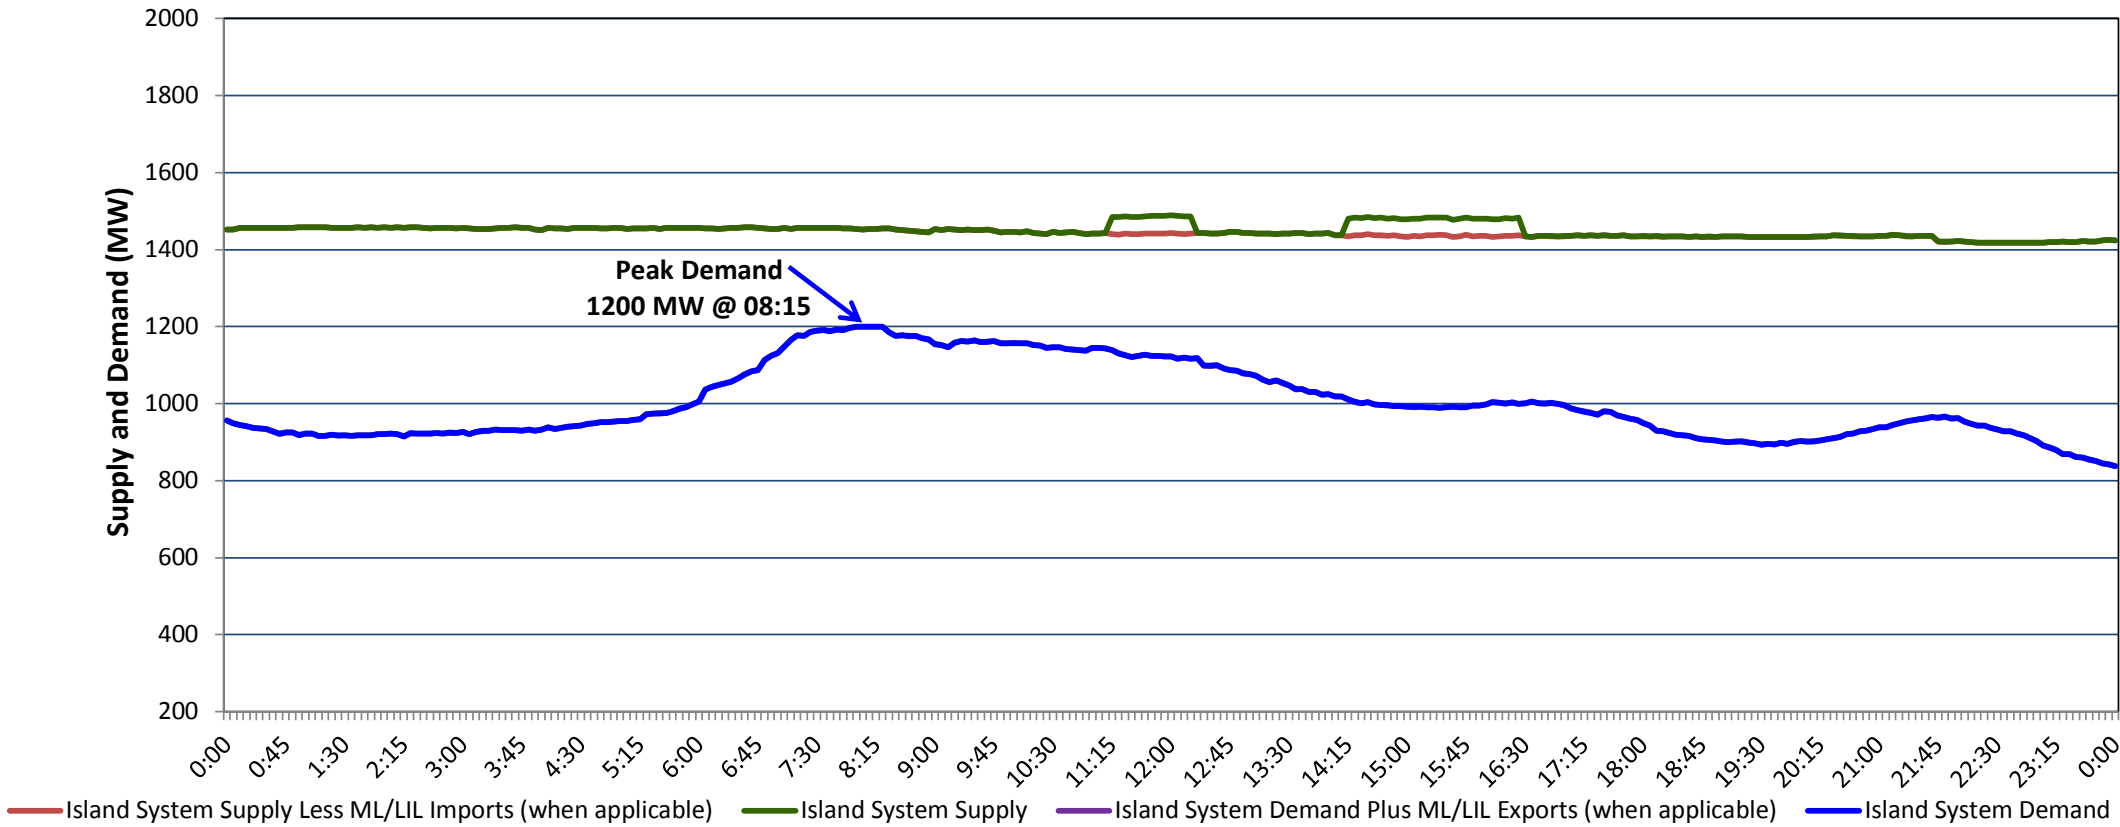

Supply Notes For June 04, 2018

- A As of 0801 hours, April 02, 2018, Holyrood Unit 3 unavailable due to planned outage 110 MW (150 MW).
- B As of 1800 hours, April 29, 2018, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- C As of 0623 hours, May 08, 2018, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- D As of 0801 hours, May 15, 2018, St. Anthony Diesel Plant available at 7.7 MW (9.7 MW).
- E As of 1438 hours, May 22, 2018, Holyrood Unit 2 unavailable due to planned outage 70 MW (170 MW).
- F As of 1357 hours, June 01, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- G As of 1430 hours, June 02, 2018, Hardwoods Gas Turbine available at 25 MW (50 MW).
- H At 2143 hours, June 04, 2018, Holyrood Unit 1 available at 100 MW (170 MW).

Section 2
Island Interconnected Supply and Demand

Tue, Jun 05, 2018	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,405	MW		Tuesday, June 05, 2018	4	5	1,065	1,065
NLH Generation: ⁴	1,100	MW		Wednesday, June 06, 2018	3	2	1,110	1,110
NLH Power Purchases: ⁶	110	MW		Thursday, June 07, 2018	7	6	915	915
Maritime Link/LIL Imports:	-	MW		Friday, June 08, 2018	6	9	905	905
Other Island Generation:	195	MW		Saturday, June 09, 2018	8	6	855	855
Current St. John's Temperature & Windchill: 4 °C	N/A	°C		Sunday, June 10, 2018	5	6	945	945
7-Day Island Peak Demand Forecast:	1,110	MW		Monday, June 11, 2018	7	7	970	970

Supply Notes For June 05, 2018

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 - As of 0800 Hours.
 - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - Gross output from all Island sources (including Note 4).
 - NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
 - Adjusted for CBPP, Vale and Praxair interruptible load, Maritime Link/LIL exports and the impact of voltage reduction, when applicable.

Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

Mon, Jun 04, 2018	Actual Island Peak Demand ⁸	08:15	1,200 MW
Tue, Jun 05, 2018	Forecast Island Peak Demand		1,065 MW

Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).