


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, April 09, 2019**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Monday, April 08, 2019**

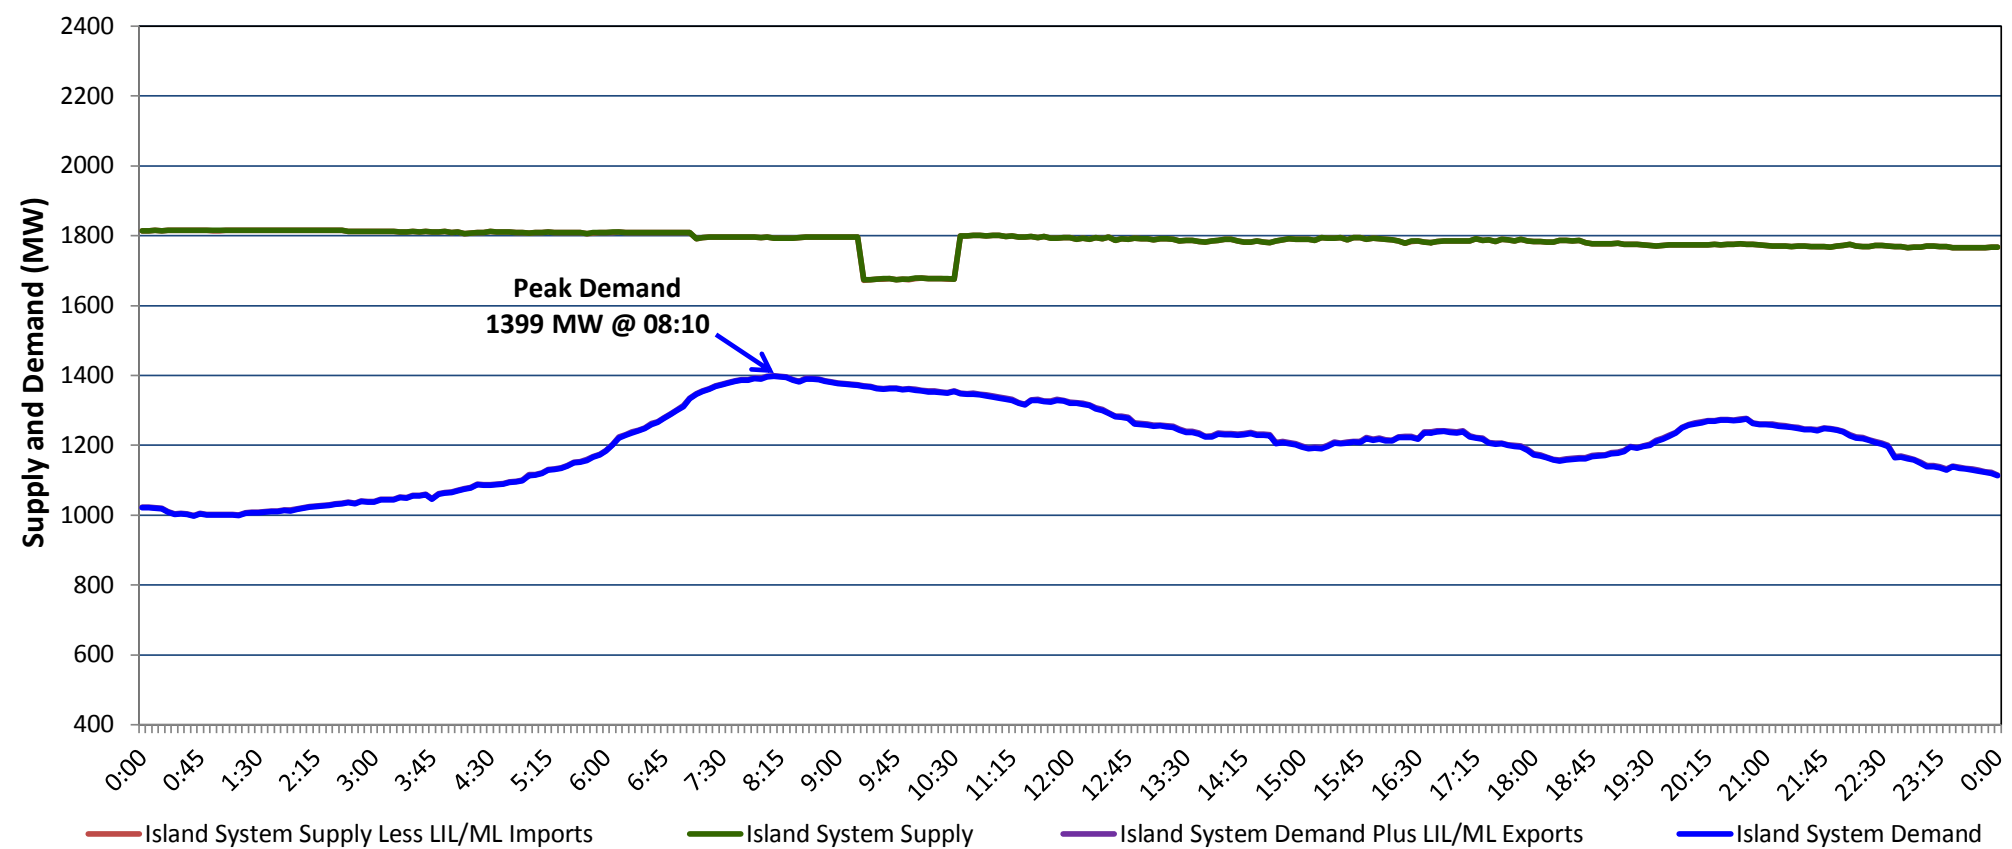

**Supply Notes For April 08, 2019**

1,2

- A As of 1049 hours, March 22, 2019, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).  
 B As of 0000 hours, April 01, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).  
 C As of 1038 hours, April 01, 2019, Hardwoods Gas Turbine available at 25 MW (50 MW).  
 D At 0920 hours, April 08, 2019, Holyrood Gas Turbine unavailable due to planned outage (123.5 MW).  
 E At 1035 hours, April 08, 2019, Holyrood Gas Turbine available (123.5 MW).

**Section 2  
Island Interconnected Supply and Demand**

Tue, Apr 09, 2019	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,770 MW	Tuesday, April 09, 2019	-6	-2	1,445	1,365
NLH Island Generation: <sup>4</sup>	1,440 MW	Wednesday, April 10, 2019	-1	2	1,375	1,295
NLH Island Power Purchases: <sup>6</sup>	115 MW	Thursday, April 11, 2019	0	0	1,270	1,190
Other Island Generation:	215 MW	Friday, April 12, 2019	0	-1	1,300	1,220
ML/LIL Imports:	- MW	Saturday, April 13, 2019	-2	0	1,245	1,165
Current St. John's Temperature & Windchill: -7 °C	-17 °C	Sunday, April 14, 2019	1	2	1,135	1,055
7-Day Island Peak Demand Forecast:	1,445 MW	Monday, April 15, 2019	3	1	1,140	1,060

**Supply Notes For April 09, 2019**

3

- F At 0636 hours, April 09, 2019, Hawkes Bay Diesel Plant unavailable due to planned outage (5 MW).  
 G At 0645 hours, April 09, 2019, Hawkes Bay Diesel Plant available (5 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Apr 08, 2019	Actual Island Peak Demand <sup>8</sup>	08:10	1,399 MW
Tue, Apr 09, 2019	Forecast Island Peak Demand		1,445 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).