


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Wednesday, April 24, 2019**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Tuesday, April 23, 2019**

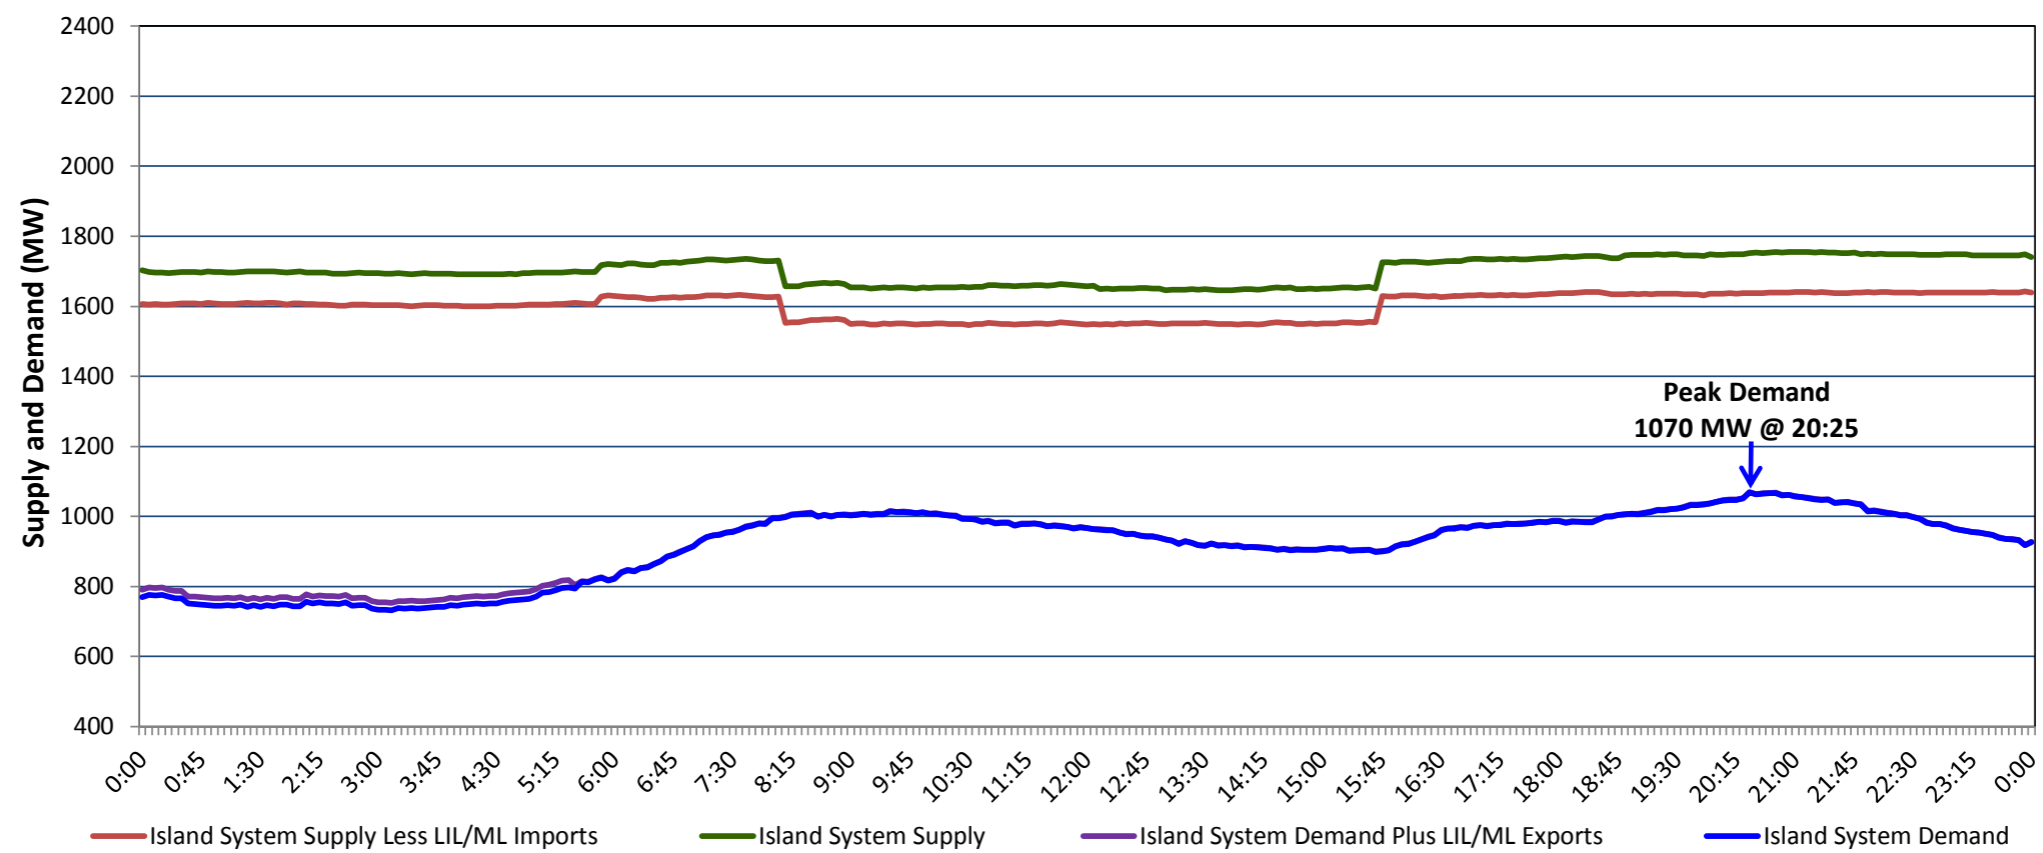

**Supply Notes For April 23, 2019**

- 1,2
- A As of 0000 hours, April 01, 2019, Holyrood Unit 3 unavailable due to planned outage (150 MW).
  - B As of 1134 hours, April 12, 2019, Holyrood Unit 2 unavailable (170 MW).
  - C As of 2225 hours, April 17, 2019, Cat Arm Plant available at 100 MW due to lower than normal water levels (134 MW).
  - D As of 0700 hours, April 22, 2019, Hardwoods Gas Turbine unavailable due to planned outage 25 MW (50 MW).
  - E At 0808 hours, April 23, 2019, Hinds Lake Unit unavailable due to planned outage (75 MW).
  - F At 0900 hours, April 23, 2019, St. Anthony Diesel Plant unavailable due to planned outage 7.7 MW (9.7 MW).
  - G At 1542 hours, April 23, 2019, Hinds Lake Unit available (75 MW).

**Section 2  
Island Interconnected Supply and Demand**

Wed, Apr 24, 2019	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,737 MW	Wednesday, April 24, 2019	-1	1	1,260	1,180
NLH Island Generation: <sup>4</sup>	1,280 MW	Thursday, April 25, 2019	1	0	1,275	1,195
NLH Island Power Purchases: <sup>6</sup>	120 MW	Friday, April 26, 2019	1	1	1,200	1,120
Other Island Generation:	220 MW	Saturday, April 27, 2019	2	2	1,140	1,060
ML/LIL Imports:	117 MW	Sunday, April 28, 2019	1	6	1,200	1,120
Current St. John's Temperature & Windchill:	-2 °C	Monday, April 29, 2019	5	7	1,055	975
7-Day Island Peak Demand Forecast:	1,275 MW	Tuesday, April 30, 2019	8	5	1,015	935

**Supply Notes For April 24, 2019**

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Apr 23, 2019	Actual Island Peak Demand <sup>8</sup>	20:25	1,070 MW
Wed, Apr 24, 2019	Forecast Island Peak Demand		1,260 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).