


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, July 22, 2019**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Friday, July 19, 2019**

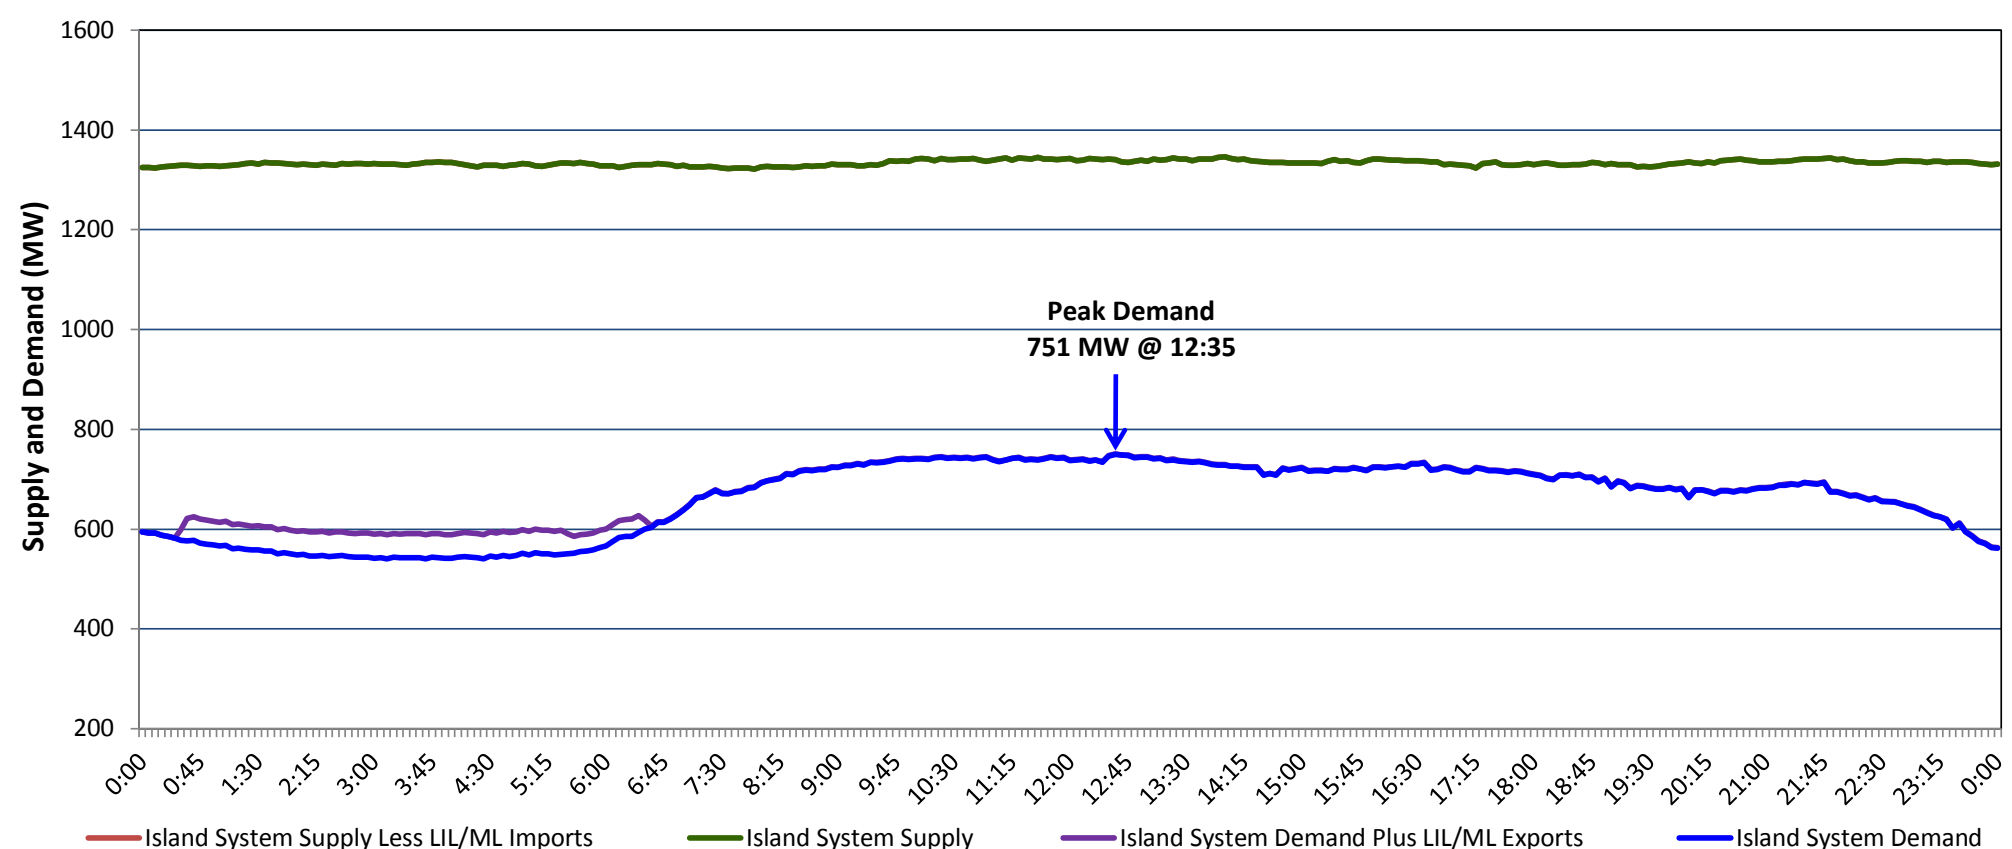

Supply Notes For July 19, 2019

1,2

- A As of 1303 hours, May 26, 2019, Bay d'Espoir Unit 7 unavailable due to planned outage (153.4 MW).
- B As of 1436 hours, June 15, 2019, Holyrood Unit 1 removed from service for economic dispatch (170 MW).
- C As of 0800 hours, June 17, 2019, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- D As of 1457 hours, June 28, 2019, Stephenville Gas Turbine available at 25 MW (50 MW).
- E At 1400 hours, July 19, 2019, St. Anthony Diesel Plant available at full capacity (9.7 MW).
- F At 1700 hours, July 19, 2019, Holyrood Unit 3 removed from service for economic dispatch (150 MW).

**Section 2
Island Interconnected Supply and Demand**

Sat, Jul 20, 2019	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,275 MW	Saturday, July 20, 2019	13	9	740	740
NLH Island Generation: ⁴	1,025 MW	Sunday, July 21, 2019	12	11	745	745
NLH Island Power Purchases: ⁶	80 MW	Monday, July 22, 2019	12	11	790	790
Other Island Generation:	170 MW	Tuesday, July 23, 2019	11	11	780	780
ML/LIL Imports:	- MW	Wednesday, July 24, 2019	12	13	805	805
Current St. John's Temperature & Windchill:	15 °C	Thursday, July 25, 2019	14	14	750	750
7-Day Island Peak Demand Forecast:	805 MW	Friday, July 26, 2019	15	18	770	770

Supply Notes For July 20, 2019

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Fri, Jul 19, 2019	Actual Island Peak Demand ⁸	12:35	751 MW
Sat, Jul 20, 2019	Forecast Island Peak Demand		740 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).