


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, October 08, 2019**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Monday, October 07, 2019**

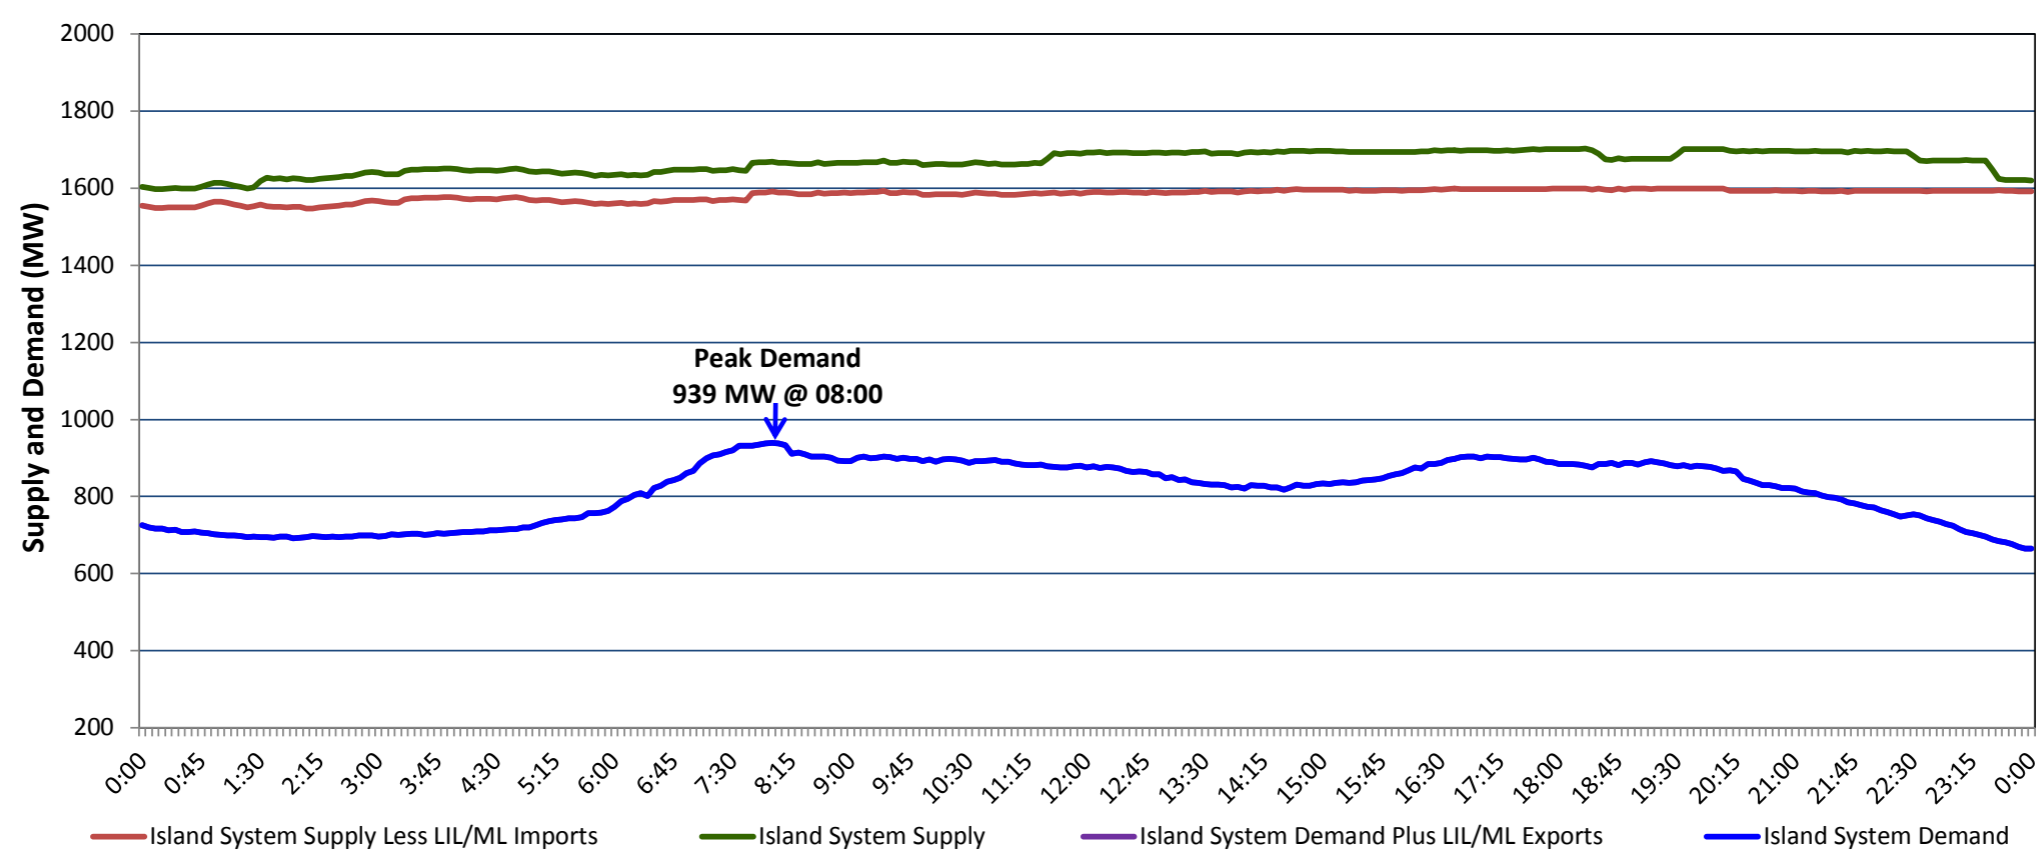

**Supply Notes For October 07, 2019**

- A As of 0800 hours, July 29, 2019, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 1150 hours, August 18, 2019, Hinds Lake Unit unavailable due to planned outage (75 MW).
- C As of 1300 hours, August 28, 2019, Stephenville Gas Turbine available at 25 MW (50 MW).
- D As of 0801 hours, September 29, 2019, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
- E As of 0830 hours, October 04, 2019, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- F As of 1011 hours, October 04, 2019, Bay d'Espoir Unit 3 available at 70 MW (76.5 MW).
- G As of 1215 hours, October 05, 2019, Upper Salmon Unit unavailable due to planned outage (84 MW).

**Section 2  
Island Interconnected Supply and Demand**

Tue, Oct 08, 2019	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,629 MW	Tuesday, October 08, 2019	14	13	865	865
NLH Island Generation: <sup>4</sup>	1,280 MW	Wednesday, October 09, 2019	9	8	875	875
NLH Island Power Purchases: <sup>6</sup>	105 MW	Thursday, October 10, 2019	7	6	960	960
Other Island Generation:	195 MW	Friday, October 11, 2019	6	7	940	940
ML/LIL Imports:	49 MW	Saturday, October 12, 2019	8	10	880	880
Current St. John's Temperature & Windchill:	14 °C	Sunday, October 13, 2019	7	11	890	890
7-Day Island Peak Demand Forecast:	960 MW	Monday, October 14, 2019	14	10	895	895

**Supply Notes For October 08, 2019**

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Oct 07, 2019	Actual Island Peak Demand <sup>8</sup>	08:00	939 MW
Tue, Oct 08, 2019	Forecast Island Peak Demand		865 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).