


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Wednesday, August 05, 2020**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Tuesday, August 04, 2020**

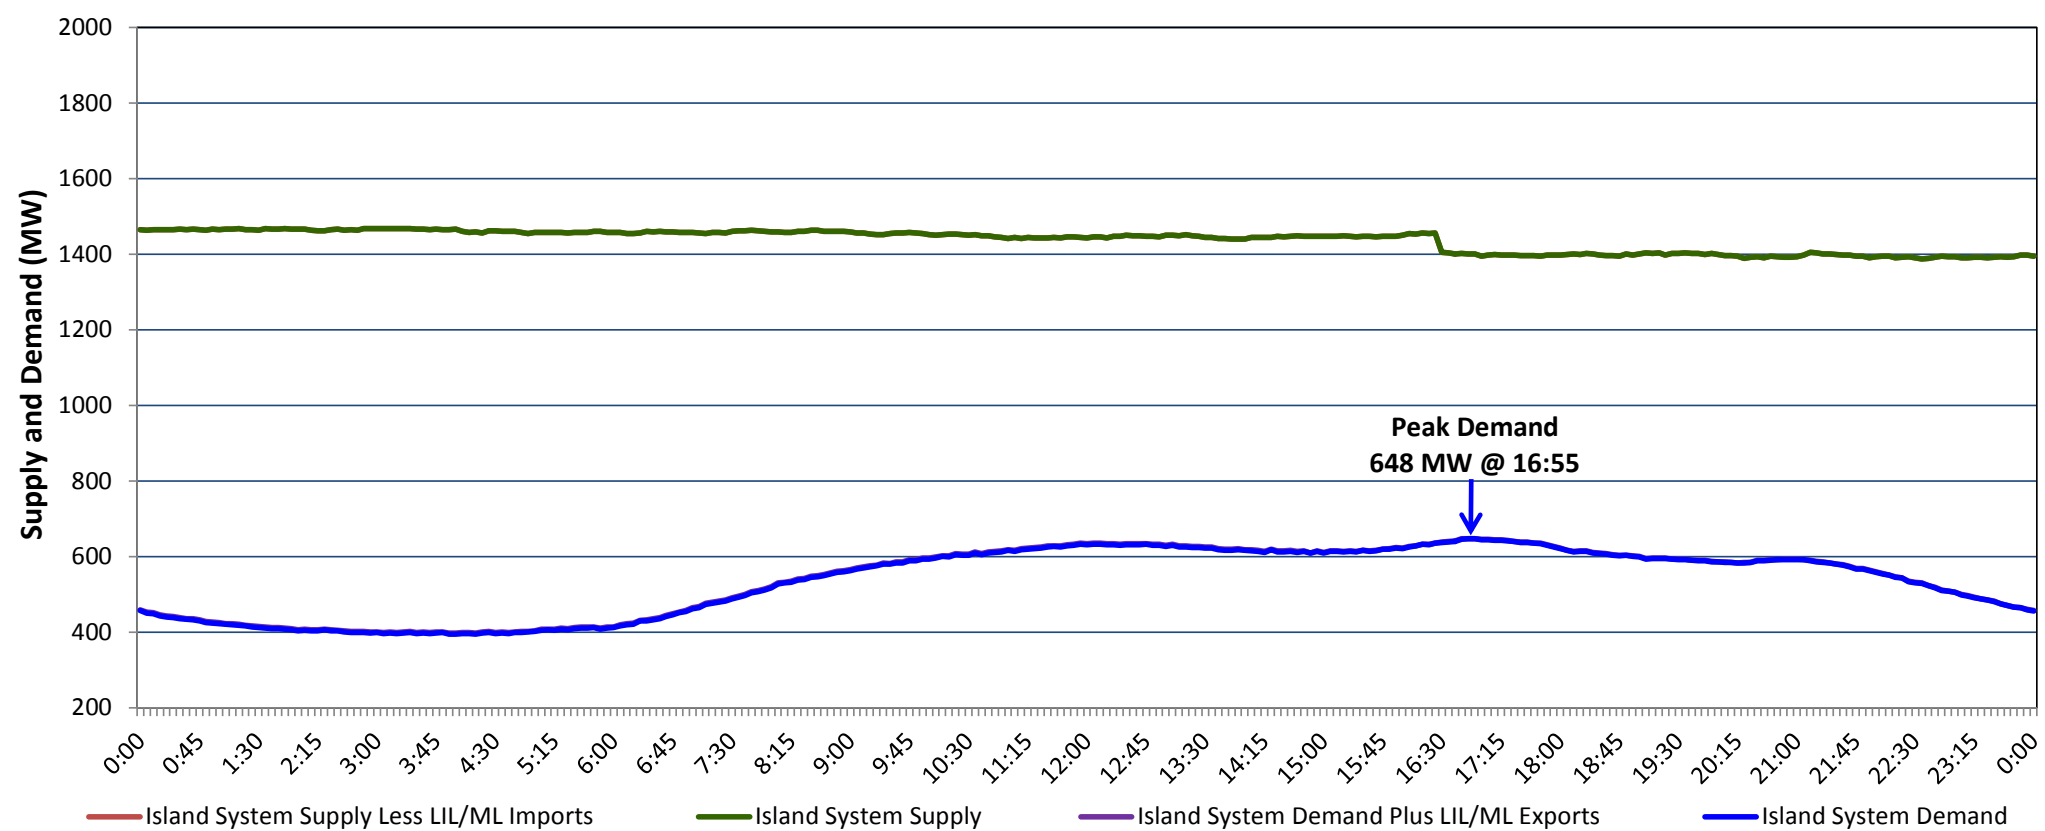

**Supply Notes For August 04, 2020**

1,2

- A As of 1415 hours, June 11, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- C As of 0808 hours, July 15, 2020, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- D As of 1222 hours, July 26, 2020, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
- E **At 1628 hours, August 04, 2020, Hardwoods Gas Turbine unavailable (50 MW).**

**Section 2  
Island Interconnected Supply and Demand**

Wed, Aug 05, 2020	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	<b>1,370 MW</b>	Wednesday, August 05, 2020	13	16	<b>615</b>	<b>615</b>
NLH Island Generation: <sup>4</sup>	1,085 MW	Thursday, August 06, 2020	17	20	640	640
NLH Island Power Purchases: <sup>6</sup>	85 MW	Friday, August 07, 2020	20	20	645	645
Other Island Generation:	200 MW	Saturday, August 08, 2020	18	18	600	600
ML/LIL Imports:	- MW	Sunday, August 09, 2020	17	17	690	690
Current St. John's Temperature & Windchill:	11 °C	Monday, August 10, 2020	17	18	740	740
7-Day Island Peak Demand Forecast:	<b>755 MW</b>	Tuesday, August 11, 2020	20	21	755	755

**Supply Notes For August 05, 2020**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Aug 04, 2020	Actual Island Peak Demand <sup>8</sup>	16:55	648 MW
Wed, Aug 05, 2020	Forecast Island Peak Demand		615 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).