


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Tuesday, August 18, 2020**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Monday, August 17, 2020**

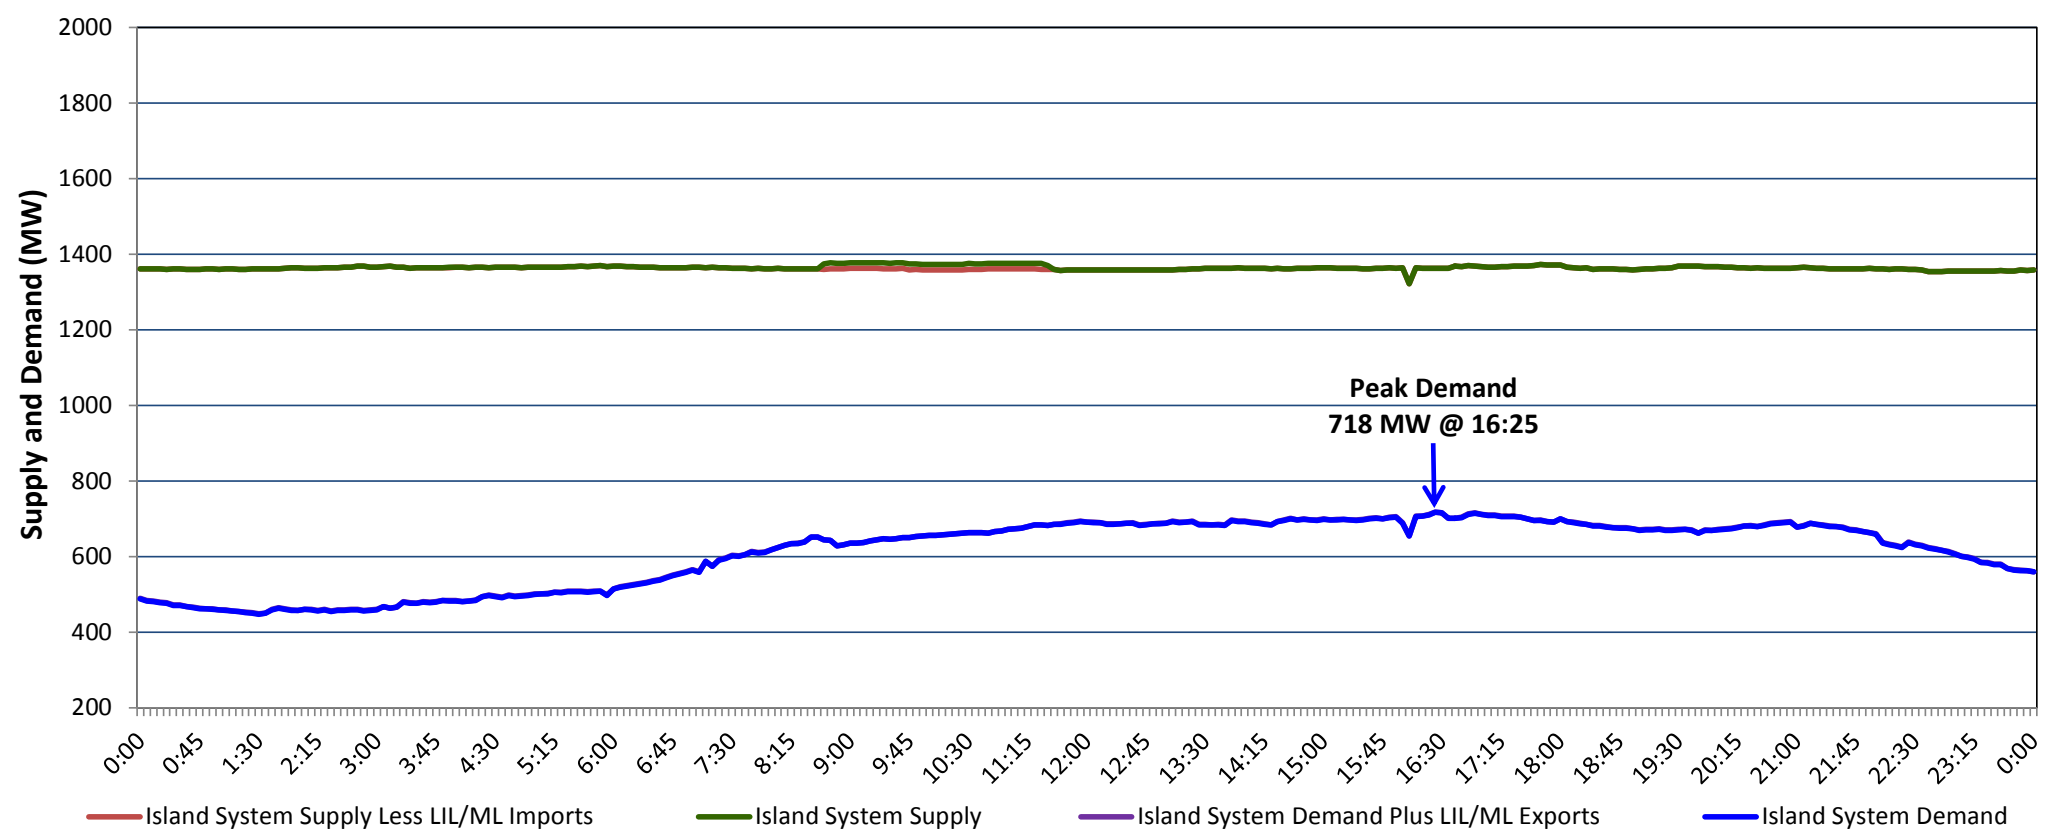

**Supply Notes For August 17, 2020**

1,2

- A As of 1415 hours, June 11, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- C As of 0808 hours, July 15, 2020, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- D As of 1222 hours, July 26, 2020, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
- E As of 1229 hours, August 16, 2020, Cat Arm Unit 1 unavailable due to planned outage (67 MW).

**Section 2  
Island Interconnected Supply and Demand**

Tue, Aug 18, 2020	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	<b>1,380</b> MW	Tuesday, August 18, 2020	16	13	<b>730</b>	<b>730</b>
NLH Island Generation: <sup>4</sup>	1,070 MW	Wednesday, August 19, 2020	18	19	720	720
NLH Island Power Purchases: <sup>6</sup>	110 MW	Thursday, August 20, 2020	18	18	725	725
Other Island Generation:	200 MW	Friday, August 21, 2020	17	17	730	730
ML/LIL Imports:	-	Saturday, August 22, 2020	15	17	695	695
Current St. John's Temperature & Windchill:	15 °C	Sunday, August 23, 2020	16	16	695	695
7-Day Island Peak Demand Forecast:	<b>730</b> MW	Monday, August 24, 2020	16	14	730	730

**Supply Notes For August 18, 2020**

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Aug 17, 2020	Actual Island Peak Demand <sup>8</sup>	16:25	718 MW
Tue, Aug 18, 2020	Forecast Island Peak Demand		730 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).