


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, August 20, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, August 19, 2020**

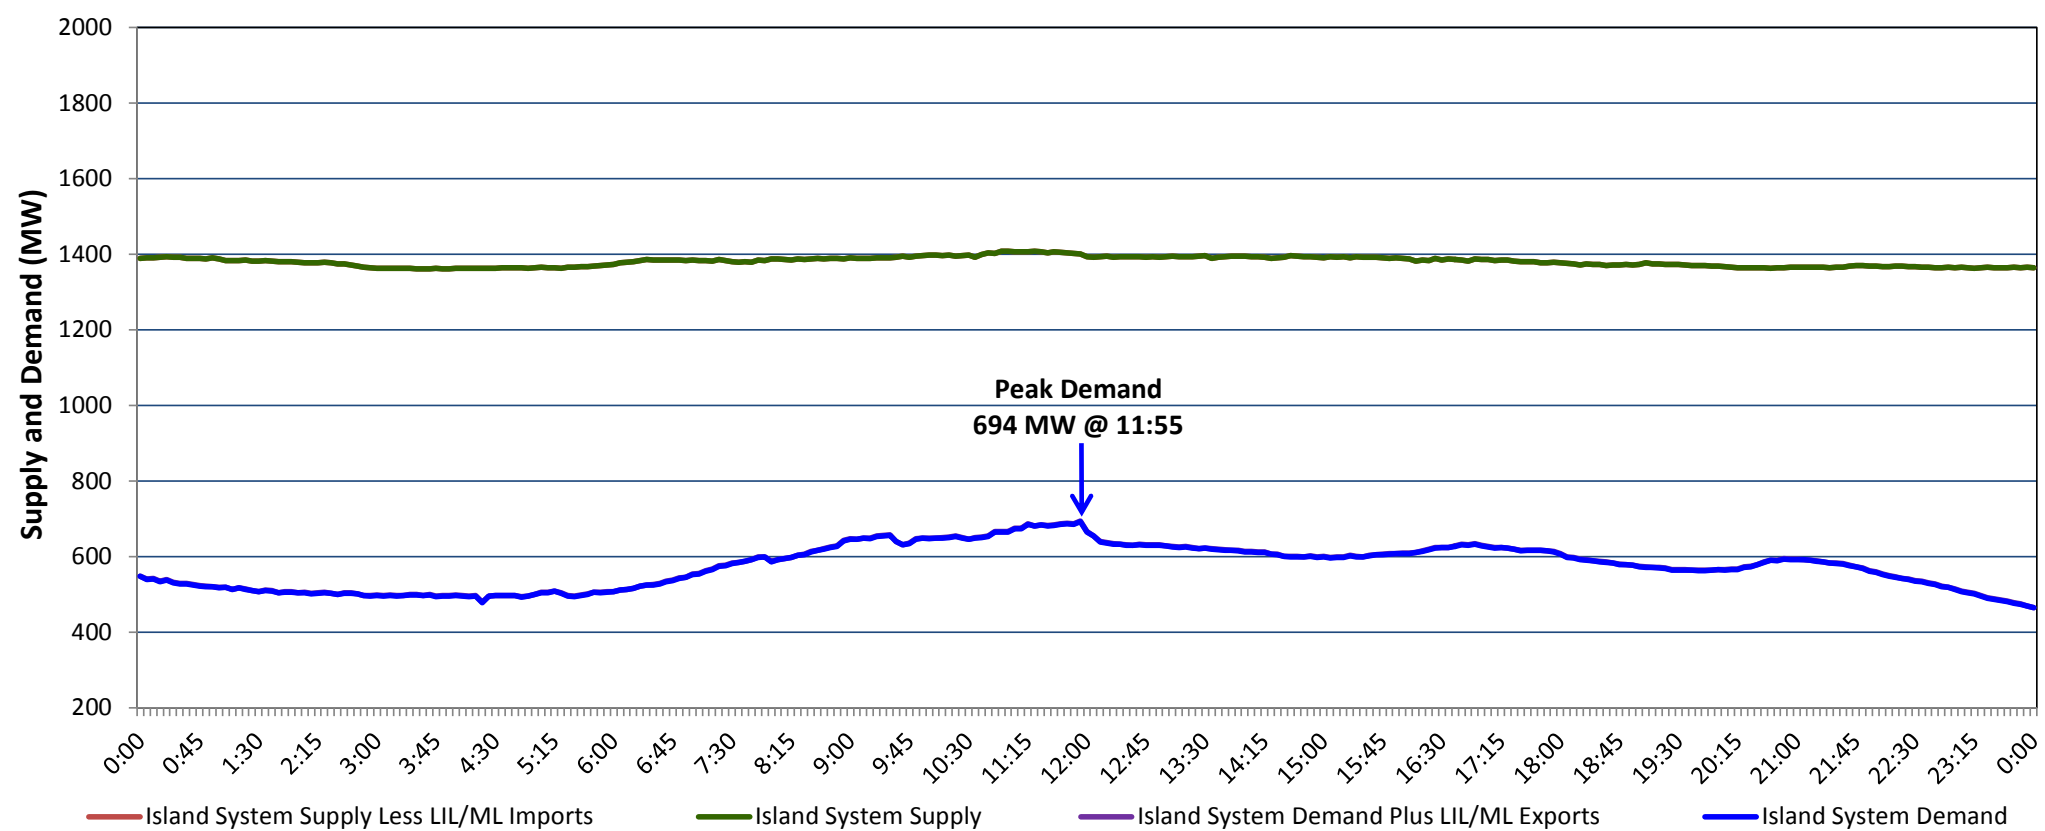

Supply Notes For August 19, 2020

1,2

- A As of 1415 hours, June 11, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- C As of 0808 hours, July 15, 2020, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- D As of 1222 hours, July 26, 2020, Cat Arm Unit 2 unavailable due to planned outage (67 MW).
- E As of 1229 hours, August 16, 2020, Cat Arm Unit 1 unavailable due to planned outage (67 MW).

**Section 2
Island Interconnected Supply and Demand**

| Thu, Aug 20, 2020 | Island System Outlook ³ | | Seven-Day Forecast | Temperature (°C) | | Island System Daily Peak Demand (MW) | |
|--|------------------------------------|--------|----------------------------|------------------|---------|--------------------------------------|-----------------------|
| | | | | Morning | Evening | Forecast | Adjusted ⁷ |
| Available Island System Supply: ⁵ | 1,370 | MW | Thursday, August 20, 2020 | 19 | 19 | 720 | 720 |
| NLH Island Generation: ⁴ | 1,070 | MW | Friday, August 21, 2020 | 17 | 18 | 730 | 730 |
| NLH Island Power Purchases: ⁶ | 100 | MW | Saturday, August 22, 2020 | 14 | 17 | 690 | 690 |
| Other Island Generation: | 200 | MW | Sunday, August 23, 2020 | 16 | 16 | 685 | 685 |
| ML/LIL Imports: | - | MW | Monday, August 24, 2020 | 16 | 17 | 740 | 740 |
| Current St. John's Temperature & Windchill: | 16 °C | N/A °C | Tuesday, August 25, 2020 | 17 | 15 | 735 | 735 |
| 7-Day Island Peak Demand Forecast: | 765 | MW | Wednesday, August 26, 2020 | 14 | 13 | 765 | 765 |

Supply Notes For August 20, 2020

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

| | | | |
|-------------------|--|-------|--------|
| Wed, Aug 19, 2020 | Actual Island Peak Demand ⁸ | 11:55 | 694 MW |
| Thu, Aug 20, 2020 | Forecast Island Peak Demand | | 720 MW |

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).