


**Newfoundland Labrador Hydro (NLH)  
Supply and Demand Status Report Filed Thursday, October 15, 2020**

**Section 1  
Island Interconnected System Supply, Demand & Exports  
Actual 24 Hour System Performance For Wednesday, October 14, 2020**

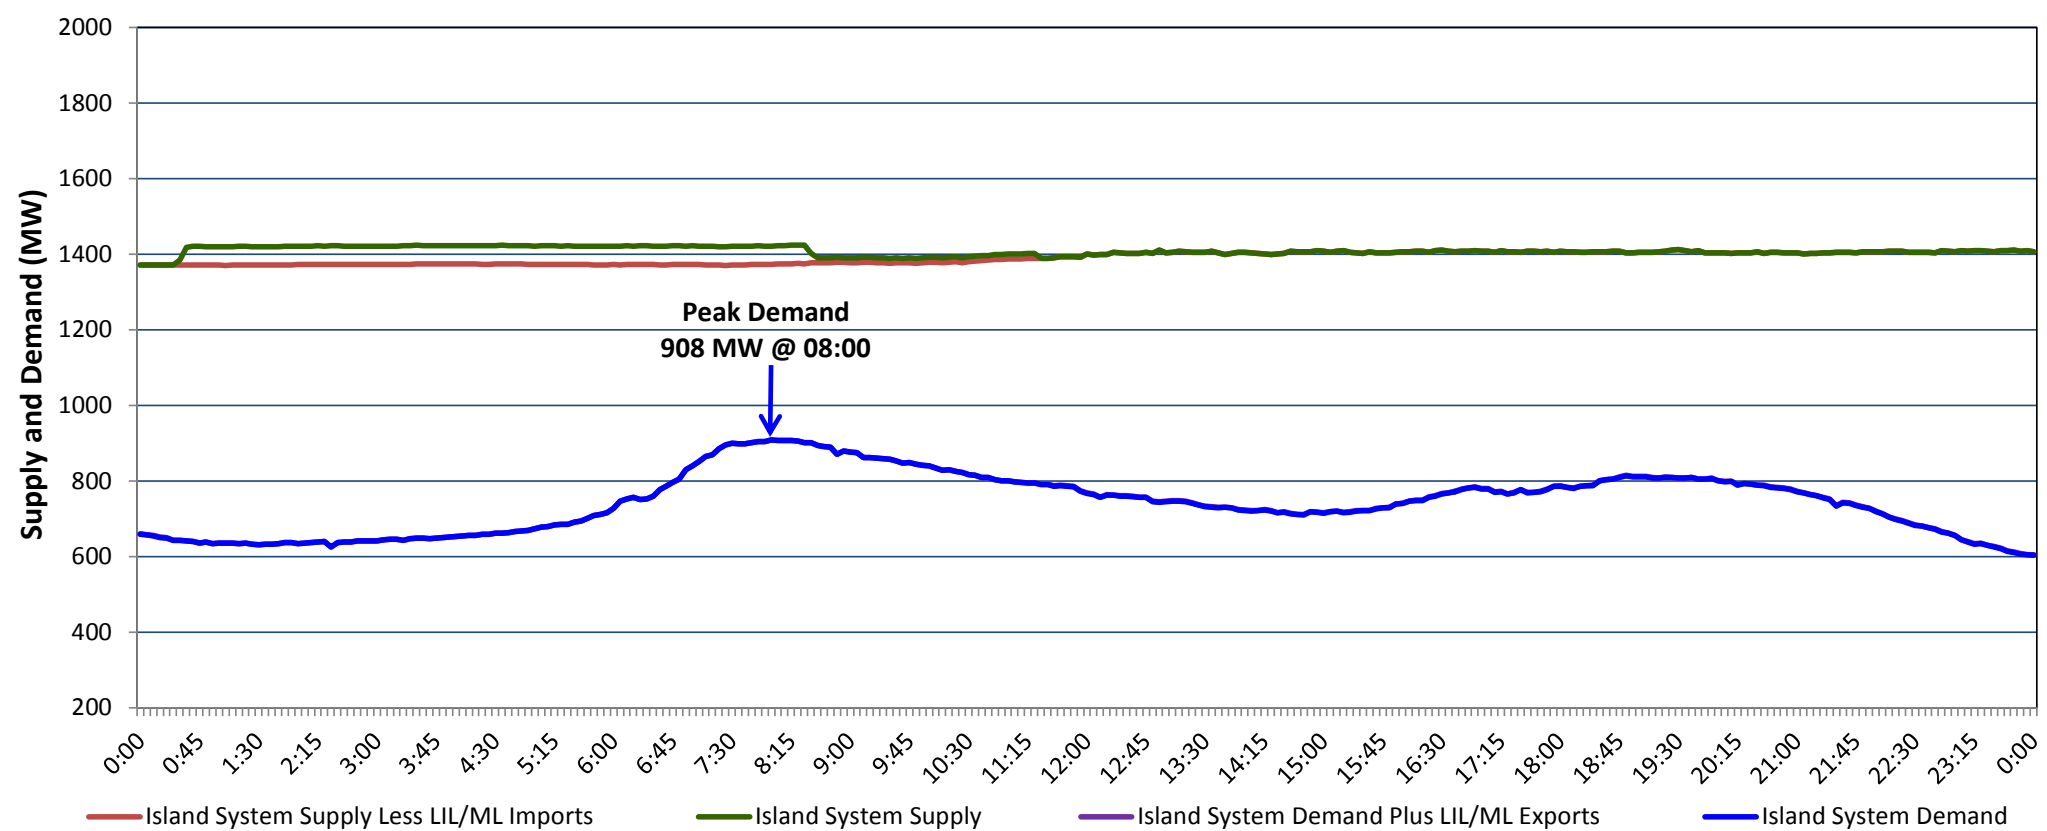

**Supply Notes For October 14, 2020**

1,2

- A As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- B As of 0808 hours, July 15, 2020, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- C As of 0734 hours, September 27, 2020, Hinds Lake Unit unavailable due to planned outage (75 MW).
- D As of 0648 hours, October 05, 2020, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
- E As of 1502 hours, October 10, 2020, Holyrood Unit 1 unavailable due to forced outage 150 MW (170 MW).

**Section 2  
Island Interconnected Supply and Demand**

Thu, Oct 15, 2020	Island System Outlook <sup>3</sup>	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,585 MW	Thursday, October 15, 2020	13	14	780	780
NLH Island Generation: <sup>4</sup>	1,200 MW	Friday, October 16, 2020	12	10	765	765
NLH Island Power Purchases: <sup>6</sup>	145 MW	Saturday, October 17, 2020	12	12	735	735
Other Island Generation:	240 MW	Sunday, October 18, 2020	12	12	775	775
ML/LIL Imports:	- MW	Monday, October 19, 2020	10	11	825	825
Current St. John's Temperature & Windchill:	12 °C	Tuesday, October 20, 2020	11	13	795	795
7-Day Island Peak Demand Forecast:	915 MW	Wednesday, October 21, 2020	8	8	915	915

**Supply Notes For October 15, 2020**

3

- F At 0000 hours, October 15, 2020, Holyrood Unit 1 available at 150 MW (170 MW).

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3  
Island Peak Demand Information  
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Oct 14, 2020	Actual Island Peak Demand <sup>8</sup>	08:00	908 MW
Thu, Oct 15, 2020	Forecast Island Peak Demand		780 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).