


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, December 29, 2020

Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, December 26, 2020

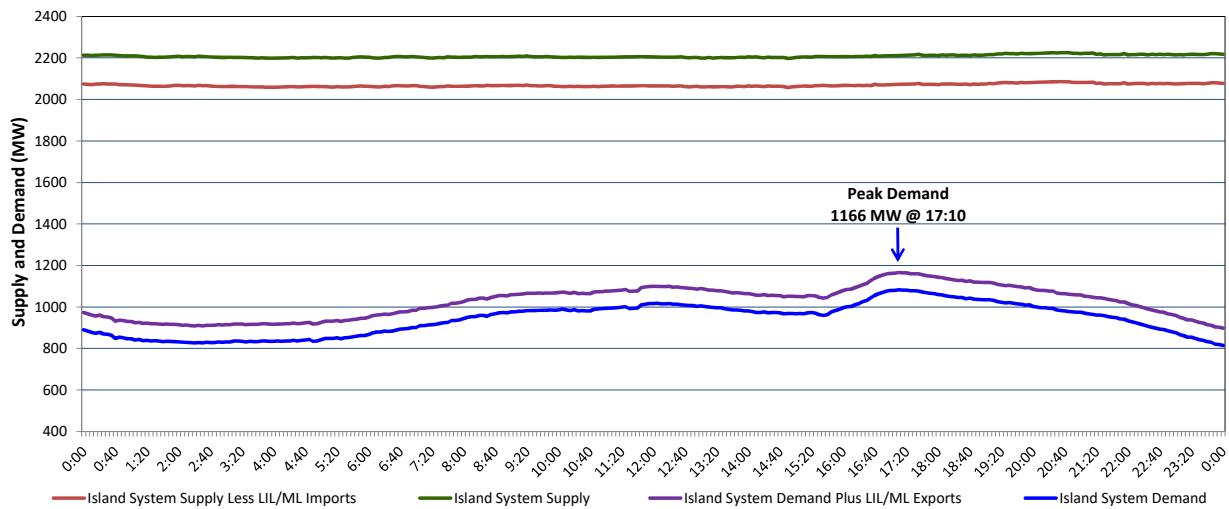

Supply Notes For December 26, 2020

^{1,2}

A As of 1903 hours, December 18, 2020, Hawkes Bay Diesel Plant available at 2.5 MW (5 MW).

Section 2
Island Interconnected Supply and Demand

Sun, Dec 27, 2020	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
	Morning	Evening	Forecast		Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,060	MW	Sunday, December 27, 2020	9	2	1,275	1,172	
NLH Island Generation: ⁴	1,690	MW	Monday, December 28, 2020	-3	-3	1,355	1,251	
NLH Island Power Purchases: ⁶	120	MW	Tuesday, December 29, 2020	-1	2	1,340	1,237	
Other Island Generation:	250	MW	Wednesday, December 30, 2020	2	-2	1,405	1,301	
ML/LIL Imports:	-	MW	Thursday, December 31, 2020	-5	-4	1,420	1,316	
Current St. John's Temperature & Windchill:	10	N/A °C	Friday, January 1, 2021	-5	-2	1,340	1,237	
7-Day Island Peak Demand Forecast:	1,420	MW	Saturday, January 2, 2021	-1	-4	1,385	1,281	

Supply Notes For December 27, 2020

³

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 - As of 0800 Hours.
 - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - Gross output from all Island sources (including Note 4).
 - NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 - Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak

Sat, Dec 26, 2020	Actual Island Peak Demand ⁸	17:10	1,166 MW
Sun, Dec 27, 2020	Forecast Island Peak Demand		1,275 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).