


**Newfoundland Labrador Hydro (NLH)**  
**Supply and Demand Status Report Filed Wednesday, January 13, 2021**

**Section 1**  
**Island Interconnected System Supply, Demand & Exports**  
**Actual 24 Hour System Performance For Tuesday, January 12, 2021**

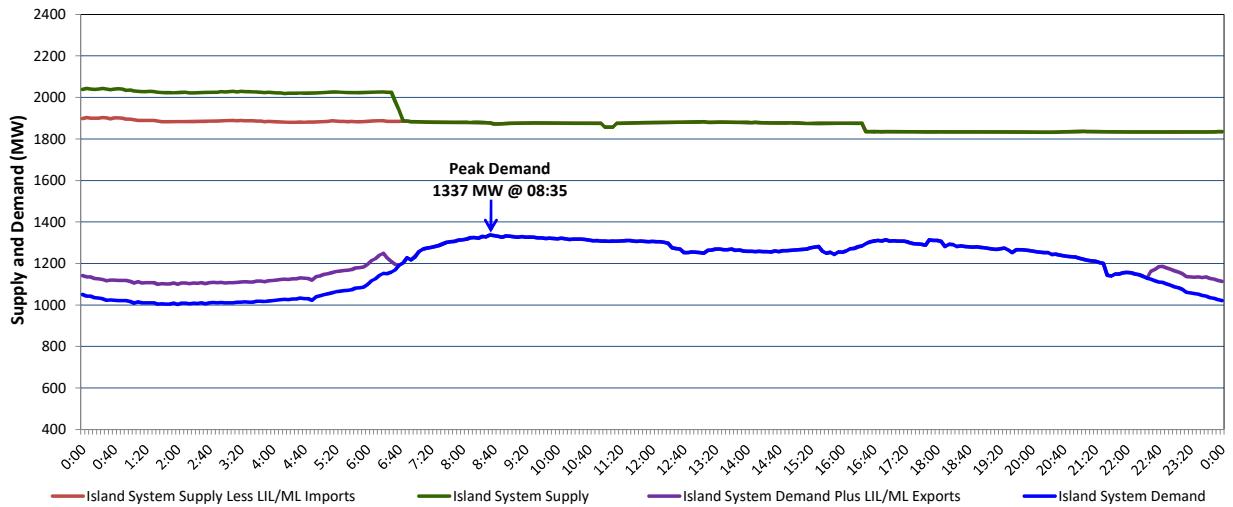

**Supply Notes For January 12, 2021**

A As of 1433 hours, January 05, 2021, Holyrood Unit 3 available but not operating (150 MW).

B At 1628 hours, January 12, 2021, Granite Canal Unit unavailable (40 MW).

**Section 2**  
**Island Interconnected Supply and Demand**

Wed, Jan 13, 2021	Island System Outlook <sup>3</sup>	Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)	
		Morning	Evening	Forecast	Adjusted <sup>7</sup>		
Available Island System Supply: <sup>5</sup>	1,845 MW	Wednesday, January 13, 2021	-3	-4	1,330	1,227	
NLH Island Generation: <sup>4</sup>	1,505 MW	Thursday, January 14, 2021	-2	0	1,325	1,222	
NLH Island Power Purchases: <sup>6</sup>	95 MW	Friday, January 15, 2021	0	-1	1,315	1,212	
Other Island Generation:	245 MW	Saturday, January 16, 2021	-2	-1	1,340	1,237	
ML/LIL Imports:	- MW	Sunday, January 17, 2021	0	2	1,260	1,157	
Current St. John's Temperature & Windchill:	-3 °C	-7 °C	Monday, January 18, 2021	1	1	1,310	1,207
7-Day Island Peak Demand Forecast:	1,340 MW	Tuesday, January 19, 2021	1	4	1,295	1,192	

**Supply Notes For January 13, 2021**

<sup>3</sup>

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  - Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  - As of 0800 Hours.
  - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  - Gross output from all Island sources (including Note 4).
  - NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  - Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3**  
**Island Peak Demand Information**  
**Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Jan 12, 2021	Actual Island Peak Demand <sup>8</sup>	8:35	1,337 MW
Wed, Jan 13, 2021	Forecast Island Peak Demand		1,330 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).