


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Wednesday, February 03, 2021

### Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Tuesday, February 02, 2021

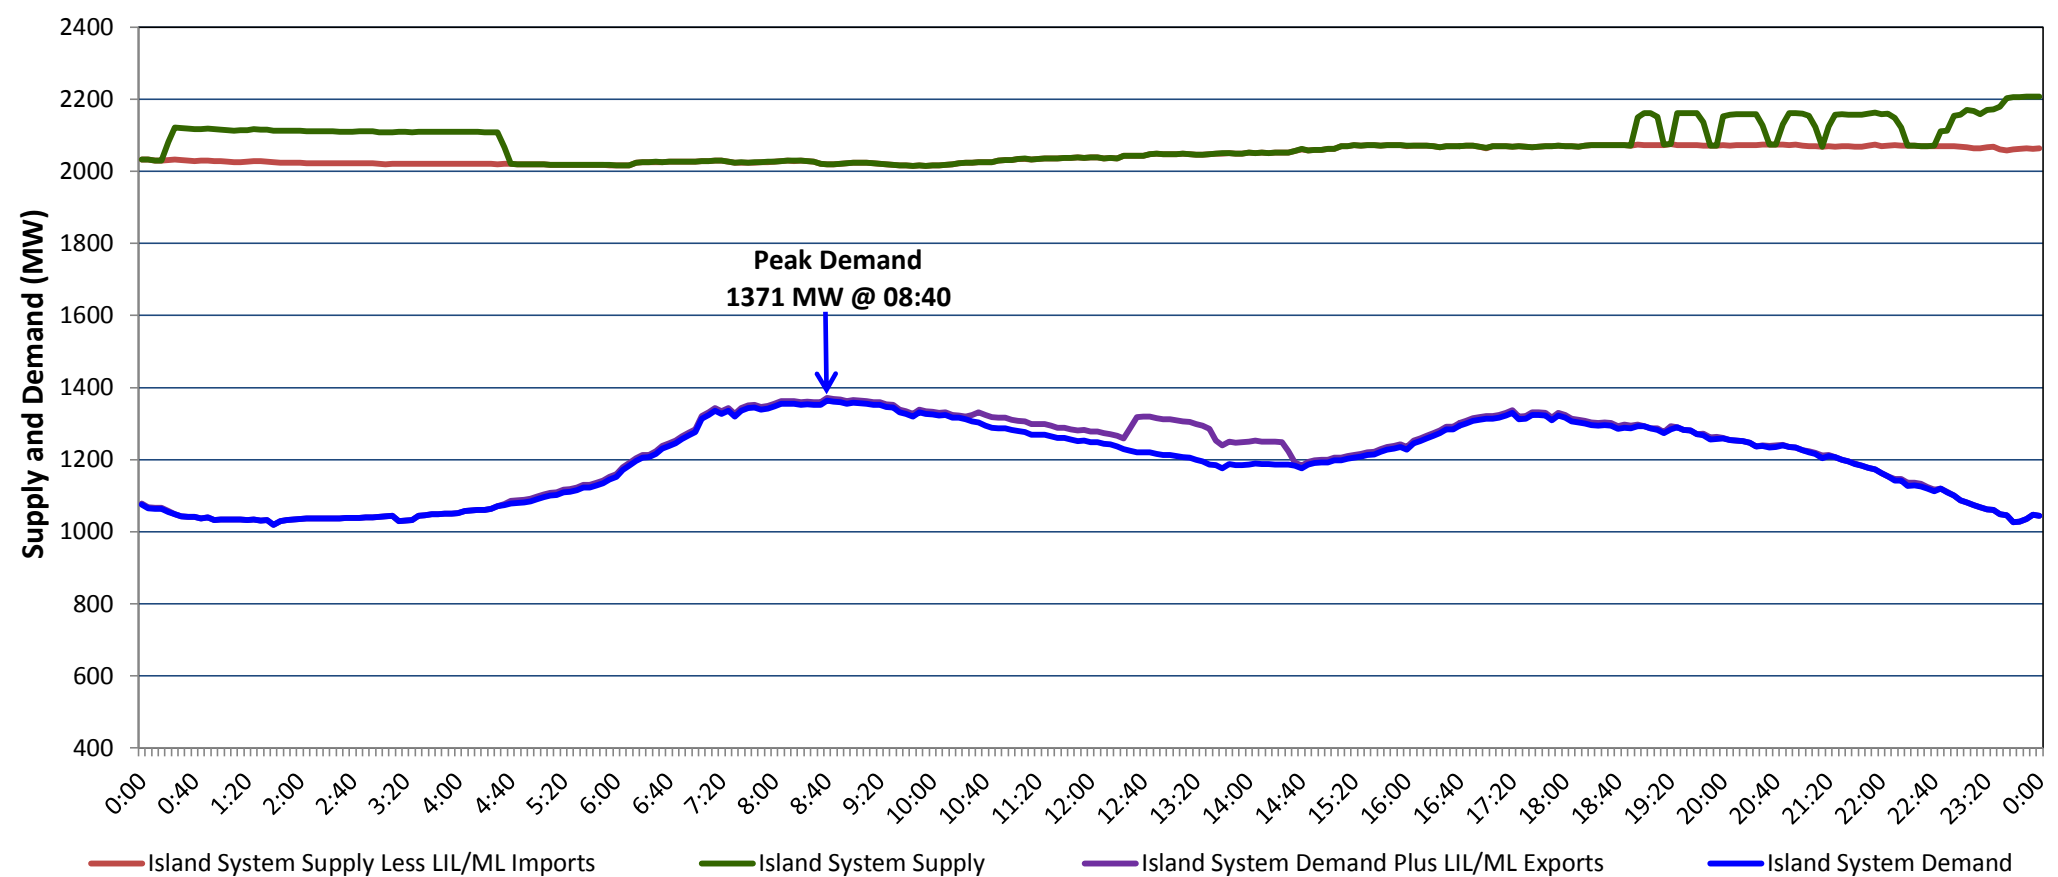

#### Supply Notes For February 02, 2021

1,2

A At 0800 hours, February 02, 2021, St. Anthony Diesel Plant available at 8.7 MW (9.7 MW).

B At 1605 hours, February 02, 2021, St. Anthony Diesel Plant available at full capacity (9.7 MW).

### Section 2 Island Interconnected Supply and Demand

Wed, Feb 03, 2021	Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	2,183	MW	Wednesday, February 03, 2021	-1	6	1,375	1,271
NLH Island Generation: <sup>4</sup>	1,695	MW	Thursday, February 04, 2021	5	2	1,230	1,128
NLH Island Power Purchases: <sup>6</sup>	115	MW	Friday, February 05, 2021	3	-1	1,250	1,148
Other Island Generation:	235	MW	Saturday, February 06, 2021	-1	2	1,240	1,138
ML/LIL Imports:	138	MW	Sunday, February 07, 2021	-1	-3	1,345	1,241
Current St. John's Temperature & Windchill:	-2 °C	-10 °C	Monday, February 08, 2021	-4	-4	1,435	1,330
7-Day Island Peak Demand Forecast:	1,435	MW	Tuesday, February 09, 2021	-2	-5	1,335	1,232

#### Supply Notes For February 03, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Tue, Feb 02, 2021	Actual Island Peak Demand <sup>8</sup>	08:40	1,371 MW
Wed, Feb 03, 2021	Forecast Island Peak Demand		1,375 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).