


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, February 09, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, February 08, 2021**

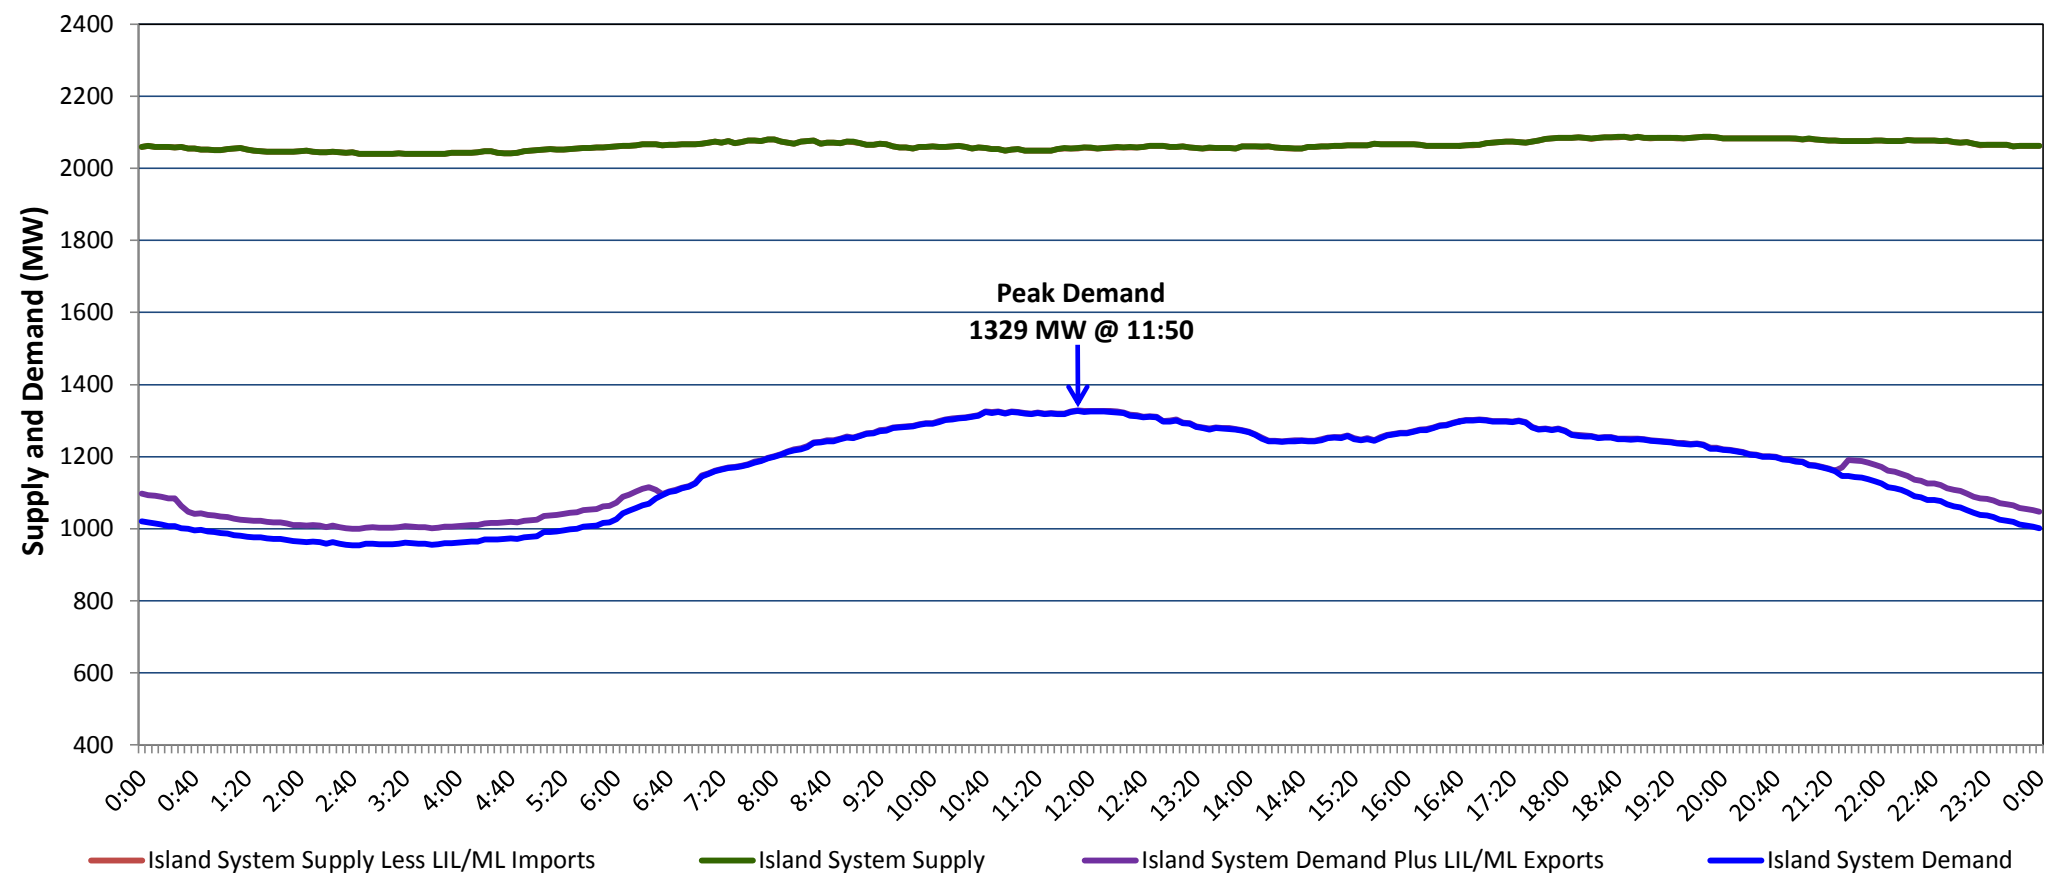

Supply Notes For February 08, 2021

1,2

A At 0834 hours, February 08, 2021, St. Anthony Diesel Plant available at 7.7 MW (9.7 MW).

B At 1723 hours, February 08, 2021, St. Anthony Diesel Plant available at full capacity (9.7 MW).

**Section 2
Island Interconnected Supply and Demand**

Tue, Feb 09, 2021	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,085	MW	Tuesday, February 09, 2021	0	-1	1,390	1,286
NLH Island Generation: ⁴	1,695	MW	Wednesday, February 10, 2021	-6	-6	1,435	1,330
NLH Island Power Purchases: ⁶	145	MW	Thursday, February 11, 2021	-8	-6	1,470	1,365
Other Island Generation:	245	MW	Friday, February 12, 2021	-1	-2	1,310	1,207
ML/LIL Imports:	-	MW	Saturday, February 13, 2021	-5	-4	1,295	1,192
Current St. John's Temperature & Windchill:	0 °C	N/A	Sunday, February 14, 2021	-5	-6	1,335	1,232
7-Day Island Peak Demand Forecast:	1,470	MW	Monday, February 15, 2021	-9	-3	1,440	1,335

Supply Notes For February 09, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Feb 08, 2021	Actual Island Peak Demand ⁸	11:50	1,329 MW
Tue, Feb 09, 2021	Forecast Island Peak Demand		1,390 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).