


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, February 24, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Tuesday, February 23, 2021**

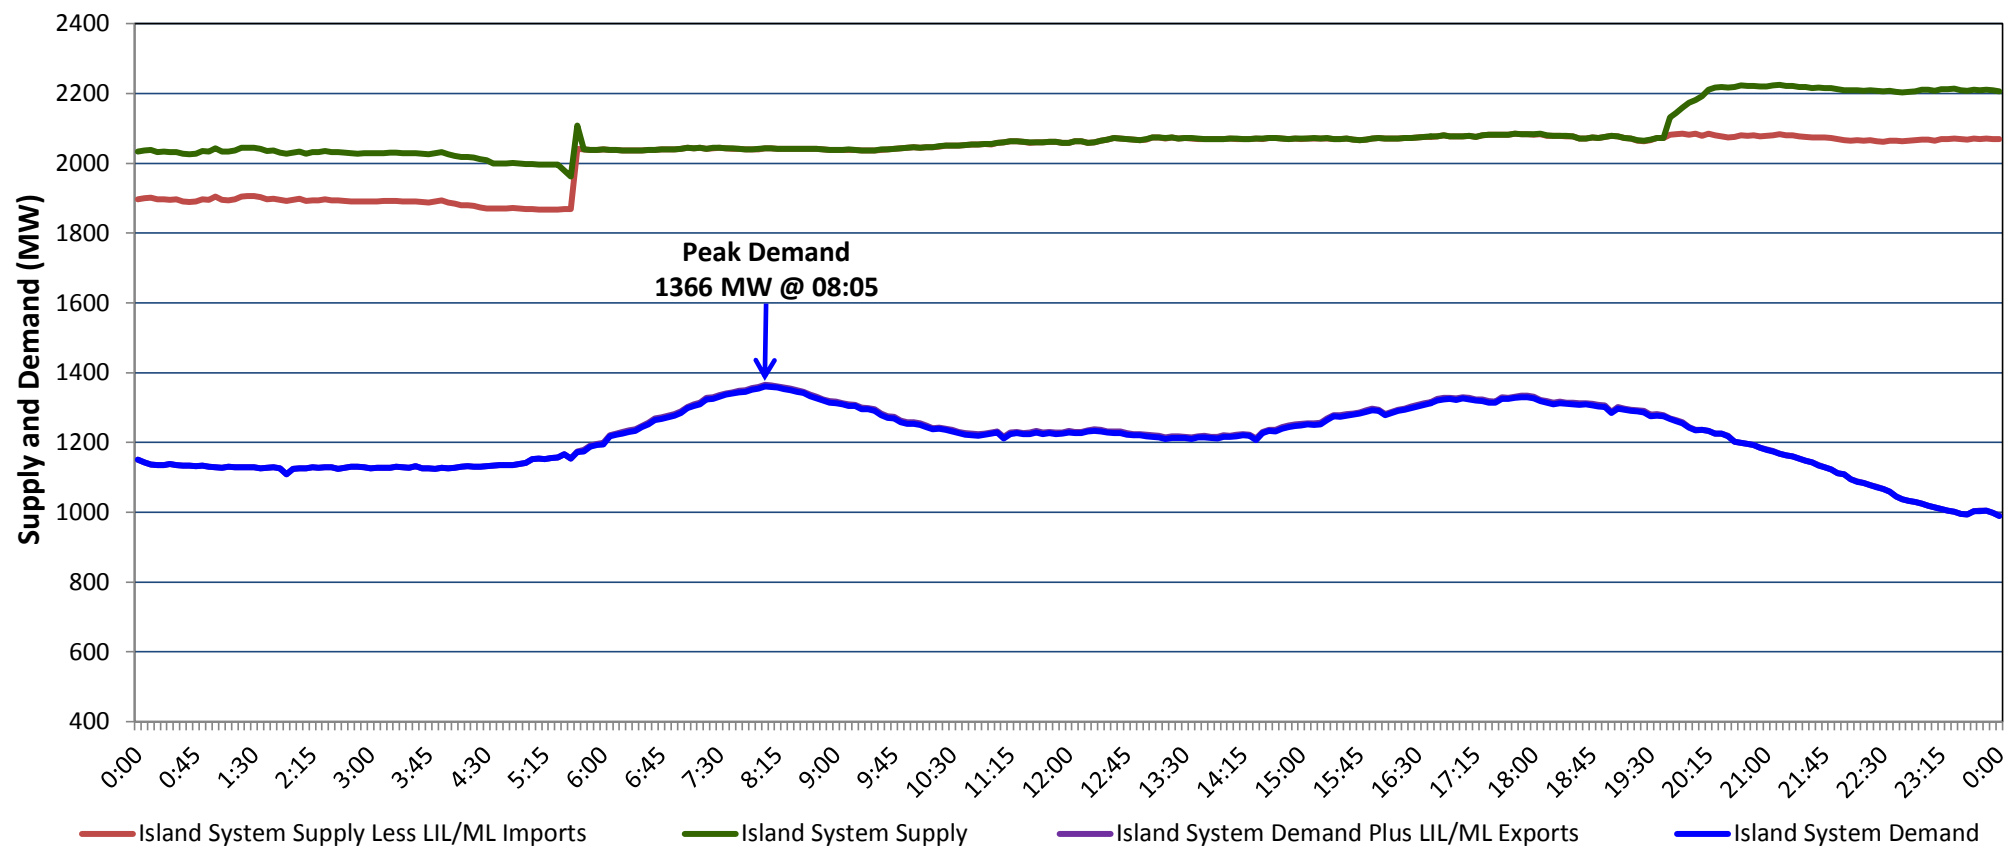

Supply Notes For February 23, 2021

1,2

- A At 0540 hours, February 23, 2021, Holyrood Unit 1 available (170 MW).
- B At 0922 hours, February 23, 2021, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- C At 1513 hours, February 23, 2021, St. Anthony Diesel Plant available at full capacity (9.7 MW).

**Section 2
Island Interconnected Supply and Demand**

Wed, Feb 24, 2021	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,050 MW	Wednesday, February 24, 2021	1	-1	1,280	1,177
NLH Island Generation: ⁴	1,695 MW	Thursday, February 25, 2021	-2	0	1,265	1,162
NLH Island Power Purchases: ⁶	135 MW	Friday, February 26, 2021	-1	-5	1,390	1,286
Other Island Generation:	220 MW	Saturday, February 27, 2021	-8	-6	1,355	1,251
ML/LIL Imports:	- MW	Sunday, February 28, 2021	-4	-2	1,320	1,217
Current St. John's Temperature & Windchill:	0 °C N/A °C	Monday, March 01, 2021	-2	-2	1,280	1,177
7-Day Island Peak Demand Forecast:	1,390 MW	Tuesday, March 02, 2021	-3	-1	1,295	1,192

Supply Notes For February 24, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Feb 23, 2021	Actual Island Peak Demand ⁸	08:05	1,366 MW
Wed, Feb 24, 2021	Forecast Island Peak Demand		1,280 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).