
### Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, April 06, 2021

## Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Monday, April 05, 2021

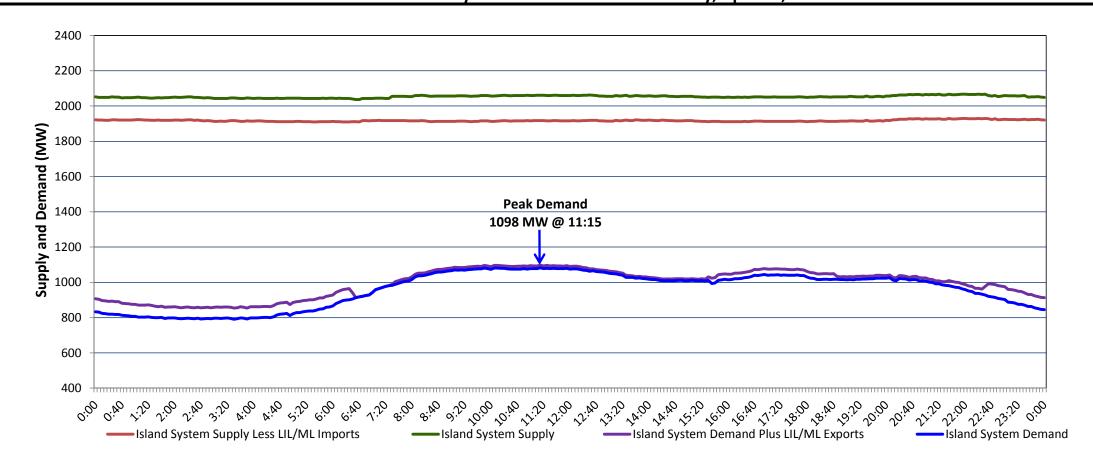

#### Supply Notes For April 05, 2021

1,2

As of 1401 hours, March 28, 2021, Paradise River Unit unavailable due to planned outage (8 MW).

As of 1030 hours, March 30, 2021, Holyrood Unit 3 available but not operating (150 MW).

#### Section 2

**Island Interconnected Supply and Demand** 

Tue, Apr 06, 2021	06, 2021 Island System Outlook <sup>3</sup>		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply:5	2,054	MW	Tuesday, April 06, 2021	4	3	1,100	1,007
NLH Island Generation: <sup>4</sup>	1,535	MW	Wednesday, April 07, 2021	4	3	1,065	973
NLH Island Power Purchases: <sup>6</sup>	140	MW	Thursday, April 08, 2021	4	3	1,055	963
Other Island Generation:	240	MW	Friday, April 09, 2021	4	3	1,050	958
ML/LIL Imports:	139	MW	Saturday, April 10, 2021	1	2	1,120	1,027
Current St. John's Temperature & Windchill:	3 °C N/A	°C	Sunday, April 11, 2021	1	2	1,105	1,012
7-Day Island Peak Demand Forecast:	1,190	MW	Monday, April 12, 2021	0	2	1,190	1,012

#### Supply Notes For April 06, 2021

Notes:

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
- 3. As of 0800 Hours.
- Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
- 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

# Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak Mon, Apr 05, 2021 Actual Island Peak Demand<sup>8</sup> Tue, Apr 06, 2021 Forecast Island Peak Demand 11:15 1,098 MW 1,100 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).