


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Friday, August 06, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, August 04, 2021**

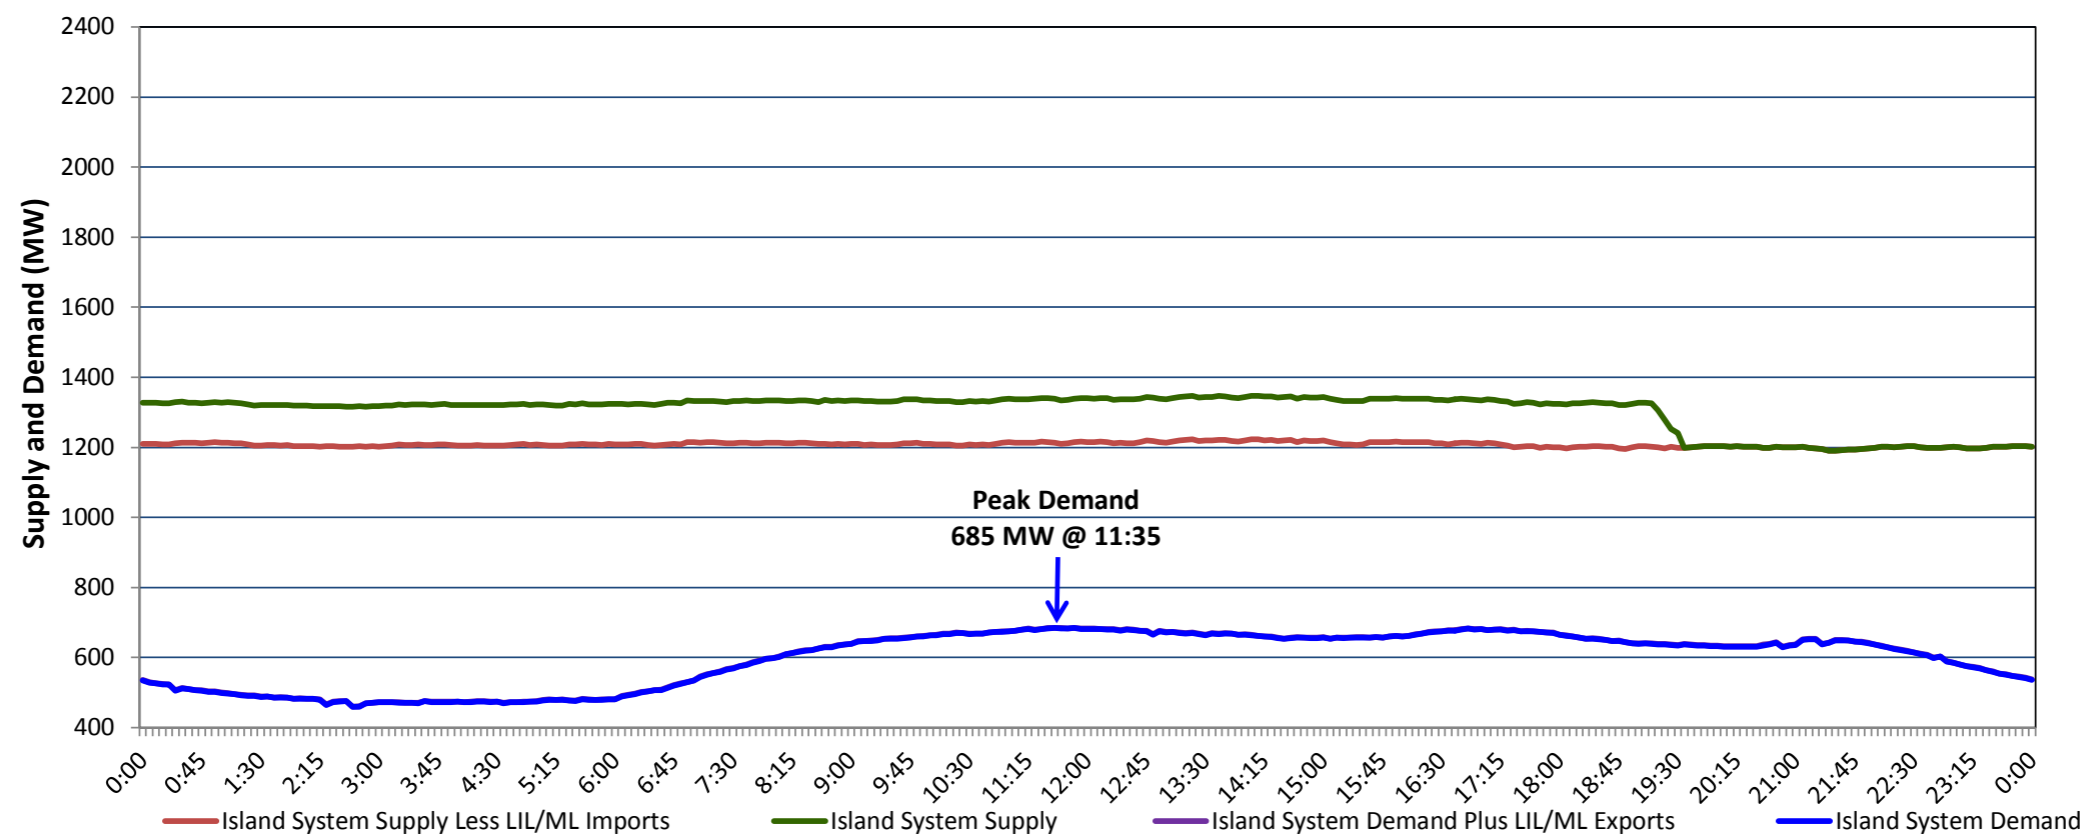

Supply Notes For August 04, 2021

- A As of 0805 hours, April 09, 2021, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- B As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- C As of 0720 hours, June 26, 2021, Holyrood Unit 2 available but not operating (170 MW).
- D As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- E As of 1051 hours, July 25, 2021, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- F As of 1052 hours, August 01, 2021, Upper Salmon Unit unavailable due to planned outage (84 MW).
- G As of 1141 hours, August 03, 2021, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, Aug 05, 2021	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,225	MW		Thursday, August 05, 2021	17	20	755	755
NLH Island Generation: ⁴	915	MW		Friday, August 06, 2021	20	21	760	760
NLH Island Power Purchases: ⁶	95	MW		Saturday, August 07, 2021	22	20	710	710
Other Island Generation:	215	MW		Sunday, August 08, 2021	19	13	710	710
ML/LIL Imports:	-	MW		Monday, August 09, 2021	12	12	770	770
Current St. John's Temperature & Windchill:	16 °C	N/A	°C	Tuesday, August 10, 2021	12	15	740	740
7-Day Island Peak Demand Forecast:	770	MW		Wednesday, August 11, 2021	18	20	755	755

Supply Notes For August 05, 2021

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Aug 04, 2021	Actual Island Peak Demand ⁸	11:35	685 MW
Thu, Aug 05, 2021	Forecast Island Peak Demand		755 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).