


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, August 16, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Saturday, August 14, 2021**

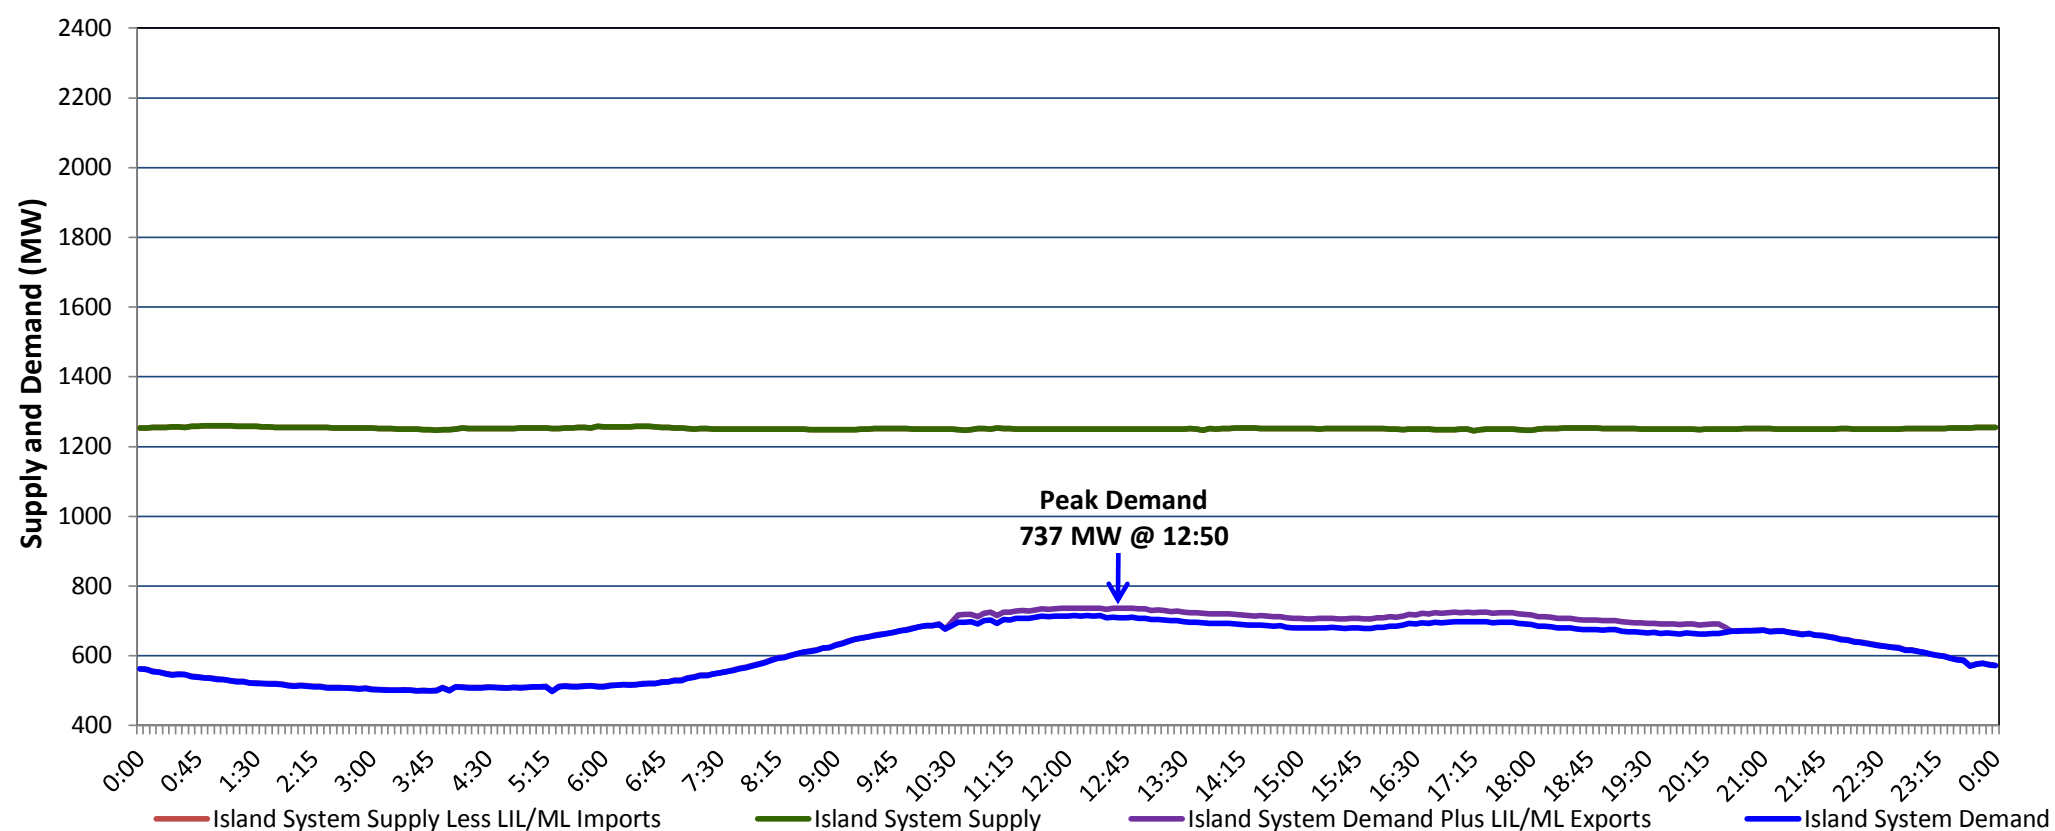

Supply Notes For August 14, 2021

1,2

- A As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- C As of 1051 hours, July 25, 2021, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- D As of 1052 hours, August 01, 2021, Upper Salmon Unit unavailable due to planned outage (84 MW).
- E As of 2302 hours, August 10, 2021, Holyrood Unit 3 available but not operating (150 MW).
- F As of 1500 hours, August 12, 2021, Holyrood Unit 2 unavailable due to planned outage (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Sun, Aug 15, 2021	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,285	MW		Sunday, August 15, 2021	20	22	725	725
NLH Island Generation: ^{4,8}	965	MW		Monday, August 16, 2021	20	15	740	740
NLH Island Power Purchases: ⁶	95	MW		Tuesday, August 17, 2021	17	20	740	740
Other Island Generation:	225	MW		Wednesday, August 18, 2021	19	22	760	760
ML/LIL Imports:	-	MW		Thursday, August 19, 2021	21	21	775	775
Current St. John's Temperature & Windchill:	20 °C	N/A	°C	Friday, August 20, 2021	19	19	745	745
7-Day Island Peak Demand Forecast:	775	MW		Saturday, August 21, 2021	13	12	715	715

Supply Notes For August 15, 2021

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sat, Aug 14, 2021	Actual Island Peak Demand ⁸	12:50	737 MW
Sun, Aug 15, 2021	Forecast Island Peak Demand		725 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).