
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Monday, November 15, 2021

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Friday, November 12, 2021

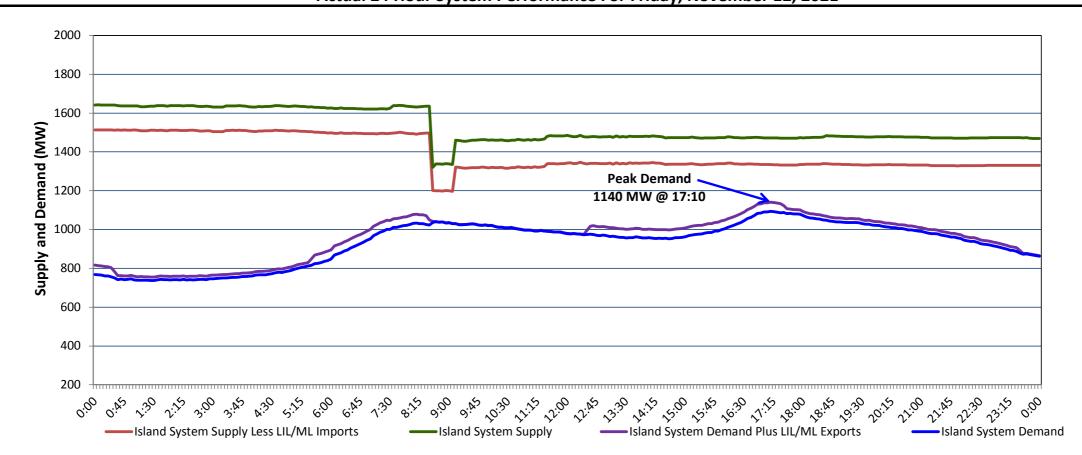

Supply Notes For November 12, 2021

1,2

- A As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- As of 1006 hours, September 11, 2021, Holyrood Unit 3 unavailable (150 MW).
- D As of 2048 hours, November 05, 2021, Upper Salmon Unit unavailable (84 MW).
 - At 0830 hours, November 12, 2021, Holyrood Gas Turbine unavailable (123.5 MW).
- At 0830 hours, November 12, 2021, Holyrood Unit 2 unavailable (170 MW).
- At 0909 hours, November 12, 2021, Holyrood Gas Turbine available (123.5 MW).

Section 2

Island Interconnected Supply and Demand

Sat, Nov 13, 2021	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵		1,482	MW	Saturday, November 13, 2021	-2	8	1,225	1,131
NLH Island Generation: ^{4,8}		1,040	MW	Sunday, November 14, 2021	13	9	1,040	948
NLH Island Power Purchases: ⁶		100	MW	Monday, November 15, 2021	6	5	1,140	1,047
Other Island Generation:		200	MW	Tuesday, November 16, 2021	9	5	1,125	1,032
ML/LIL Imports:		142	MW	Wednesday, November 17, 2021	3	3	1,195	1,101
Current St. John's Temperature & Windchill:	-1 °C	-3	°C	Thursday, November 18, 2021	1	6	1,180	1,086
7-Day Island Peak Demand Forecast:		1,225	MW	Friday, November 19, 2021	4	7	1,120	1,027

Supply Notes For November 13, 2021

Notes

Sat, Nov 13, 2021

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
- 2018, UFLS events3. As of 0800 Hours.
- Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).

Forecast Island Peak Demand

- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
- 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
- 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak Fri, Nov 12, 2021 Actual Island Peak Demand⁸ 17:10 1,140 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).

1,225 MW