
Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, July 19, 2022

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Monday, July 18, 2022

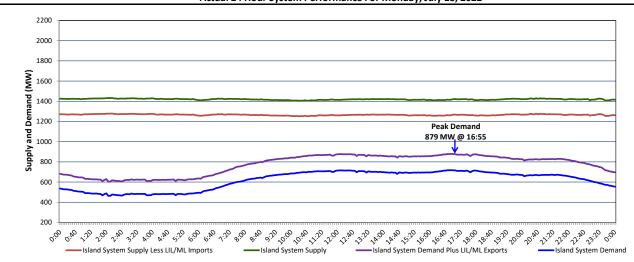

Supply Notes For July 18, 2022

1,2

- As of 0857 hours, April 04, 2022, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- As of 1327 hours, May 08, 2022, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- C As of 2351 hours, May 28, 2022, Holyrood Unit 2 available but not operating 150 MW (170 MW).
- As of 0800 hours, June 08, 2022, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- As of 1422 hours, June 19, 2022, Granite Canal Unit unavailable due to planned outage (40 MW).
- As of 0210 hours, July 03, 2022, Bay d'Espoir Unit 5 unavailable (76.5 MW).
- As of 0930 hours, July 12, 2022, Upper Salmon Unit unavailable due to planned outage (84 MW)

Section 2

Island Interconnected Supply and Demand

| Tue, Jul 19, 2022 | Island System Outlook ³ | | 1 | Seven-Day Forecast | | Temperature (°C) | | Island System Daily Peak Demand (MW) | |
|--|------------------------------------|-------|----|--------------------------|---------|---------------------|----------|---|--|
| | | | | | Morning | Evening | Forecast | Adjusted ⁷ | |
| Available Island System Supply: ⁵ | | 1,424 | MW | Tuesday, July 19, 2022 | 18 | 20 | 885 | 885 | |
| NLH Island Generation: ^{4,8} | | 925 | MW | Wednesday, July 20, 2022 | 19 | 17 | 735 | 735 | |
| NLH Island Power Purchases: ⁶ | | 125 | MW | Thursday, July 21, 2022 | 16 | 18 | 745 | 745 | |
| Other Island Generation: | | 220 | MW | Friday, July 22, 2022 | 19 | 19 | 735 | 735 | |
| ML/LIL Imports: | | 154 | MW | Saturday, July 23, 2022 | 16 | 17 | 710 | 710 | |
| Current St. John's Temperature & Windchill: | 17 °C | N/A | °C | Sunday, July 24, 2022 | 18 | 21 | 705 | 705 | |
| 7-Day Island Peak Demand Forecast: | | 885 | MW | Monday, July 25, 2022 | 21 | 18 | 740 | 740 | |

Supply Notes For July 19, 2022

Notes:

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
- 3. As of 0800 Hours.
- 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
- Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
- 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

| Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak | | | | | | | |
|---|--|-------|--------|--|--|--|--|
| Mon, Jul 18, 2022 | Actual Island Peak Demand ⁹ | 16:55 | 879 MW | | | | |
| Tue, Jul 19, 2022 | Forecast Island Peak Demand | | 885 MW | | | | |
| | | | | | | | |

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).