
## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Tuesday, January 24, 2023

## Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Monday, January 23, 2023

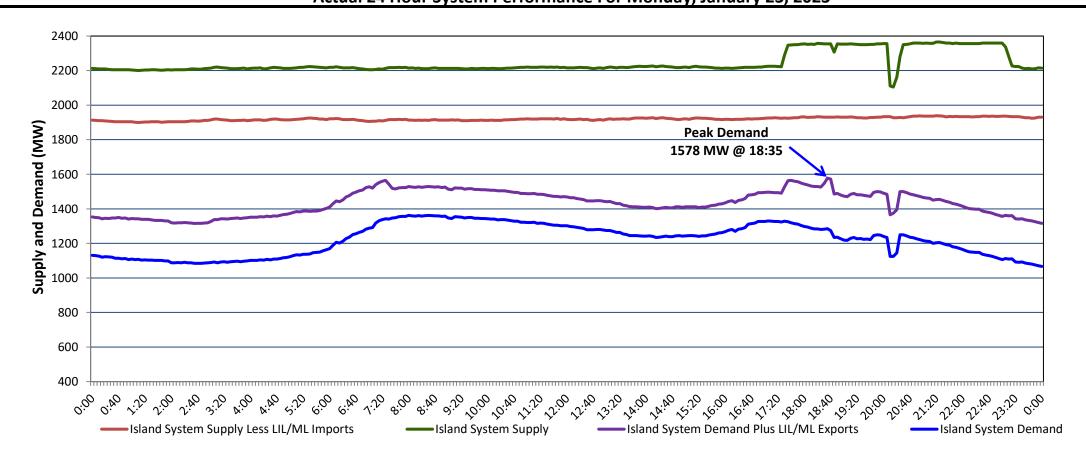

Supply Notes For January 23, 2023

1,2

As of 0631 hours, January 19, 2023, Holyrood Unit 3 available but not operating (150 MW).

At 1413 hours, January 23, 2023, Hawkes Bay Diesel Plant unavailable due to planned outage (5 MW).

At 1658 hours, January 23, 2023, Hawkes Bay Diesel Plant available (5 MW).

## Section 2

**Island Interconnected Supply and Demand** 

Tue, Jan 24, 2023	Island System Outlook <sup>3</sup>			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	<b>Adjusted</b> <sup>7</sup>
Available Island System Supply: <sup>5</sup>		2,216	MW	Tuesday, January 24, 2023	5	0	1,620	1,521
NLH Island Generation: <sup>4,8</sup>		1,545	MW	Wednesday, January 25, 2023	-1	-3	1,390	1,294
NLH Island Power Purchases: <sup>6</sup>		145	MW	Thursday, January 26, 2023	-8	1	1,485	1,388
Other Island Generation:		225	MW	Friday, January 27, 2023	7	0	1,290	1,195
ML/LIL Imports:		301	MW	Saturday, January 28, 2023	-4	-5	1,345	1,249
Current St. John's Temperature & Windchill:	5 °C	N/A	°C	Sunday, January 29, 2023	-6	-2	1,360	1,264
7-Day Island Peak Demand Forecast:		1,620	MW	Monday, January 30, 2023	-5	-1	1.465	1.368

## Supply Notes For January 24, 2023

Notes:

- 1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
- 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
- 3. As of 0800 Hours.
- Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
- 5. Gross output from all Island sources (including Note 4).
- 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
- 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
- 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak							
Mon, Jan 23, 2023	Actual Island Peak Demand <sup>9</sup>	18:35	1,578 MW				
Tue, Jan 24, 2023	Forecast Island Peak Demand		1,620 MW				

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).