


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, May 30, 2025

Section 1 Island Interconnected System - Supply, Demand & Exports Actual 24 Hour System Performance For Thursday, May 29, 2025

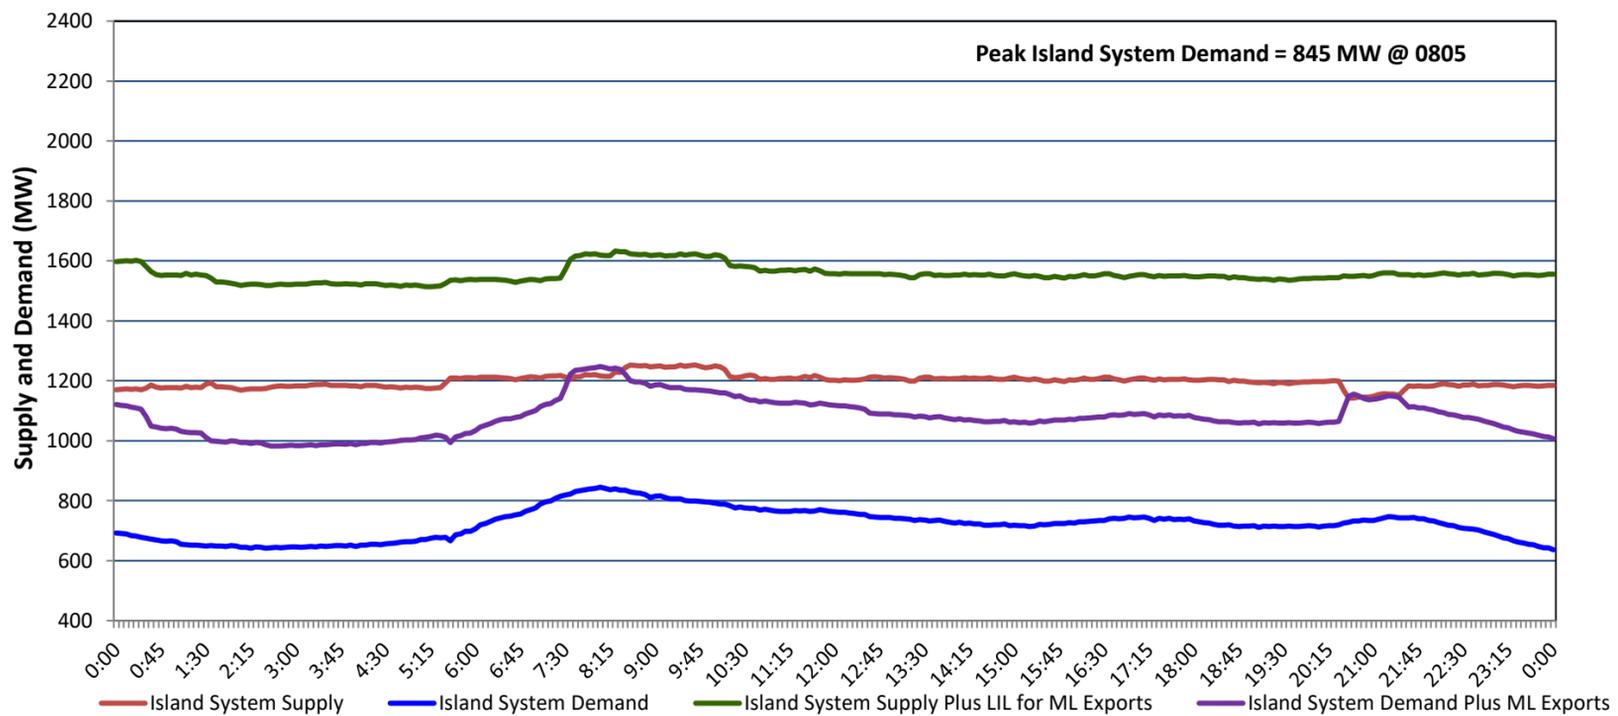

Island Supply Notes For May 29, 2025

- A As of 0816 hours, March 26, 2025, St. Anthony Diesel Plant available at 8.85 MW due to forced derating (9.7 MW).
- B As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).
- C As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
- D As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
- E As of 1543 hours, May 03, 2025, Holyrood Unit 2 available but not operating 115 MW (170 MW).
- F As of 0800 hours, May 04, 2025, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- G As of 0851 hours, May 05, 2025, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
- H As of 1538 hours, May 16, 2025, Holyrood Diesels available at 8 MW due to forced derating (10 MW).
- I As of 0852 hours, May 27, 2025, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
- J Ad of 0852 hours, May 27, 2025, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).

Section 2 Island Interconnected System - Supply, Demand & Outlook

Fri, May 30, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴	1,256 MW	Friday, May 30, 2025	825	775
NLH Island Generation: ^{3,7}	845 MW	Saturday, May 31, 2025	780	730
NLH Island Power Purchases: ⁵	120 MW	Sunday, June 1, 2025	775	725
NP and CBPP Owned Generation:	195 MW	Monday, June 2, 2025	810	760
LIL/ML Net Imports to Island: ⁹	96 MW	Tuesday, June 3, 2025	800	750
		Wednesday, June 4, 2025	805	755
7-Day Island Peak Demand Forecast:	825 MW	Thursday, June 5, 2025	810	760

Island Supply Notes For May 30, 2025

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. As of 0800 Hours.
 3. Gross continuous unit output.
 4. Gross output from all Island sources (including Note 3).
 5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 6. Adjusted for interruptible load and the impact of voltage reduction when applicable.
 7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.
 8. Does not include ML Exports.
 9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3 Island Peak Demand and Exports Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, May 29, 2025	Island Peak Demand ¹⁰	8:05	845 MW
	Exports at Peak		403 MW
	LIL Net Imports to Island		1,182 MWh
Fri, May 30, 2025	Forecast Island Peak Demand		825 MW

- Notes: 10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).