


Newfoundland Labrador Hydro (NLH)

Supply and Demand Status Report Filed Tuesday, September 08, 2026

Section 1

Island Interconnected System - Supply, Demand & Exports

Actual 24 Hour System Performance For Friday, September 04, 2026

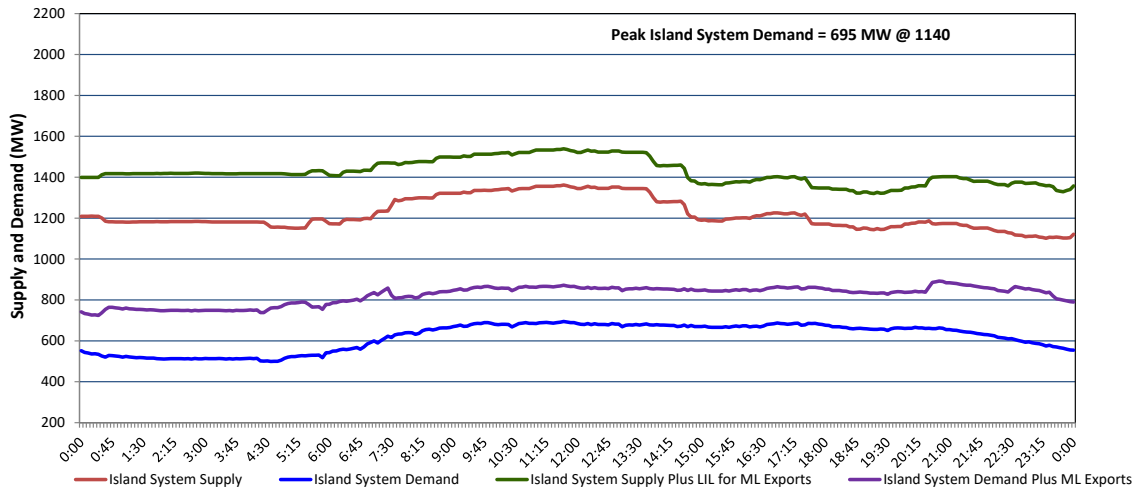

Island Supply Notes For September 04, 2026

- A As of 0800 hours, March 29, 2026, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- B As of 1513 hours, April 16, 2026, St. Anthony Diesel Plant available at 7.7 MW due to forced derating (9.7 MW).
- C As of 0800 hours, May 06, 2026, Holyrood Unit 2 unavailable due to planned outage 40 MW (170 MW).
- D As of 0701 hours, May 24, 2026, Holyrood Unit 1 unavailable due to planned outage 166 MW (170 MW).
- E As of 0841 hours, May 24, 2026, Hinds Lake Unit unavailable due to planned outage (75 MW).
- F As of 0834 hours, June 15, 2026, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
- G As of 0834 hours, June 15, 2026, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
- H As of 1003 hours, August 09, 2026, Cat Arm Unit 1 unavailable due to planned outage (67 MW).
- I As of 1159 hours, August 20, 2026, Cat Arm Unit 2 unavailable due to planned outage 57 MW (67 MW).

Section 2

Island Interconnected System - Supply, Demand & Outlook

Sat, Sep 05, 2026		Island System Outlook ²		Seven-Day Forecast		Island System Daily Peak Demand (MW)	
						Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴		1,188 MW		Saturday, September 5, 2026		740	690
NLH Island Generation: ^{3,7,10}		840 MW		Sunday, September 6, 2026		730	680
NLH Island Power Purchases: ⁵		125 MW		Monday, September 7, 2026		745	695
NP and CBPP Owned Generation:		195 MW		Tuesday, September 8, 2026		750	700
LIL Net Imports to Island: ⁹		28 MW		Wednesday, September 9, 2026		775	725
				Thursday, September 10, 2026		770	720
7-Day Island Peak Demand Forecast:		775 MW		Friday, September 11, 2026		745	695

Island Supply Notes For September 05, 2026

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. As of 0800 Hours.
 3. Gross continuous unit output.
 4. Gross output from all Island sources (including Note 3).
 5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 6. Adjusted for interruptible load and the impact of voltage reduction when applicable.
 7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.
 8. Does not include ML Exports.
 9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.
 10. Run-of-river hydro resources are subject to hydrological variability. Reported firm capacity reflects the capacity expected to be available during peak demand periods.

Section 3

Island Peak Demand and Exports Information

Previous Day Actual Peak and Current Day Forecast Peak

Fri, Sep 04, 2026	Island Peak Demand ¹¹	11:40	695 MW
	Exports at Peak		177 MW
	LIL Net Imports to Island		3,039 MWh
Sat, Sep 05, 2026	Forecast Island Peak Demand		740 MW

- Notes:
11. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).