Whenever. Wherever.
We'll be there.

NEWFOUNDLAND POWER
A FORTIS COMPANY

November 6, 2026

Board of Commissioners
of Public Utilities
P.O. Box 21040
120 Torbay Road
St. John's, NL A1A 5B2

Attention: Mike McNiven
Board Secretary

Dear Mr. McNiven:

Re: Application for Approval of a Contribution in Aid of Construction ("CIAC") for Three-Phase Service for the Town of George's Brook-Milton (1st Revision)

Please find enclosed the revised application of Newfoundland Power Inc. (the "Company") for approval of the above-noted CIAC for a line upgrade to provide three-phase service to the Town of George's Brook-Milton. To provide the requested service, it is necessary to upgrade 2.7 kilometres of existing single-phase to three-phase (the "Upgrade").

The application has been revised to remove the Basic Investment previously included in the calculation of the CIAC. The proposed work consists solely of an upgrade of existing distribution facilities and does not include a line extension to which the Basic Company Investment applies under the Company's *CIAC Policy: Distribution Line Extensions and Upgrades to General Service Customers* (the "Policy").

The construction cost of the proposed line upgrade based on the detailed engineering estimate is $594,244 (excluding HST).[1] The revised CIAC is $583,257 (excluding HST), as detailed in Schedule B (1st Revision).

Changes to the application and Schedule B are indicated by shading in grey. Should you have any questions please contact the undersigned.

Yours truly,

Dominic Foley

Dominic Foley
Legal Counsel

[1] Section 5(e) of the Policy requires the completion of a detailed engineering cost estimate wherever the total estimated cost of the line upgrade, using the applicable cost per metre factors, exceeds $100,000. Section 10(ii) further requires that all extensions or upgrades involving CIACs calculated in accordance with section 5(e) of the Policy be submitted to the Board for approval.

Newfoundland Power Inc.
55 Kenmount Road • P.O. Box 8910 • St. John's, NL A1B 3P6
PHONE (709) 737-5500 ext. 6200 • FAX (709) 737-2974 • **dfoley@newfoundlandpower.com**

Enclosures

ec. Shirley A. Walsh
Newfoundland and Labrador Hydro

Adrienne Ding
O'Dea Earle Law Offices

Newfoundland Power Inc.
55 Kenmount Road • P.O. Box 8910 • St. John's, NL A1B 3P6
PHONE (709) 737-5500 x6200 • FAX (709) 737-2974 • **dfoley@newfoundlandpower.com**

IN THE MATTER OF the *Public Utilities Act*, (the "Act"); and

IN THE MATTER OF an Application by Newfoundland Power Inc. for approval of a contribution in aid of construction for a three-phase service for the Town of George's Brook-Milton (the "Customer") pursuant to section 41(5) of the Act.

TO: The Board of Commissioners of Public Utilities (the "Board")

THE APPLICATION OF Newfoundland Power Inc. (the "Applicant") **SAYS THAT:**

1. The Applicant is a corporation duly organized and existing under the laws of the Province of Newfoundland and Labrador, is a public utility within the meaning of the Act, and is subject to the provisions of the *Electrical Power Control Act, 1994*.

2. The Customer is the incorporated Town of George's Brook – Milton whose mandate is to facilitate economic development in the region.

3. The Customer has requested that the Applicant provide the Town of George's Brook-Milton with three-phase electrical service. In order to provide the requested service, it is necessary to upgrade 2.7 kilometres of single-phase to three-phase (the "Upgrade"). Schedule A to this Application contains a drawing of the Upgrade.

4. A contribution in aid of construction ("CIAC") for the Upgrade has been calculated in accordance with section 5(e) of the CIAC Policy: Distribution Line Extensions and Upgrades to General Service Customers, approved by Order No. P.U. 27 (2005), dated November 2, 2005 (the "Policy"). Based on a detailed engineering estimate as required by section 5(e) of the Policy, the estimated construction cost of the Upgrade is $594,244. Schedule B (1st Revision) to this Application contains a detailed calculation of the construction cost.

5. Section 10(ii) of the Policy states that the Company shall apply to the Board for approval of all line extensions or upgrades involving CIACs where the cost of the line extension or upgrade is calculated pursuant to section 5(e) of the Policy.

6. A CIAC is required for the Upgrade as stipulated in section 1 of the Policy. The CIAC calculated in accordance with the Policy is $583,257 excluding HST. The CIAC has been calculated without a Basic Investment, as the proposed work consists solely of an Upgrade and does not include a Line extension to which the Basic Investment provided for in section 3 of the Policy applies. Schedule B (1st Revision) to this Application provides a detailed calculation of the CIAC. The CIAC as calculated in Schedule B (1st Revision) was quoted to the Customer by way of letter dated November 3, 2026. The Customer provided written confirmation of its acceptance of the CIAC on November 4, 2026.

7. This Application seeks approval of the CIAC as calculated in accordance with the Policy.

8. Communications with respect to this Application should be forwarded to the attention of Dominic Foley, Counsel to the Applicant.

9. **THE APPLICANT REQUESTS** that the Board approve, pursuant to section 41(5) of the Act, the CIAC as calculated in Schedule B (1st Revision) to this Application.

DATED at St. John's, Newfoundland and Labrador, this 6th day of November, 2026.

NEWFOUNDLAND POWER INC.

Dominic Foley
Newfoundland Power Inc.
P.O. Box 8910
55 Kenmount Road
St. John's, NL A1B 3P6

Telephone: (709) 737-5500 ext. 6200
Facsimile: (709) 737-2974

IN THE MATTER OF the *Public Utilities Act*, (the "Act"); and

IN THE MATTER OF an Application by Newfoundland Power Inc. for approval of a contribution in aid of construction for a three-phase service for the Town of George's Brook-Milton (the "Customer") pursuant to section 41(5) of the Act.

AFFIDAVIT


I, Dawn E. Furey, of the City of St. John's in the Province of Newfoundland and Labrador, make oath and say as follows:

1. THAT I am employed with Newfoundland Power Inc. as Team Lead, CIAC and Risk Management;
2. THAT I have read and understand the foregoing Application; and
3. THAT, to the best of my knowledge, information and belief, all matters, facts and things set out in the Application are true.

SWORN TO before me at the
City of St. John's, in the Province of
Newfoundland and Labrador
this 6th day of November, 2026:

Barrister


Dawn E. Furey

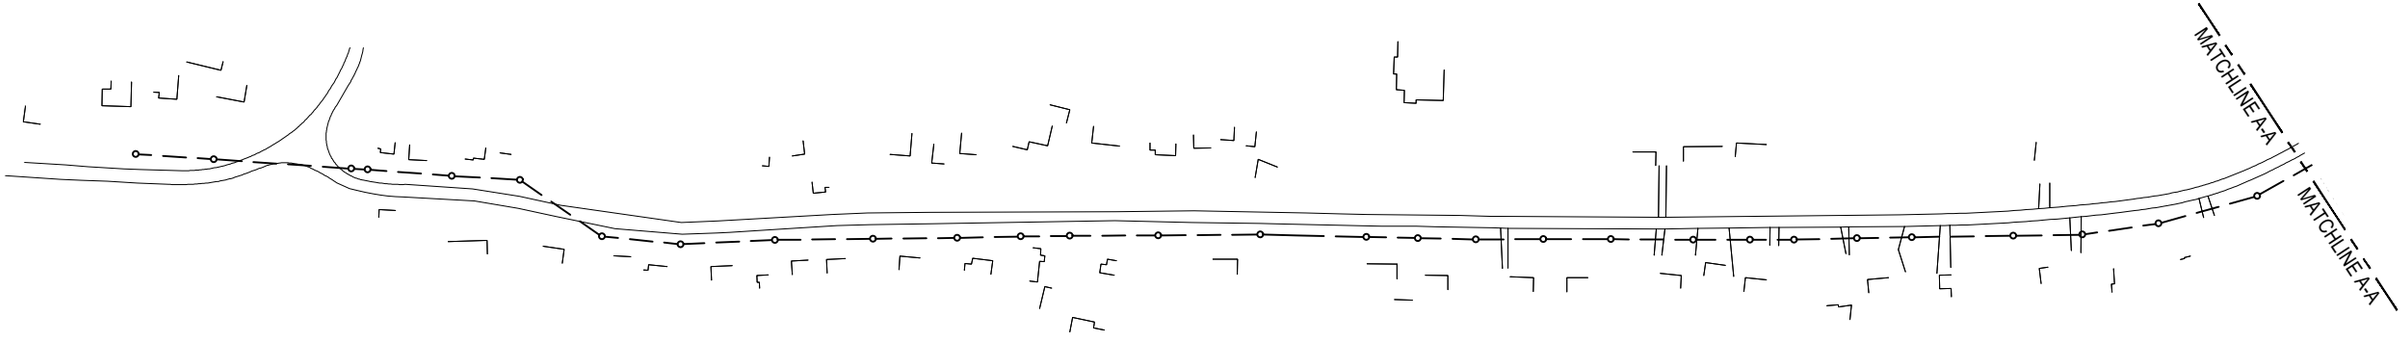

TOTAL SPAN = 2700m

NEWFOUNDLAND POWER
A FORTIS COMPANY

Title:	TOWN OF GEORGE'S BROOK-MILTON		
	THREE PHASE UPGRADE		
Scale: N.T.S.		Drawn: D. GEORGE	DWG No. 460547
Date: 2026/08/13		App: .	SHEET 1 OF 2

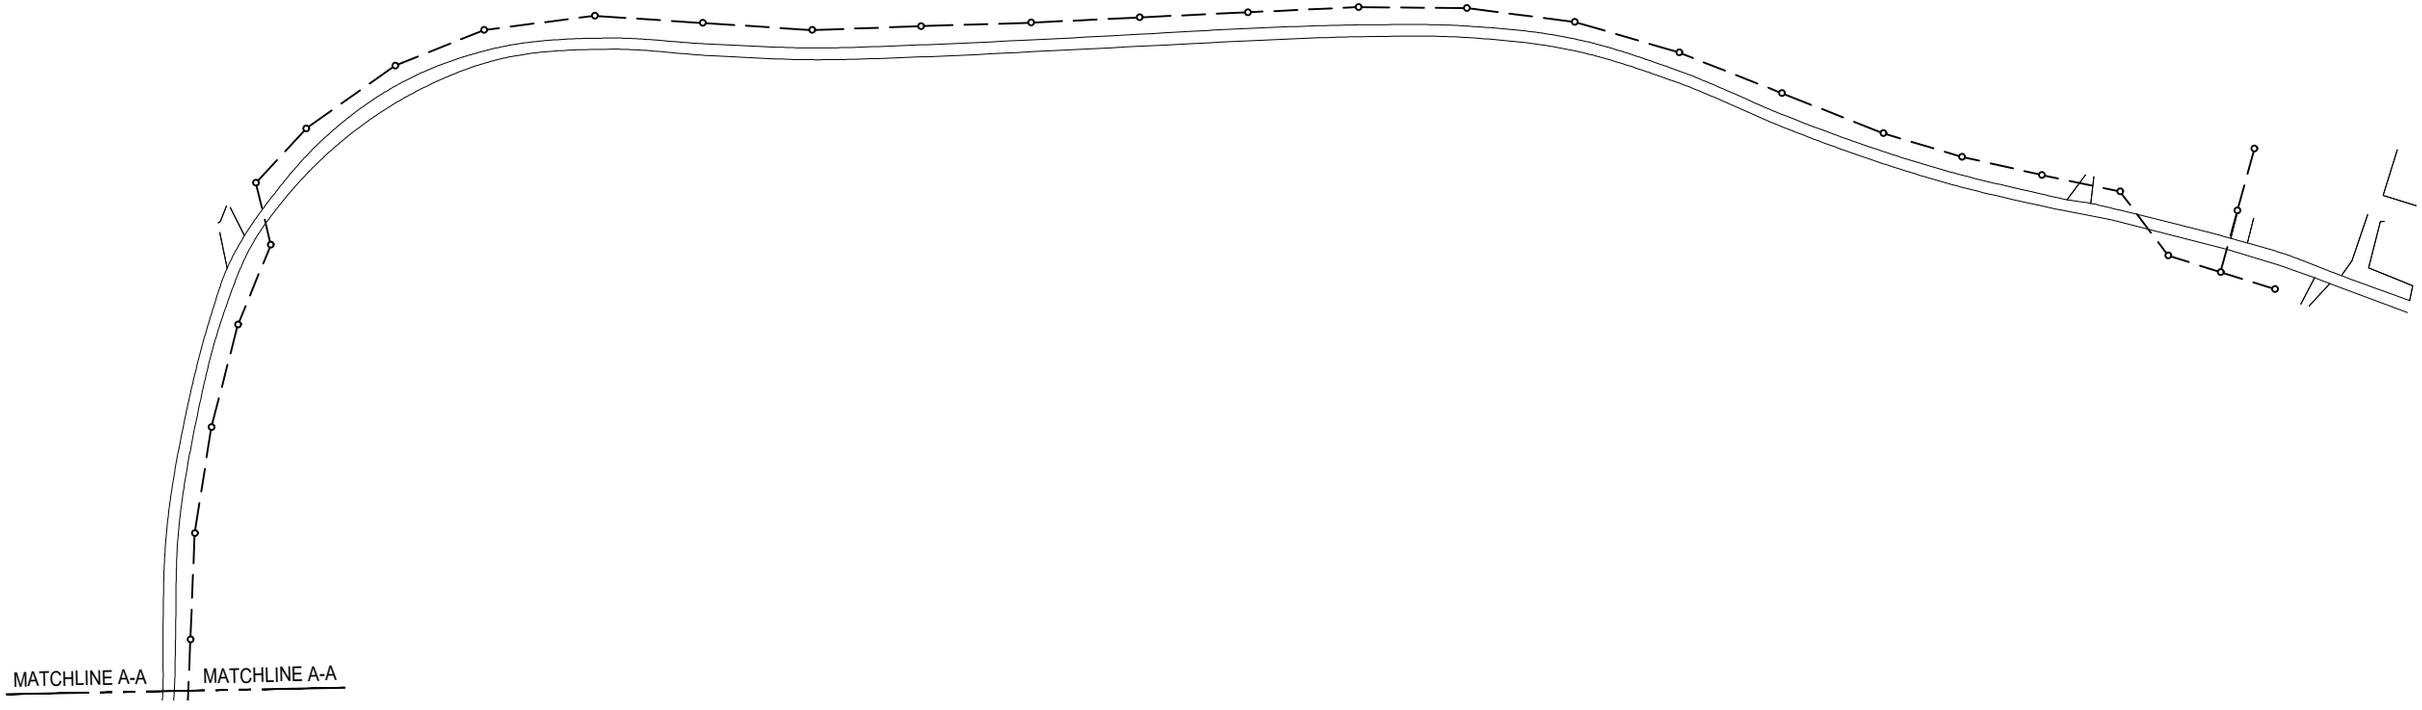

TOTAL SPAN = 2700m

NEWFOUNDLAND POWER
A FORTIS COMPANY

Title:	TOWN OF GEORGE'S BROOK-MILTON		
	THREE PHASE UPGRADE		
Scale: N.T.S.		Drawn: D. GEORGE	DWG No. 460547
Date: 2026/08/13		App: .	SHEET 2 OF 2

CONTRIBUTION IN AID OF CONSTRUCTION
GENERAL SERVICE

CUSTOMER: Town of George's Brook-Milton
LOCATION: Along Route 232

BASIS OF ESTIMATE Upgrade 2.7 kilometres from Single-phase to Three-phase

Material & Other Costs	
Material Costs (excluding poles)	$ 145,568
Stores O/H	$ 21,835
	$ 167,403
Poles	$ 27,867
Brush Clearing	$ 36,736
Survey/Easements	$ 15,246
Flagging Services	$ 48,029
Total Material & Other Costs	$ 295,281
Labour Costs	
Labour (NF Power)	$ 181,341
Contract Labour	$ 59,893
Total Labour Costs	$ 241,234
Total Material, Labour & Other Costs	$ 536,515
GEC (4%)	$ 21,461
Total Construction Costs	$ 557,976
Operating & Maintenance (6.5%)	$ 36,268
Total Costs	$ 594,244
Less: 3-Phase Minimum Company Investment	$ - [1]
Less: Remaining Life Credit	$ (10,987) [2]
Total CIAC	$ 583,257

[1] No Basic Company Investment applicable.
[2] Based on average life of 18 poles replaced.