

DD-NLH-092  
**Island Interconnected System Supply Issues and Power Outages**

---

**Page 1 of 1**

1    Q.    Please provide the final path of the cables across the SOBI showing water depths for  
2            every 10 metres.

3

4

5    A.    The corridor for the Strait of Belle Isle cables is shown on DD-NLH-092 Attachment  
6            1. The bathymetry contour interval on the chart is ten metres.

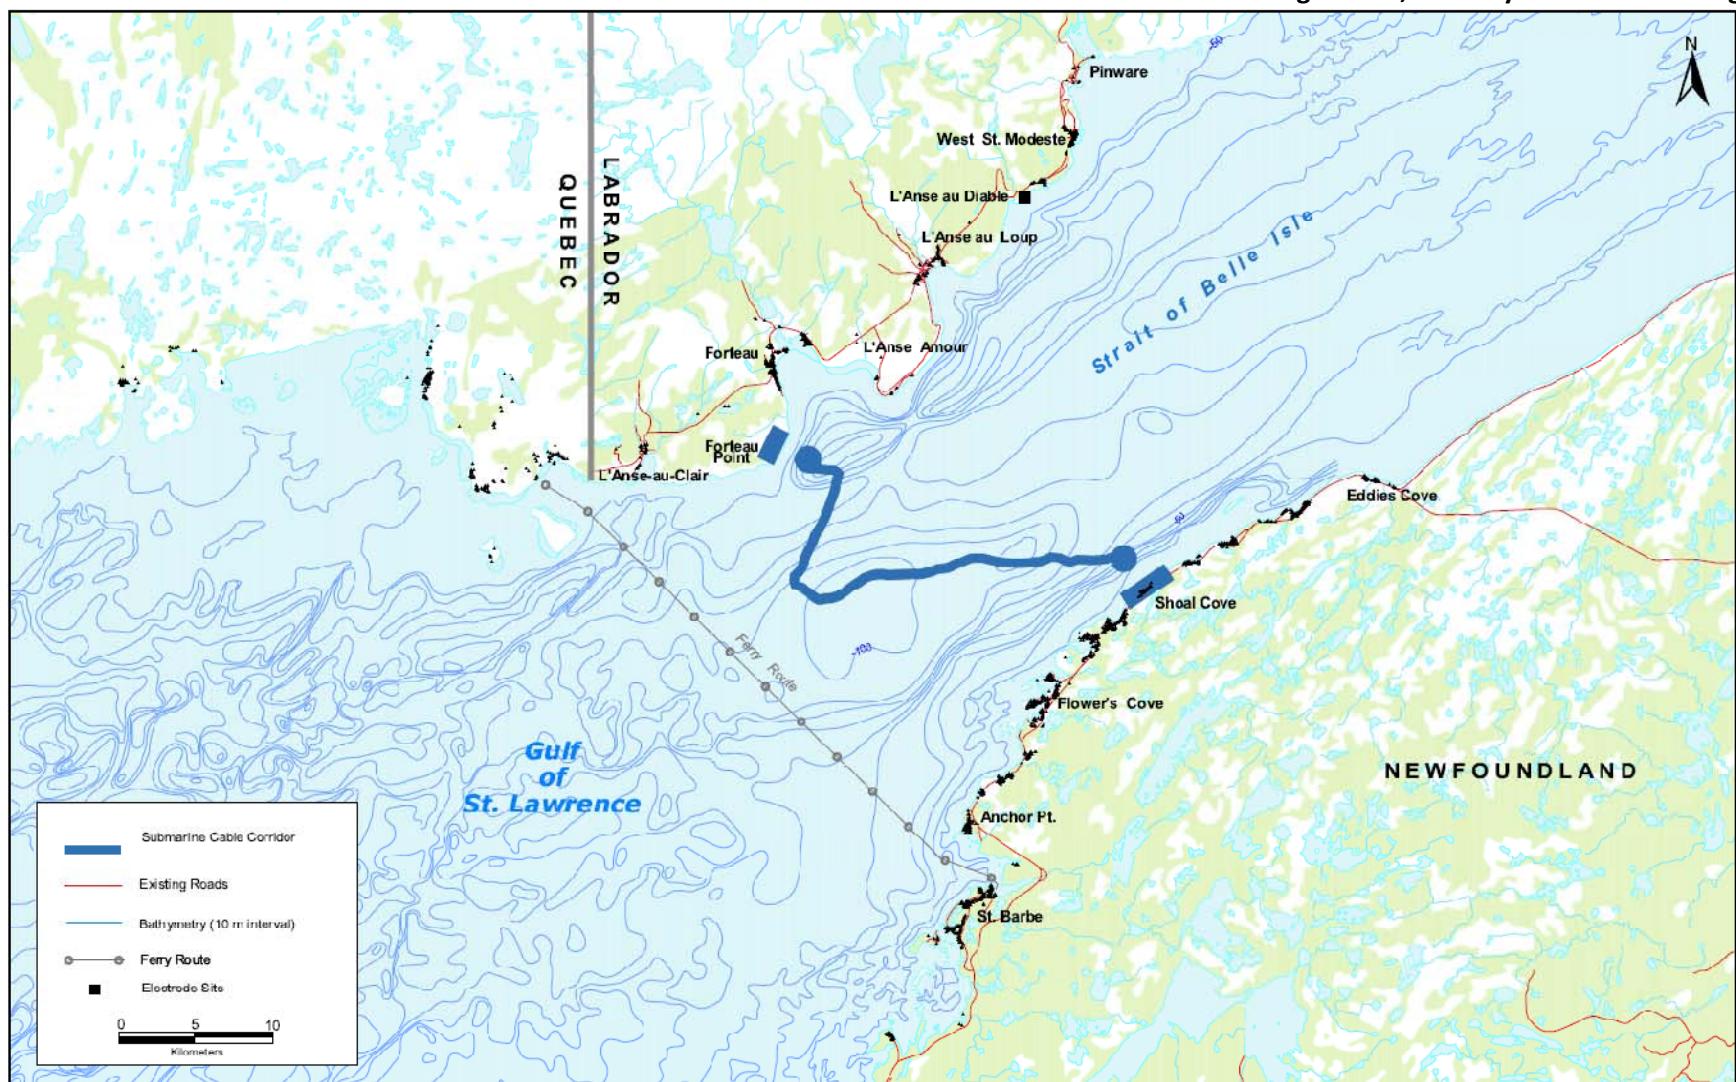


Figure 1.1-1: Study Area and Strait of Belle Isle Submarine Cable Crossing Corridor.