



Newfoundland and Labrador Hydro
Hydro Place, 500 Columbus Drive
P.O. Box 12400, St. John's, NL
Canada A1B 4K7
t. 709.737.1400 | f. 709.737.1800
nlhydro.com

October 14, 2025

Board of Commissioners of Public Utilities
Prince Charles Building
120 Torbay Road, P.O. Box 21040
St. John's, NL A1A 5B2

Attention: Jo-Anne Galarneau
Executive Director and Board Secretary

Re: Reliability and Resource Adequacy Study Review – 2025–2026 Winter Readiness Planning Report –Report

Further to correspondence received from the Board of Commissioners of Public Utilities ("Board") on October 13, 2016 directing Newfoundland and Labrador Hydro ("Hydro") to provide an annual report detailing its winter readiness planning, and correspondence received on March 5, 2020 requesting additional detail, please find enclosed Hydro's 2025–2026 Winter Readiness Planning Report.

Should you have any questions, please contact the undersigned.

Yours truly,

NEWFOUNDLAND AND LABRADOR HYDRO

Shirley A. Walsh
Senior Legal Counsel, Regulatory
SAW/rr

Encl.

ecc:

Board of Commissioners of Public Utilities
Jacqui H. Glynn
Ryan Oake
Board General

Island Industrial Customer Group
Paul L. Coxworthy, Stewart McKelvey
Denis J. Fleming, Cox & Palmer
Glen G. Seaborn, Poole Althouse

Labrador Interconnected Group
Senwung F. Luk, Olthuis Kleer Townshend LLP
Nicholas E. Kennedy, Olthuis Kleer Townshend LLP

Consumer Advocate
Dennis M. Browne, KC, Browne Fitzgerald Morgan & Avis
Stephen F. Fitzgerald, KC, Browne Fitzgerald Morgan & Avis
Sarah G. Fitzgerald, Browne Fitzgerald Morgan & Avis
Bernice Bailey, Browne Fitzgerald Morgan & Avis

Newfoundland Power Inc.
Dominic J. Foley
Douglas W. Wright
Regulatory Email

2025–2026 Winter Readiness Planning Report

October 14, 2025

A report to the Board of Commissioners of Public Utilities



Executive Summary

Newfoundland and Labrador Hydro (“Hydro”) closely monitors its supply-related assets and is confident in its ability to service customers during the 2025–2026 winter season. Each year, Hydro completes extensive winter readiness (“WR”) activities across its network of assets. This requires detailed scheduling and coordination from across all teams and sites to ensure safe completion of all tasks. These activities are progressing towards completion, and Hydro is confident in its ability to provide reliable service to its customers, as well as those of Newfoundland Power Inc., throughout the upcoming winter season.

The results of Hydro's annual work plan (“AWP”) and WR activities for both the Island Interconnected System and the Labrador Interconnected System year-to-date indicate that Hydro is on track to meet its target for all regulated generating assets, with the exception of Unit 3 at the Holyrood Thermal Generating Station (“Holyrood TGS”). Due to a period of low inflows in its reservoirs, Hydro continues to utilize its portfolio of assets to manage reservoir levels. Hydro will continue to monitor progress and mitigate work execution and operational risks. The system is well positioned to meet the needs of all customers for the 2025–2026 winter season.

Holyrood TGS Unit 3 is anticipated to return to service in mid-January 2026 due to the additional work required to refurbish the steam turbine rotor during the Overhaul Turbine and Valves Program. In advance of Unit 3’s return to service, Hydro has sufficient generation reserves and appropriate plans in place to mitigate any risk to the system.

The Labrador-Island Link (“LIL”) continues to reliably support the Island Interconnected System, delivering both capacity and energy to meet system needs, and will be available for bipole operation up to 700 MW this winter. Subject to the completion of high-power testing, which Hydro continues to plan for execution in the fourth quarter of 2025, the LIL will be able to be operated up to 900 MW as system conditions permit.¹

Although Hydro has identified risks as outlined in this report, it is important to note that the identification of risks is a normal and important piece of Hydro’s comprehensive planning and

¹ Completion of high-power testing is subject to the prerequisite conditions as discussed in “*Reliability and Resource Adequacy Study Review – Labrador-Island Link Update for the Quarter Ended September 30, 2025*,” Newfoundland and Labrador Hydro, October 3, 2025.

- 1 preparedness processes. These processes help to ensure reliable operation during our winter operating
- 2 seasons.
- 3 Hydro continues to monitor the remaining work activities and risks to WR, and will provide a further
- 4 update in its next 2025–2026 Winter Readiness Planning Report, to be filed on November 10, 2025.

Contents

Executive Summary.....	i
1.0 Introduction	1
2.0 Holyrood Thermal Generating Station.....	3
2.1 Annual Work Plan and Winter Readiness Status	3
2.2 Critical Spares.....	6
2.3 Plant and Equipment Testing	7
2.4 Risk and Risk Mitigation	8
2.4.1 Unit 3 Turbine and Valves Overhaul	9
2.4.2 Unit Boiler Tubes.....	9
2.4.3 High Pressure Feedwater Heaters	9
2.4.4 Unit 1 Turbine Control Valve.....	10
2.4.5 Fuel Oil Contamination Storage Tank 3	11
2.4.6 Cooling Water Sump Structures.....	12
2.4.7 Fuel Oil Storage Tank 1	12
3.0 Combustion Turbine Generation	13
3.1 Annual Work Plan and Winter Readiness Status	13
3.2 Critical Spares.....	15
3.3 Plant and Equipment Testing	16
3.4 Risk and Risk Mitigation	16
4.0 Hydraulic Generation	16
4.1 Annual Work Plan and Winter Readiness Status	16
4.2 Critical Spares.....	20
4.3 Plant and Equipment Testing	21
4.4 Risk and Risk Mitigation	21
4.4.1 Bay d’Espoir Penstocks.....	21
4.4.2 Hinds Lake Unit Vibration and Shaft Seal Leakage.....	22
5.0 Muskrat Falls Assets.....	23
5.1 Annual Work Plan and Winter Readiness Status	23
5.2 Critical Spares.....	25
5.3 Plant and Equipment Testing	25
5.4 Risk and Risk Mitigation	26

5.4.1	Muskrat Falls Unit 1 Intake – Concrete Spalling	26
5.4.2	Optical Ground Wires Tower Peak and Top Plate Design	26
5.4.3	Electrode Conductors.....	27
5.4.4	DCCT Cold Weather Operation	27
5.4.5	Synchronous Condenser Brush Gear Assemblies	28
6.0	Transmission and Terminal Stations	29
6.1	Annual Work Plan and Winter Readiness Status	29
6.2	Plant and Equipment Testing	31
6.3	Risk and Risk Mitigation	32
6.3.1	Generator Step-Up Transformer Spares	32
6.3.2	Western Avalon Terminal Station – Replace Bushing Connecting the Gas Insulated Switchgear to Transmission Line TL267	32
7.0	Operational Technology.....	33
7.1	Annual Work Plan and Winter Readiness Status	33
7.2	Plant and Equipment Testing	33
8.0	Status of Winter Readiness for Capital Projects and Programs.....	33
9.0	System Energy Capability	34
10.0	Conclusion.....	37

List of Appendices

Appendix A: Status of Capital Projects and Programs Related to Winter Readiness

Appendix B: Master Generation Outage Schedule

Appendix C: Critical Spares Status Listing for Thermal Generation

Appendix D: Status of Winter Readiness Testing of Plant and Equipment for Thermal Generation

Appendix E: Critical Spares Status Listing for Combustion Turbine Generation

Appendix F: Critical Spares Status Listing for Hydraulic Generation

Appendix G: Status of Winter Readiness Testing of Plant and Equipment for Hydraulic Generation

Appendix H: Critical Spares Status Listing for Muskrat Falls Generation

Appendix I: Status of Winter Readiness Testing of Plant and Equipment for Muskrat Falls Generation

1.0 Introduction

In 2016, the Board of Commissioners of Public Utilities (“Board”) directed Hydro to provide an annual report detailing its WR planning.² This report, for the 2025–2026 winter season, addresses the following items as requested by the Board:

- The status of annual work plan items, for Hydro’s generating plant and transmission and terminal stations, including the completion to date, outstanding items to complete, and any risks to completion or as a result of failure to complete.
- A description and schedule for all outstanding [2025] capital projects for Hydro’s generating plant and transmission and terminal stations, including progress on completion status to date and expected completion date.
- Identification of all equipment and plant testing to be carried out in advance of the winter period (generation plant, emergency diesels, black start generators, fire systems, transmission system equipment), including progress on completion status to date.
- The planned generation outage schedule for the period September 1 to December 31, [2025], including an explanation for any planned outages extending beyond December 1, [2025].³
- An update of critical spares assessment and procurement.
- Identification of any risks that could impact the winter readiness of assets as of December 1, [2025] and associated contingency plans.⁴

² “Investigation and Hearing into Supply Issues and Power Outages on the Island Interconnected System – Directions further to the Board’s Phase One Report,” Board of Commissioners of Public Utilities, October 13, 2016, p. 2, item iii.

³ In previous years, Hydro’s WR report included a Near-Term Reliability and Resource Adequacy section. The Board approved the removal of the duplicate information in “Newfoundland and Labrador Hydro - Reliability and Resource Adequacy Study Review – Schedule for Future Updates,” Board of Commissioners of Public Utilities, August 17, 2023. The information has been provided in the “Reliability and Resource Adequacy Study Review – 2024 Near-Term Reliability Report,” Newfoundland and Labrador Hydro, November 20, 2024.

⁴ “Request to Hydro to file Winter Readiness Planning 2016-2017,” Board of Commissioners of Public Utilities, September 13, 2016.

Hydro’s AWP integrates all planned activities for the year (i.e., corrective maintenance (“CM”), preventive maintenance (“PM”), and capital project support) that are critical to the safe and reliable production and transmission of electricity. Hydro regularly measures the progress of its AWP execution in comparison with the plan, and is able to track the AWP status down to the level of individual work plan items. The individual AWP for various assets are incorporated into an integrated AWP. While some AWP activities are planned for completion through December 2025, those tagged as WR activities are generally planned for completion by December 1, 2025.

To ensure WR, Hydro follows a structured checklist for planning and documenting its testing and inspection of plant and equipment in its thermal and hydroelectric generation facilities.

In its transmission, terminal station, operational technology, and combustion turbine (“CT”) operations, Hydro relies on its AWP process to plan and track its WR testing and inspection of these assets. The AWP in these areas include planned PM activities and CM items, both of which involve inspection and testing. Planned PMs and CMs, and any other activities pertaining to WR, are flagged inside the respective AWP and may be tracked separately from other AWP items that are not WR related.

Except where otherwise noted, information presented in this report covers both the Island Interconnected System and the Labrador Interconnected System for the period ending September 30, 2025.⁵ This report is organized by operating area (i.e., Holyrood TGS, CT Generation, Hydraulic Generation, Muskrat Falls Assets, Transmission and Rural Operations, and Operational Technology), and WR activities for each operating area are discussed in Sections 2.0 through 7.0 and relevant appendices, which contain applicable information on:

- **Annual Work Plan and Winter Readiness Status:** This report provides a consolidated summary of operation and maintenance progress, both for the entire AWP and the WR tasks for each area. Each status chart includes the completed and remaining operations and maintenance AWP and WR tasks, as well as an indication of the planned task completion target to date.
- **Critical Spares:** A full update on the status of Hydro’s critical spares for the 2025–2026 winter season is provided in this report. This update includes a detailed listing of critical spares

⁵ The data used to generate the AWP and WR Status charts reflect a data cutoff date of September 19, 2025.

requirements for each area of generation operations and the status of each item.⁶ Items are categorized as In Stock, Non-Stock or Procurement Ongoing. In Stock status indicates the part is in inventory. Non-stock status is used when parts are critical but not necessary to keep in stock (e.g., because the part is readily available locally). Procurement Ongoing status indicates the part is required to be in stock but is not, and is at a varying stage of the procurement process.

- **Plant and Equipment Testing:** Discussion of equipment and plant testing to be carried out in advance of the winter period, including structured checklist for planning and documenting its testing and inspection of plant and equipment in its thermal and hydroelectric generation facilities.

- **Risk and Risk Mitigation:** Discussion of items influencing WR and/or reliable operations.

In line with Board direction, Hydro also provides an update on its capital programs and projects impacting WR in Section 8.0 and Appendix A. As reflected throughout this report, a number of generating unit annual maintenance programs have been completed across the fleet and Hydro plans to complete annual maintenance on all of its units in advance of the winter season, with the exception of Holyrood TGS Unit 3. The Master Generation Outage Schedule for September 1 to December 31, 2025 is provided as Appendix B.

2.0 Holyrood Thermal Generating Station


2.1 Annual Work Plan and Winter Readiness Status



The status of AWP and WR execution at the Holyrood TGS is summarized in the following charts, including:

- Units 1, 2, and 3; and
- Balance of Plant, including black start diesels.


⁶ Hydro utilizes a number of its spare parts to address deficiencies found during the maintenance season; as such, fall maintenance outages may result in the requirement to replenish additional spare components.

- 1 All planned 2025 WR work is on target for completion by December 1, 2025, aside from activities related
- 2 to related to Unit 3. Unit 3's return to service is anticipated in mid-January 2026 due to additional work
- 3 identified to refurbish the steam turbine rotor during the Overhaul Turbine and Valves Program.

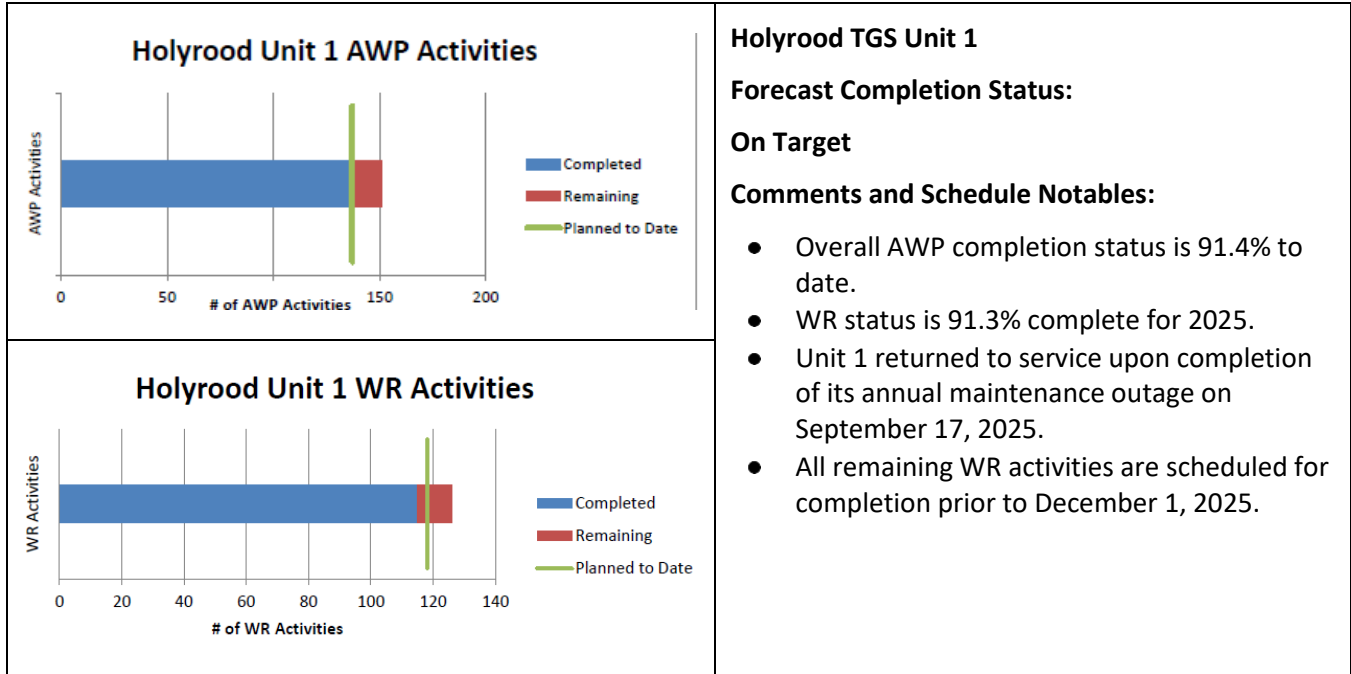

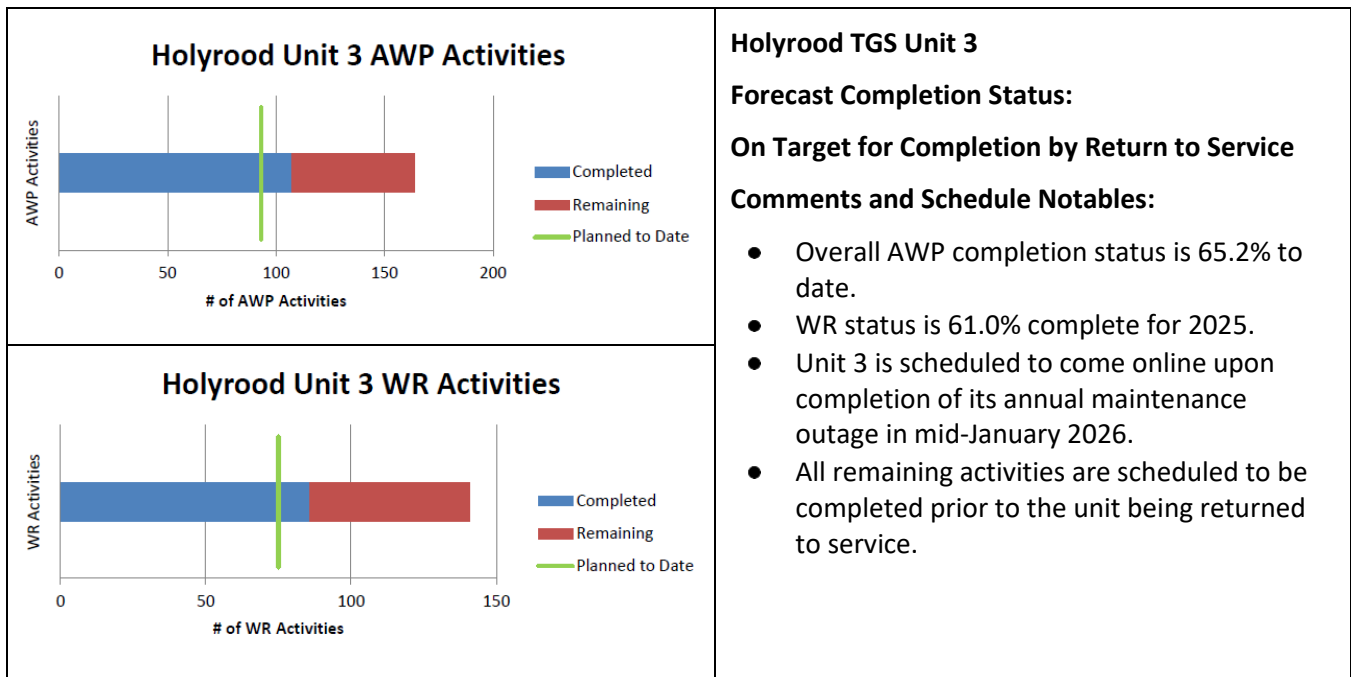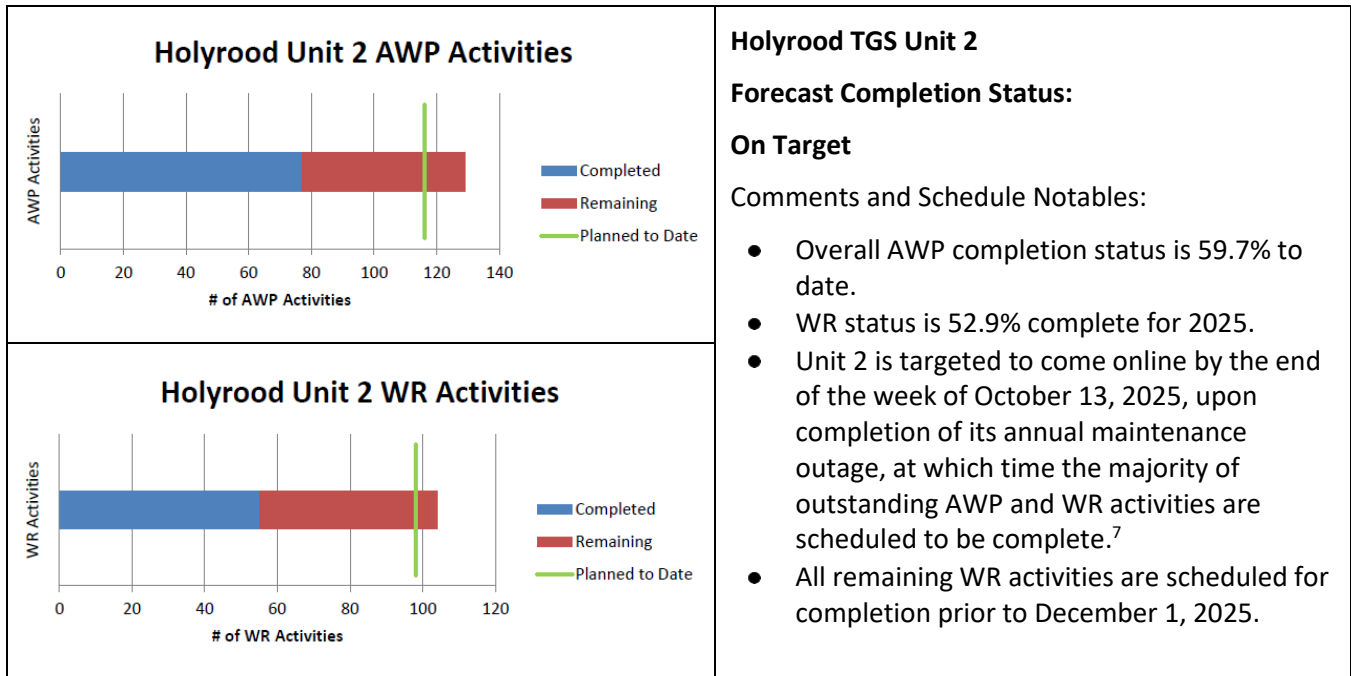

⁷ As the status charts reflect a data cutoff date of September 19, 2025, activities completed in preparation to start the unit for system generation needs in early October will be reflected in the filing of the next 2025–2026 Winter Readiness Planning Report, scheduled for November 10, 2025.

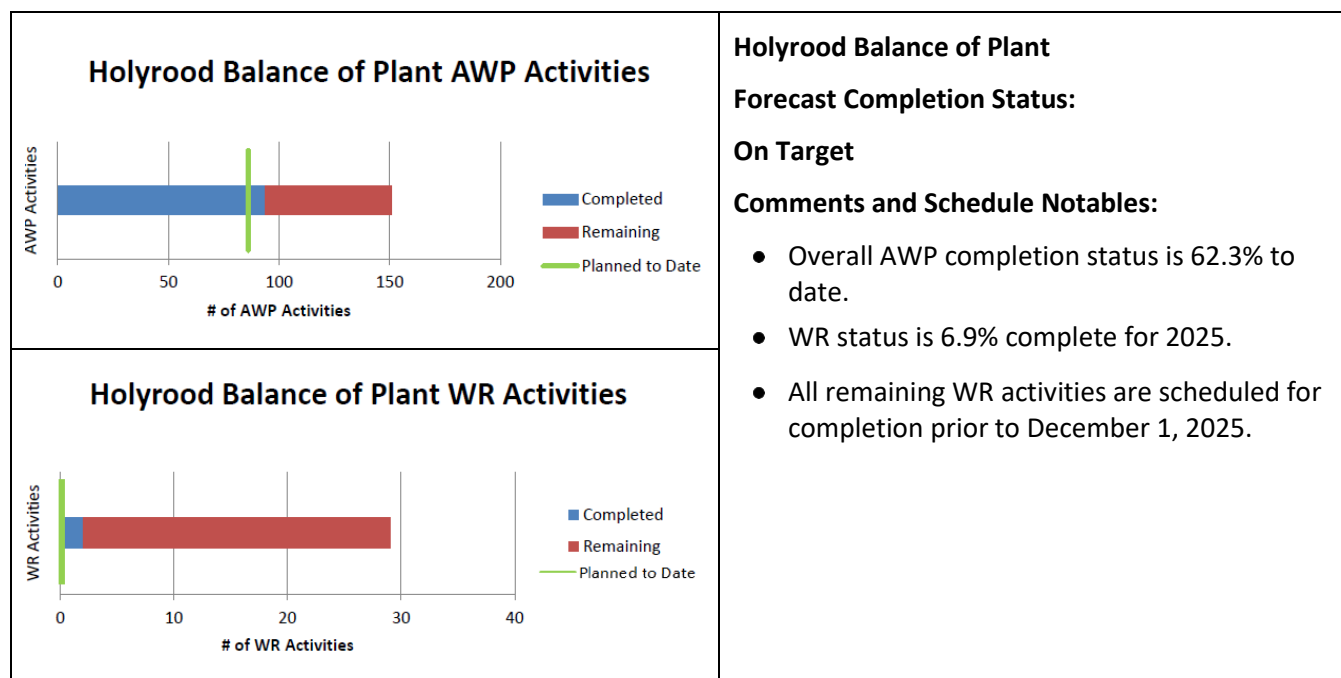

2.2 Critical Spares

The complete list of critical spares for the Holyrood TGS is provided in Appendix C.

Table 1: Critical Spares for Thermal Generation

Status	Quantity
In Stock	729
Non-Stock ⁸	17
Procurement Ongoing	29
Total	775

As summarized in Table 1, there are 29 critical spare stock items currently not in stock, they are either on order or not yet on order. Six items have purchase orders issued, and expected delivery dates will be provided in the November 2025 filing of the 2025–2026 Winter Readiness Planning Report. Two items have been sent to third-party vendors for refurbishment, and are expected to be returned to site prior to December 1, 2025.

⁸ For the Non-Stock parts, an explanation of the reason why it is Non-Stock is provided in the Notes column in Appendix C.

The remaining twenty-one items not yet on order were recently consumed during the Overhaul Unit 3 Turbine and Valves program. A complete parts review for Unit 3 is currently underway, with a purchase order to be placed for these items, and any other recommended spares, upon completion of this review to secure preferred pricing and shipping. All items are expected to be on order by the end of October, 2025. As these outstanding items are typically used during outages only, Hydro considers the risk to WR to be low.

2.3 Plant and Equipment Testing

WR testing of generating equipment in thermal generation is focused primarily around annual unit maintenance outages. Following these annual outages, units are run up and synchronized and all systems are verified before the unit's operating status is determined and preparedness is confirmed. Unit load tests are performed at this time as well; however, all required load testing is not completed until later in the fall when system conditions allow. The WR testing protocol includes the testing of appropriate Balance of Plant components, including the black start diesel generators.⁹ The current status of equipment/plant testing for thermal generation is indicated in Appendix D.

Unit 1 was returned to service on September 17, 2025 after completion of its annual maintenance outage. Many of the start-up checks for Unit 1 have been completed, as reflected in Appendix D. The completion of load testing and online safety valve testing remains outstanding due to an issue discovered with the turbine control valves after the unit returned to service, restricting the unit to 100 MW. This issue is planned for correction after Unit 2 is returned to service. Unit 1 will remain online, derated to 100 MW, until that time. High pressure ("HP") feedwater heaters Number 4 and 5 are not available for service this year due to the failure of Heater Number 4. Heater Number 6 will remain in service. This will not impact the ability of the unit to operate reliably at full load for this winter.

Unit 2 is scheduled to come online by the end of the week of October 13, 2025 following the conclusion of its annual maintenance outage. Unit 3's return to service is extended to mid-January 2026 due to the additional work required during the Overhaul Unit 3 Turbine and Valves Program.¹⁰ As indicated in Appendix D, the majority of start-up checks on both Unit 2 and 3 have not been completed due to the

⁹ The black start diesel generators are run up to speed and synchronized on a weekly basis to confirm their availability. The function of all associated breakers are also tested and confirmed.

¹⁰ Further extension is possible; however, as this project has completed the discovery phase, additional unexpected findings which may extend the return to service date of the unit are considered to be unlikely.

ongoing outages. The start-up checks will commence in preparation to return the units to service, with the remainder completed when the units are started up for system generation needs. All HP feedwater heaters are expected to be in service for Unit 2 for this winter. Heater Number 6 on Unit 3 will not be available for service this year due to failure. Heater Number 4 and 5 are expected to be in service. Both units are expected to be available for full load when they are returned to service.

With the exception of Unit 3, Hydro does not anticipate any concerns regarding completion of the start-up checks for all units by December 1, 2025.

2.4 Risk and Risk Mitigation

In accordance with capacity requirements as specified by Hydro in its 2024 Resource Adequacy Plan,¹¹ Hydro has recommended that all three Holyrood TGS units remain available through the “Bridging Period”¹² while Hydro seeks to develop new long-term sources of supply.

In 2021, Hatch Ltd. (“Hatch”) completed its Life Extension Condition Assessment Study (“LECA”),¹³ including a capital plan to support the standby operation of the Holyrood TGS to 2030. In 2024, Hatch completed a refresh to their capital plan, which also considered operations to 2035 to inform the capital costs of operating beyond 2030, should this be required.¹⁴ It is recognized that increased age can result in an increased risk of in-service failures. Hydro mitigates this risk through regular overhaul programs on major components, increased condition assessment work, and a robust critical spares program.

Hydro anticipates that Units 1 and 2 at the Holyrood TGS will be fully available for the winter period.

Unit 3 is undergoing major overhaul of the steam turbine and valves, and due to additional work

¹¹ “2024 Resource Adequacy Plan – An Update to the Reliability and Resource Adequacy Study,” Newfoundland and Labrador Hydro, rev. August 26, 2024 (originally filed July 9, 2024).

¹² Hydro considers the Bridging Period to be from the present to 2030, or until such time that sufficient alternative generation is commissioned, adequate performance of the LIL is proven, and generation reserves are met. During the Bridging Period, the system would rely primarily on existing sources of generation capacity to maintain reliability while new generation capacity is being built. The primary, readily available supply options in this period are extending the retirements of the Holyrood TGS, Stephenville GT and the Hardwoods GT until their capacities can be adequately replaced.

¹³ “Reliability and Resource Adequacy Study Review – Assessment to Determine the Potential Long-Term Viability of the Holyrood Thermal Generating Station,” Newfoundland and Labrador Hydro, March 31, 2022, att. 2.

¹⁴ “Reliability and Resource Adequacy Study Review – Holyrood Thermal Generating Station Capital Plan Refresh,” Newfoundland and Labrador Hydro, March 7, 2025, att. 1.

identified during this project, its return to service date has been extended to mid-January 2026. Items influencing WR and/or reliable operations are identified in the sections that follow.

2.4.1 Unit 3 Turbine and Valves Overhaul

The WR scope in this program is to clean, inspect, test, and refurbish or overhaul as required the turbine and turbine valves for Unit 3 at the Holyrood TGS. The planned inspection and overhaul of the turbine valves is substantially complete, with final commissioning to occur during the start up and return to service of Unit 3.

The planned turbine inspection has been completed and overhaul work is in progress. During the project discovery phase, damage was discovered on a turbine rotor diaphragm that requires additional time to refurbish at the original equipment manufacturer's ("OEM") facility. The diaphragm refurbishment work is ongoing and the component is expected to be returned to the Holyrood TGS by the end of the week of October 13, 2025. Installation of this component in the lower turbine casing is required for turbine reassembly and has delayed the reassembly of Unit 3 turbine. As a result, the expected return to service of Unit 3 has been delayed to mid-January 2026.

2.4.2 Unit Boiler Tubes

Each of the three thermal generating units at the Holyrood TGS has a boiler that contains tubes, the failure of which are a common issue in thermal power plants.¹⁵ To mitigate the possibility of tube failures, Hydro conducts a thorough annual tube inspection and test program, which was executed during the 2025 annual outage season, and is scheduled to reoccur in 2026. Hydro has determined that the boiler tube sections as a whole are in good condition; however, tube failures continue to pose a risk. Hydro maintains a thorough selection of spare tube material and a contract with an experienced boiler contractor for the provision of emergency repairs in the event of tube failures.

2.4.3 High Pressure Feedwater Heaters

In recent years, Hydro has experienced increasing difficulty in operating the HP feedwater heaters, with the majority of the heaters unavailable for service during the 2023–2024 operating season due to tube

¹⁵ Boiler tube failures are a common issue in thermal power plants due to the inherent design, which requires relatively thin walls for heat transfer to be subjected to high temperatures and stresses.

bundle leaks.¹⁶ In 2024, Hydro began a condition assessment program,¹⁷ under which all heaters will be opened for internal inspection and tube testing over the next two years.

This program continued in 2025, with a total of six of the nine heaters assessed to date.¹⁸ Four of these heaters were refurbished and returned to service; two had deteriorated severely and could not be refurbished. Replacement of these heaters (Heater Number 4 on Unit 1, and Heater Number 6 on Unit 3) is ongoing. Three heaters remain to be assessed in 2026, all of which are available for service. For the 2025–2026 operating season Unit 1 will have one heater in service, Unit 2 will have three heaters in service, and Unit 3 will have two heaters in service as a result of this ongoing work. Based on heater lead-time and the need for installation during a unit outage, replacement of the two failed heaters is expected to occur after the 2025–2026 operating season.

The units can be operated reliably at full load without the HP feedwater heaters in service; however, extended operation without the heaters can cause premature failures of turbine and boiler components. As such, Hydro considers the risk to the Holyrood TGS for this winter operating season to be low.

2.4.4 Unit 1 Turbine Control Valve

The completion of the Overhaul Unit 1 Turbine Valves and Generator 2024 Program included assessment and refurbishment of the main steam control valves. During the assessment of these components by the turbine service provider, it was discovered that the camshafts that control opening and closing of the control valves were bent outside of the OEM recommended tolerance for reliable operation. Two spare camshafts, OEM supplied, were used to rebuild the control valve assemblies.

During commissioning of the unit during April 2025, load was limited intermittently. The OEM investigated the issue and determined that pins on the new camshafts were interfering with the control valves, preventing full opening. The interference was corrected, and the unit successfully returned to service.

¹⁶ The HP heaters transfer heat from steam outside of the tubes to the feedwater, which then passes through the tube bundles to the boiler. Each unit contains three heaters, which are intended to improve thermal efficiency.

¹⁷ “2024 Capital Budget Application,” Newfoundland and Labrador Hydro, rev. September 21, 2023 (originally filed July 12, 2023), sch. 6, prog. 6.

¹⁸ There are three heaters per unit, numbered 4 through 6.

After this adjustment, the unit was operated for a brief period without the issue reoccurring before being shut down for the summer. Hydro believed that this issue was resolved; however, during the return to service of Unit 1 in September 2025 after completion of the annual outage, the same load limit was experienced, restricting the unit to 100 MW. It is expected that a similar adjustment is required, which will be completed in consultation with the OEM and service provider upon the return to service of Unit 2, which is scheduled to come online by the end of the week of October 13, 2025 following its annual maintenance outage. Unit 1 will remain online, derated to 100 MW, until that time.

2.4.5 Fuel Oil Contamination Storage Tank 3

In March 2025, Hydro received a fuel delivery of just over 202,000 barrels. The bulk of this delivery (approximately 180,000 barrels) was allocated to Tank 3 while the remaining (approximately 22,000 barrels) was stored in Tank 1. While this fuel delivery fully complied with Hydro's specifications, issues with frequent strainer plugging were encountered immediately with fuel drawn from Tank 3, with contamination suspected. At that time, there were also leaks in the steam piping to Tank 3, which limited the amount of heating that could be provided to the fuel oil and may have contributed to the strainer plugging; however, this has since been corrected.

When Unit 1 was returned to service in September 2025, Tank 4 was in service and there were no concerns with fuel plugging. Upon switching fuel delivery from Tank 4 to Tank 3, strainer plugging became severe, leading to a trip of Unit 1 on September 25, 2025 due to insufficient fuel supply to the boiler.

Rather than discharge the fuel, operational strategies will be followed to consume the fuel in Tank 3, including using the fuel from Tank 3 in parallel with other tanks to dilute the contaminated fuel and reduce the potential for fouling. Tank 3 currently contains the most fuel. As the tanks must contain the same level of fuel to be utilized parallel, the fuel in Tank 3 will be burned down carefully until it can be placed in parallel with another tank. Risk will remain as the fuel from Tank 3 is gradually consumed.

Preventive measures are also required to prevent the receipt of contaminated fuel in future, including:

- Consultation with the fuel supplier and other industry experts;

- Review of Hydro’s fuel delivery and storage practices, fuel specifications, and testing/sampling methods to identify possible improvements; and
- Testing and study of the deposits to understand their origin and identify preventive measures.

2.4.6 Cooling Water Sump Structures

The WR scope in this project is to clean, inspect, and perform a Level 2 Condition Assessment of the Holyrood Stage 2 Pumphouse cooling water sump structures. This project was initially approved by the Board to complete a Level 2 Condition Assessment of both the Stage 1 & Stage 2 cooling water sump structures in 2025; however, as a result of the outcome of the procurement process, Hydro adjusted its approach and proposed to proceed with the inspection of Pumphouse 2 only in 2025, and to extrapolate the findings to define the scope of the Pumphouse 1 refurbishments.¹⁹ The risk associated with not completing the condition assessment of Pumphouse 1 in 2025 is considered to be low, and was mitigated by completing a UAV²⁰ inspection to identify any significant changes in the concrete condition over the past 12 months. This inspection is now complete, with preliminary feedback indicating that no major changes were observed.

The schedule delay associated with pausing the project construction activities to update, review and approve the new project budget and scope has resulted in the expected completion date for this project to be extended to late-December, 2025.

2.4.7 Fuel Oil Storage Tank 1

During a tanker delivery in November 2024, while filling Tank 1, it was determined that both suction heaters²¹ on this tank had tube leaks. The leaking tubes were removed from service by plugging, which allowed the suction heaters to be returned to service; however, the number of tubes removed from service in each heater was significant, and has reduced their heating capability. As such, for reliable winter operation, the Tank 1 suction heaters need to be replaced.

Hydro purchased replacement suction heaters, which are expected to be delivered to site in fall 2025.

Hydro will prioritize the consumption of fuel from Tank 1 early in the operating season to reduce the

¹⁹ The Board approved Hydro’s proposal and updated budget in Board Order No. P.U. 29(2025).

²⁰ Unmanned Aerial Vehicle.


²¹ The suction heaters utilize steam to heat the oil to a sufficient temperature, allowing the oil to flow freely from the tank farm to the plant for combustion in the boilers.



1 level of fuel in the tank to a point where the suction heaters can be replaced. This replacement work is
 2 planned for completion prior to December 1, 2025.

3 3.0 Combustion Turbine Generation


4 3.1 Annual Work Plan and Winter Readiness Status

5 The status of AWP and WR execution at the Holyrood CT, Hardwoods GT, Stephenville GT, and Happy
 6 Valley GT is summarized in the following charts. Planned WR work for all CTs is on target for completion
 7 by December 1, 2025.

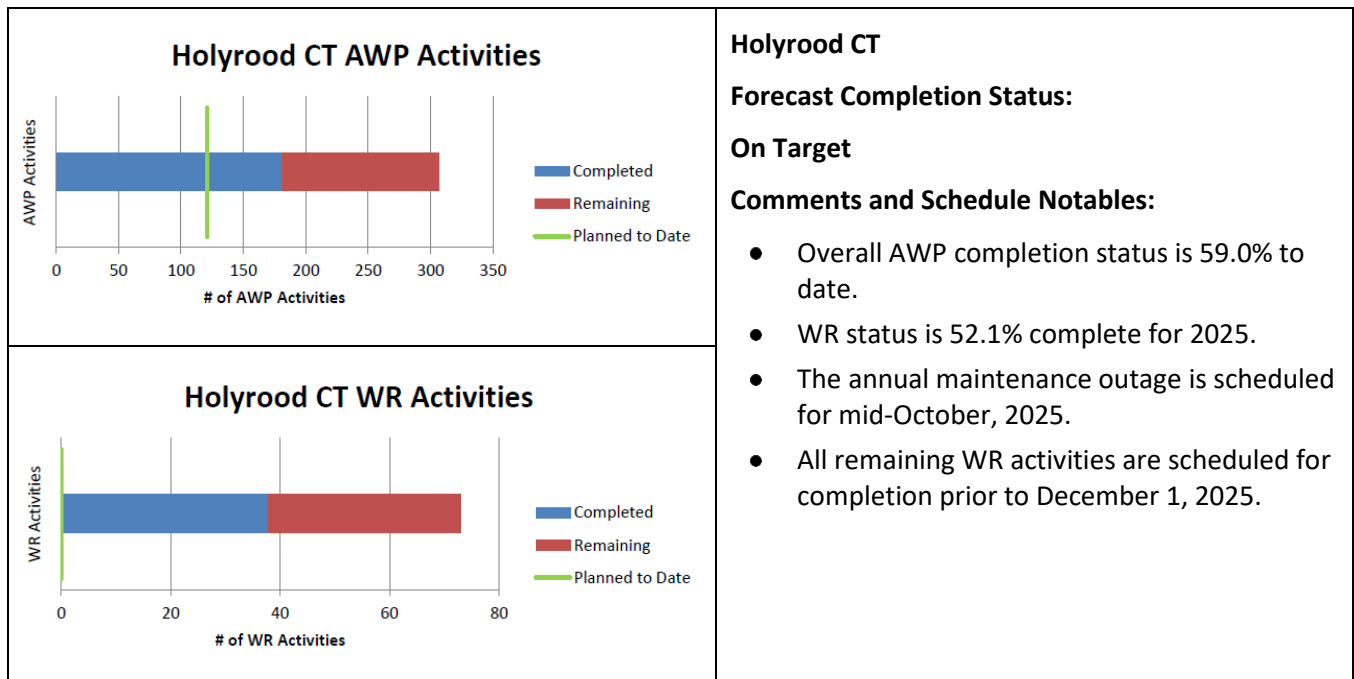

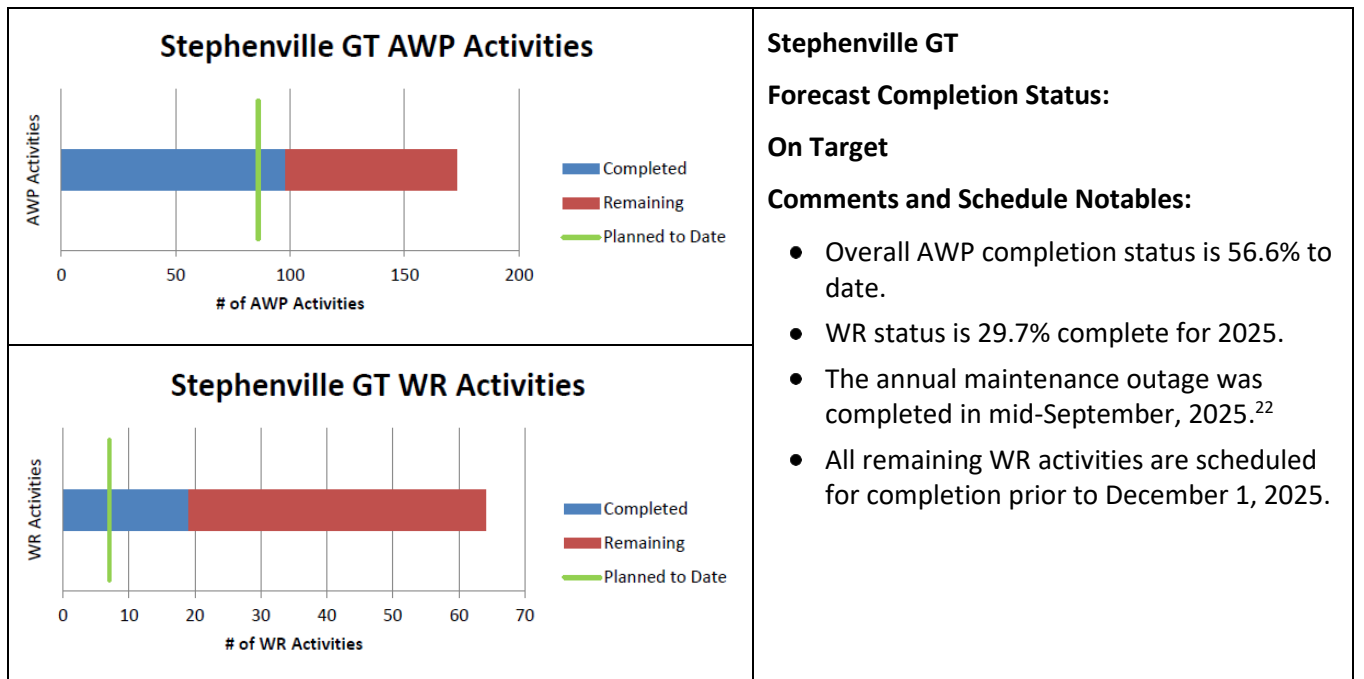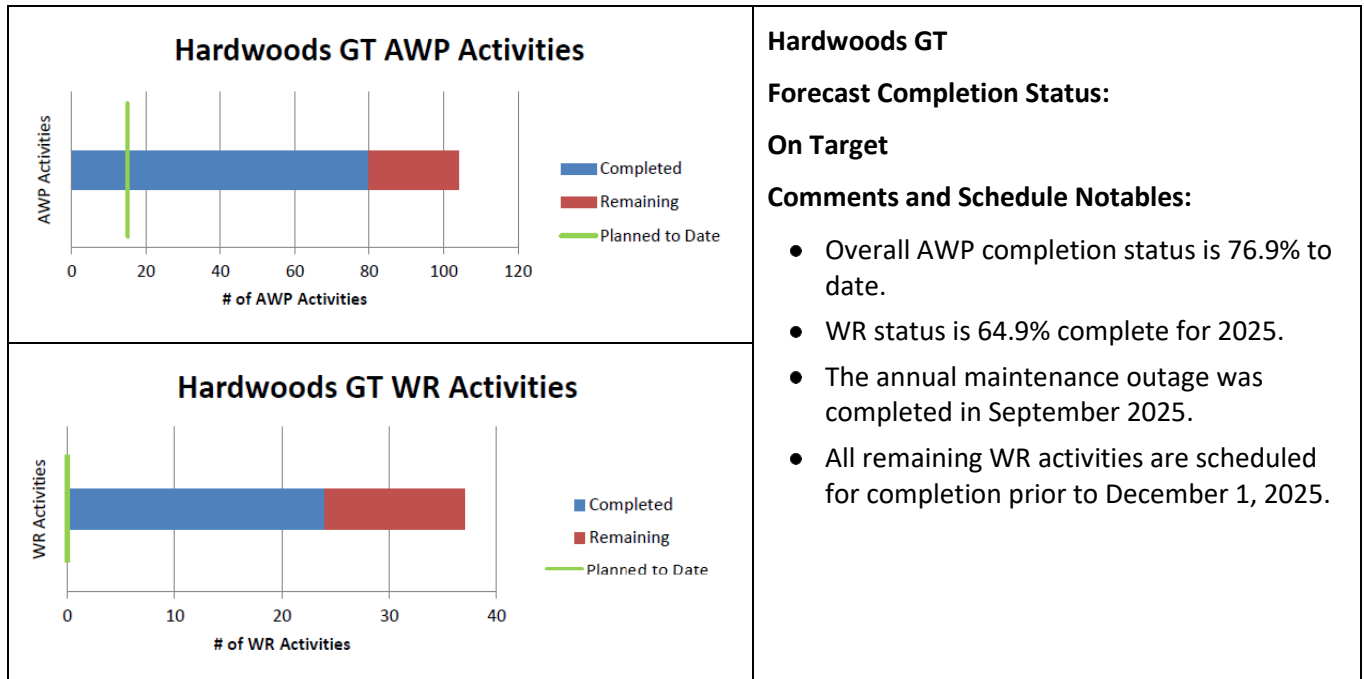

²² As the status charts reflect a data cutoff date of September 19, 2025, activities completed during the annual maintenance outage in mid-September will be reflected in the filing of the next 2025–2026 Winter Readiness Planning Report, scheduled for November 10, 2025.

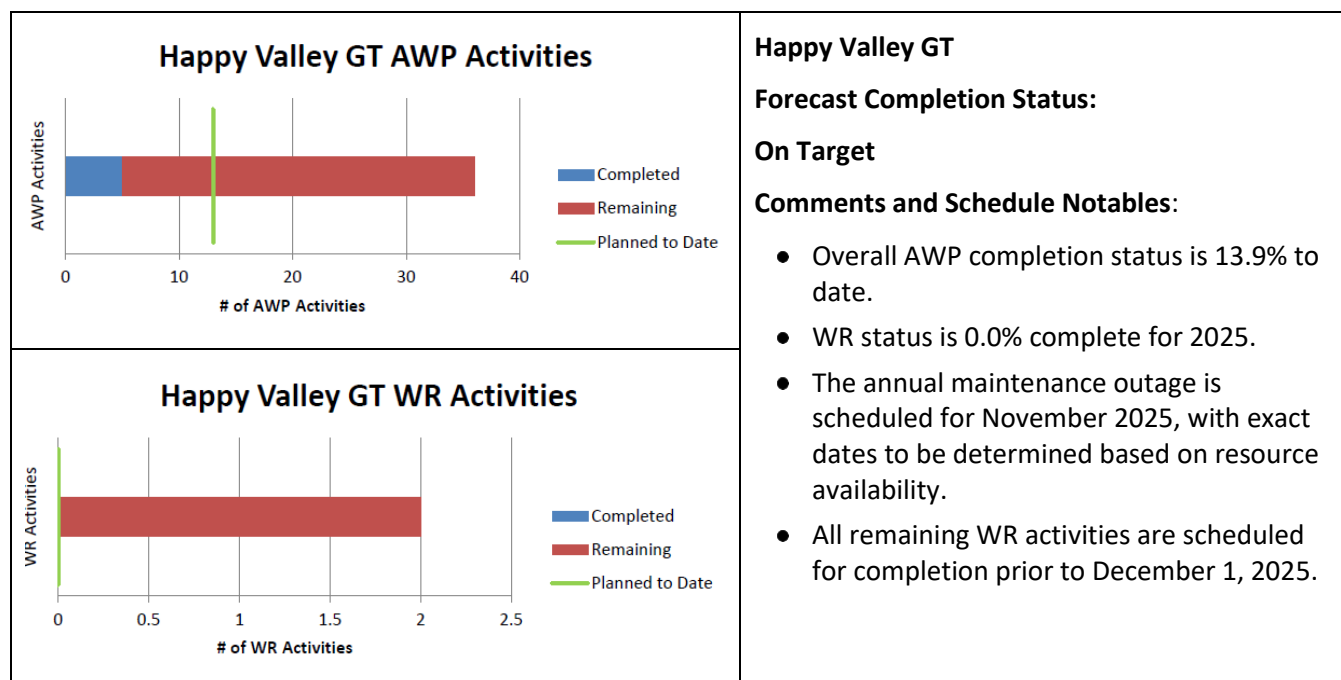

1 3.2 Critical Spares

- 2 Table 2 summarizes the status of spare parts for the Hardwoods GT, Stephenville GT, Holyrood CT, and
- 3 Happy Valley GT and Appendix E contains detailed lists for each.

Table 2: Critical Spares for CT Generation

Status	Hardwoods/ Stephenville	Holyrood	Happy Valley	Total
In Stock	90	402	54	546
Procurement Ongoing	0	1	0	1
Total	90	403	54	547

- 4 As Hydro utilized some of its critical spares during recent fall maintenance outages, one critical spare
- 5 remains outstanding as of September 30, 2025. The consumed item is on order, with expected delivery
- 6 in October 2025.
- 7 Should any outstanding parts be required prior to delivery, it may be possible for Hydro to temporarily
- 8 utilize other in stock parts until the spares are received; as such, the risk to WR is low.

3.3 Plant and Equipment Testing

Examples of WR activities that are included in the AWP for the Holyrood CT, Hardwoods GT, Stephenville GT, and Happy Valley GT include the following:

- PMs and CMs for major components and auxiliary systems;
- Black start testing;
- Monthly operational testing; and
- Execution of capital upgrades and refurbishment.

Black start testing of the Holyrood CT and the Happy Valley GT is complete. Hydro anticipates that completion of planned black start tests for Hardwoods and Stephenville GTs will occur before December 1, 2025 during upcoming planned maintenance outages and planned monthly operational testing.

Operational testing of all CTs was performed throughout the year as planned and all WR capital upgrades and refurbishments are anticipated to be completed by December 1, 2025.

3.4 Risk and Risk Mitigation

Hydro anticipates that all CTs will be fully available by December 1, 2025. There are currently no existing risk to WR and/or reliable operations related to CT operations.


4.0 Hydraulic Generation



4.1 Annual Work Plan and Winter Readiness Status



The status of AWP and WR execution at hydraulic generation facilities is summarized in the following charts, including:

- Bay d’Espoir Hydroelectric Generating Station (“Bay d’Espoir”);
- Cat Arm Hydroelectric Generating Station (“Cat Arm”);
- Hinds Lake Hydroelectric Generating Station (“Hinds Lake”);
- Paradise River Hydroelectric Generating Station (“Paradise River”);
- Upper Salmon Hydroelectric Generating Station (“Upper Salmon”); and


- 1 ○ Granite Canal Hydroelectric Generating Station (“Granite Canal”).
- 2 WR work for all hydraulic generation facilities is on target for completion by December 1, 2025.

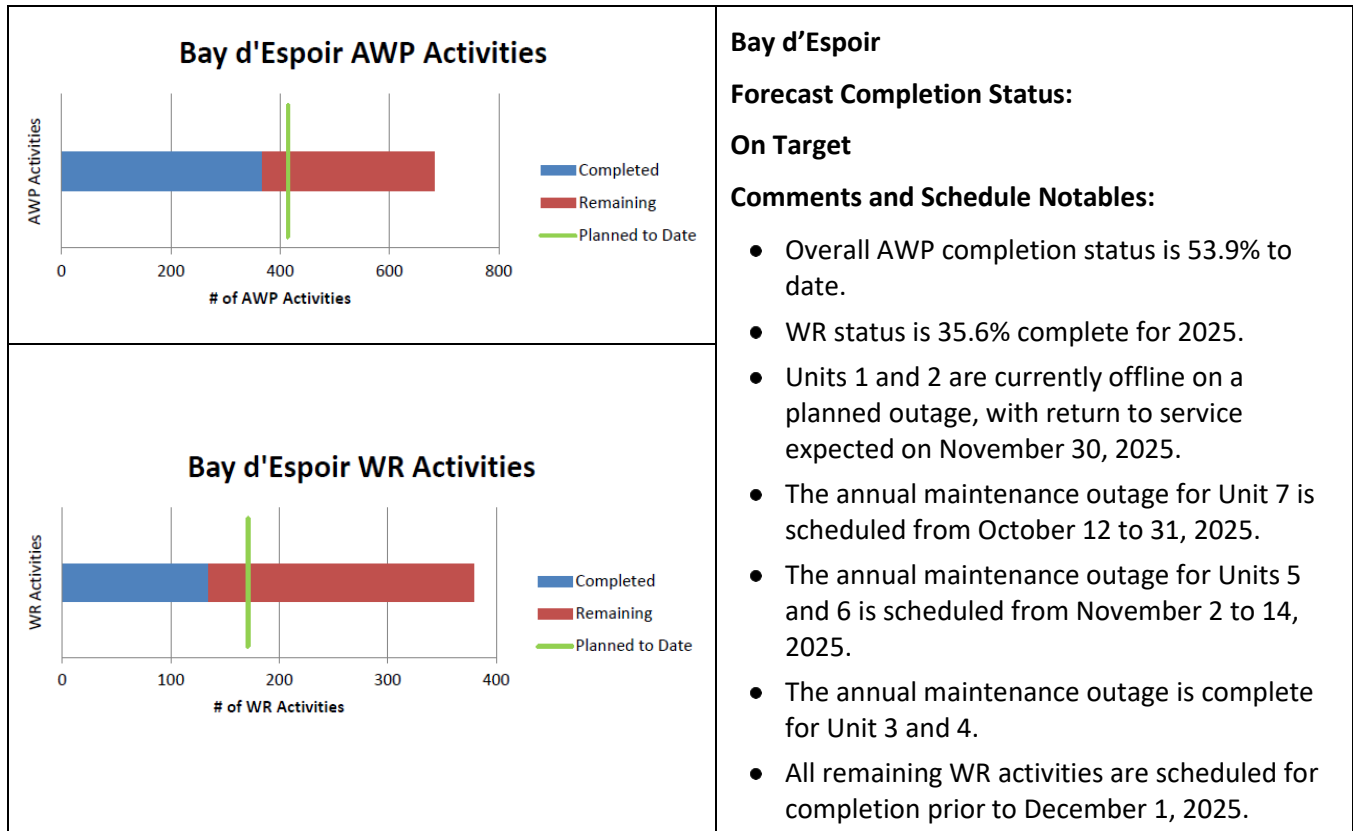

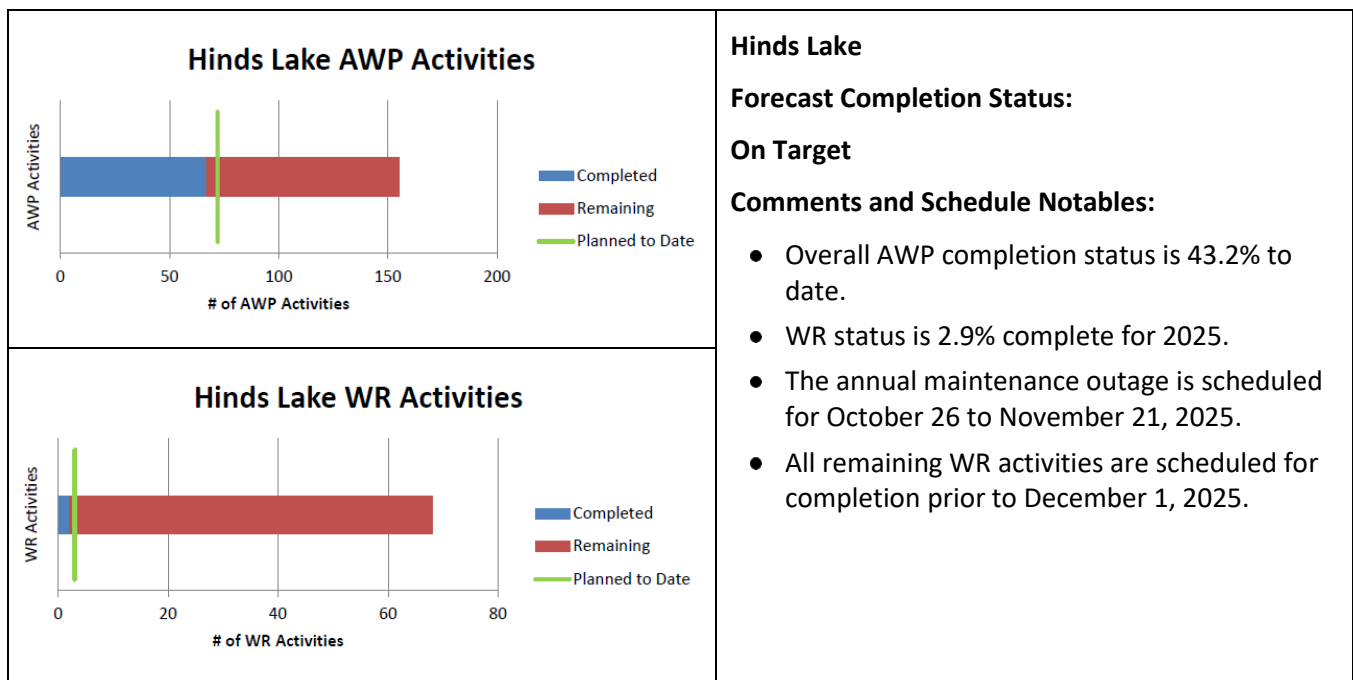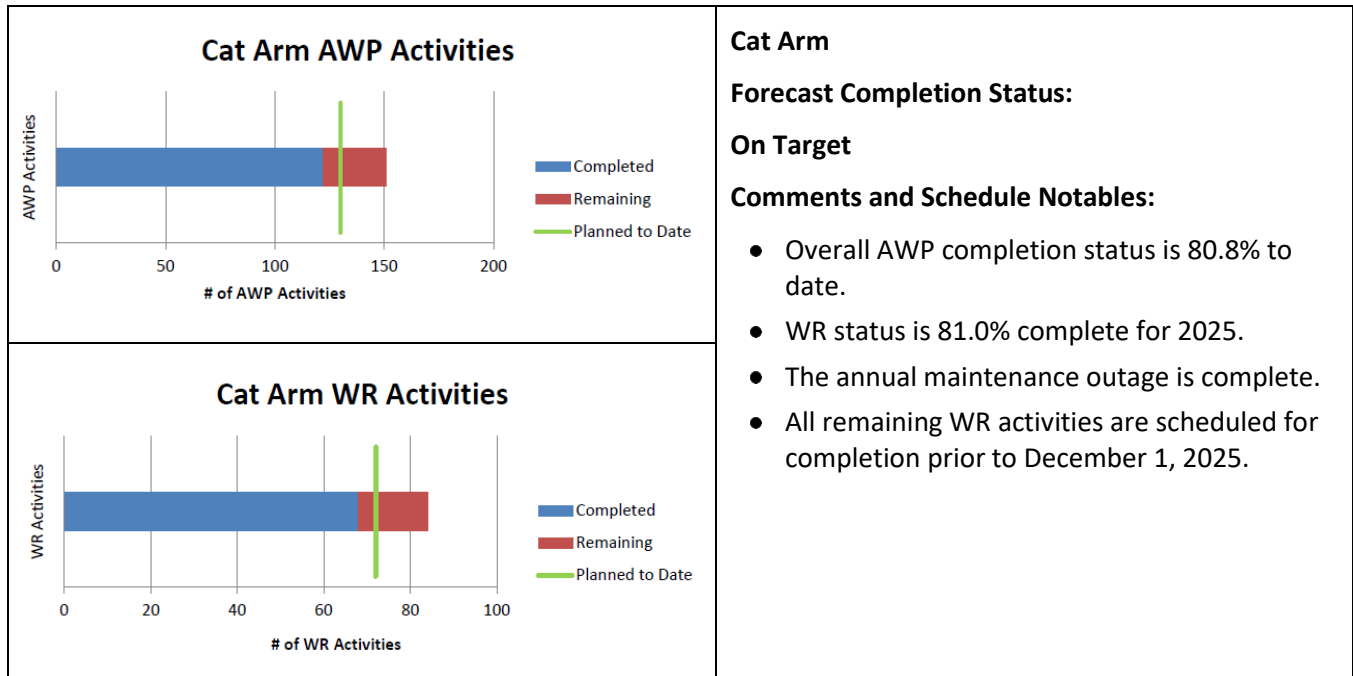

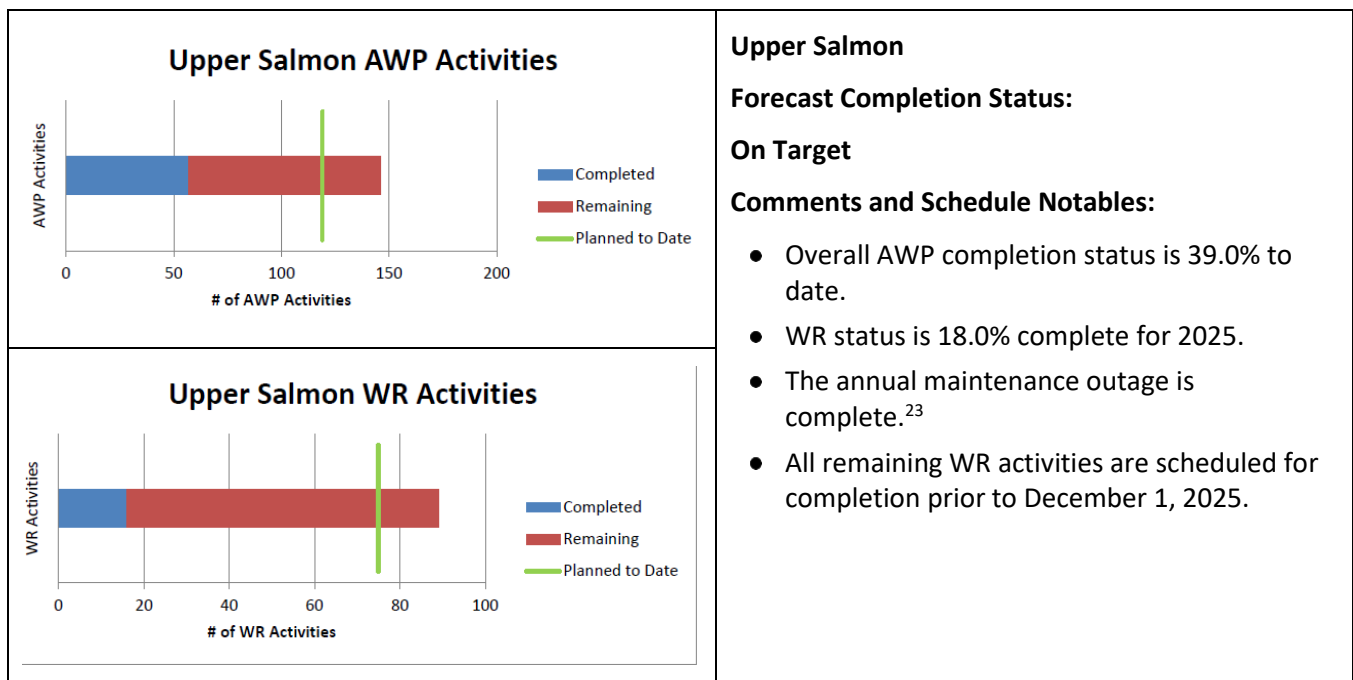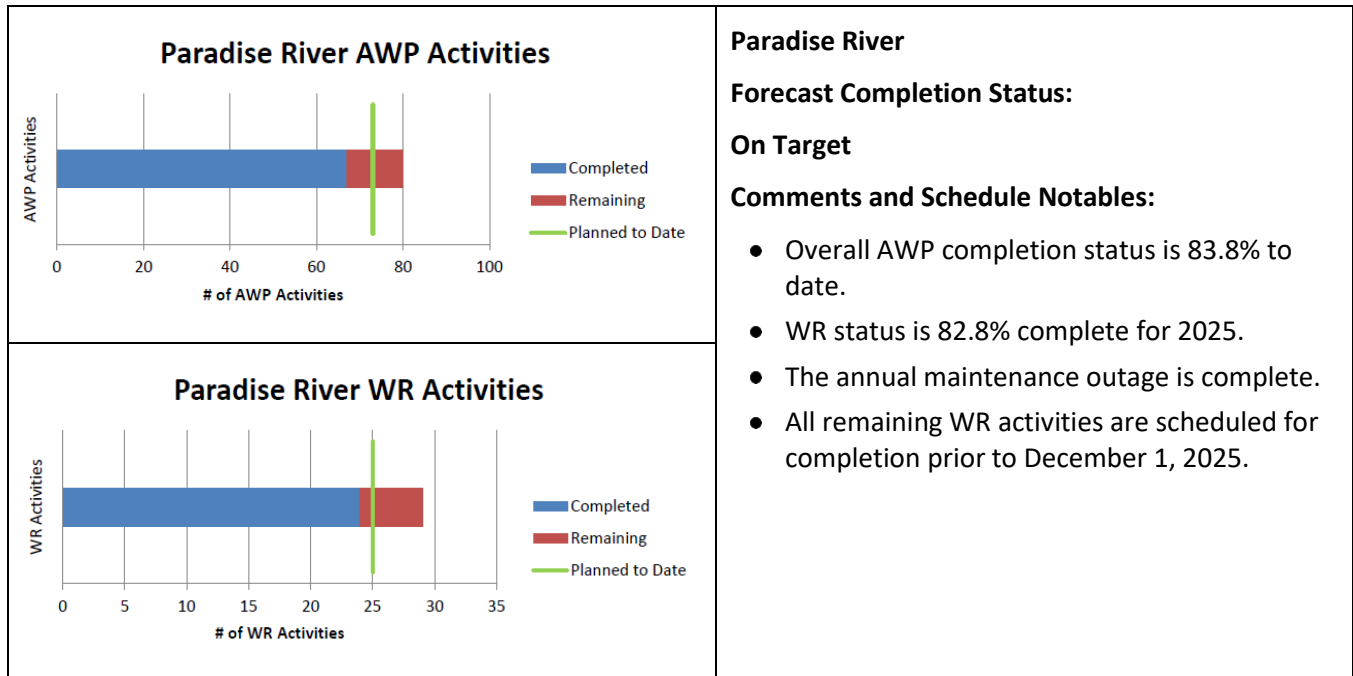

²³ Additional WR and AWP activities have been completed for this unit since the status charts data cutoff date of September 19, 2025; these will be reflected in the filing of the next 2025–2026 Winter Readiness Planning Report, scheduled for November 10, 2025.

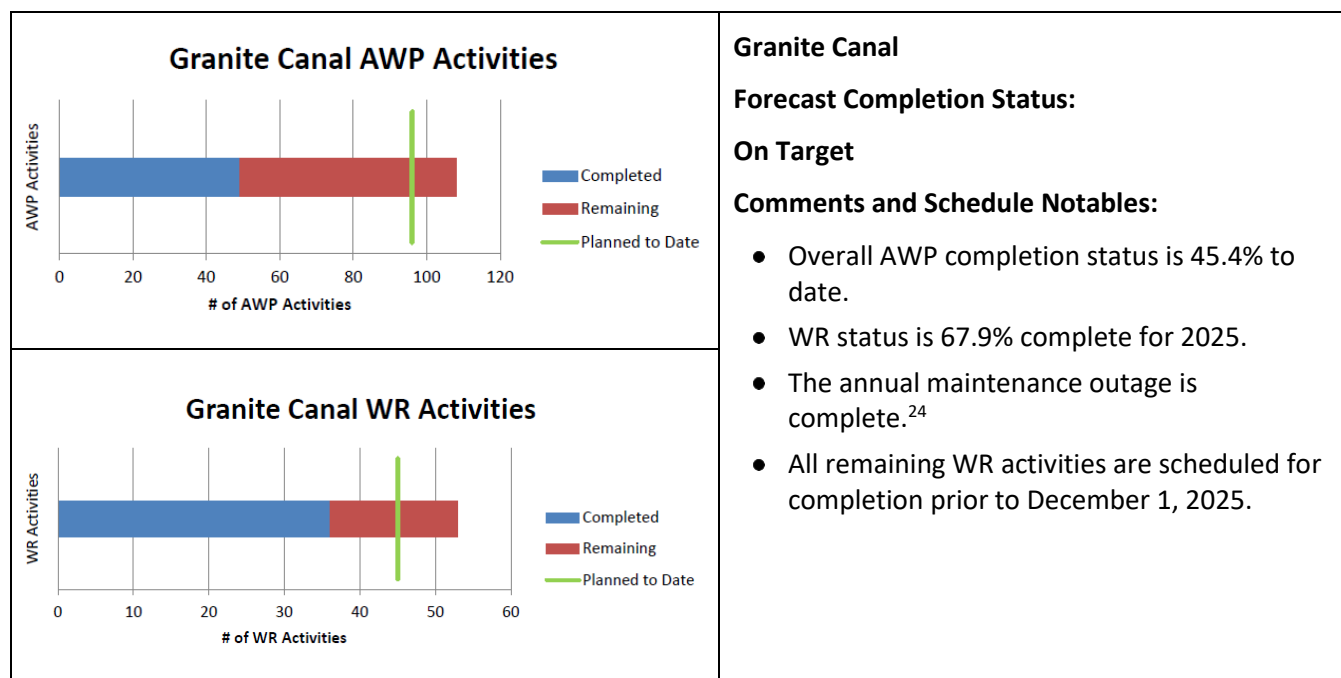

4.2 Critical Spares

- Table 3 provides an overview of the critical spares program for hydraulic generation and Appendix F contains detailed spares lists for the various facilities.

Table 3: Critical Spares for Hydraulic Generation

Status	Quantity
In Stock	1,227
Procurement Ongoing	1
Total	1,228

- The Upper Salmon T2 spare transformer remains outstanding but does not present a risk to WR.²⁵ This spare transformer was delivered to Upper Salmon in August 2021 from a factory in Turkey; however, the unit was not accepted by Hydro due to unit damage most likely caused by an impact event that occurred during shipping from the factory.²⁶ The transformer was returned to Turkey in 2022 to be repaired and

²⁴ Additional WR and AWP activities have been completed for this unit since the status charts data cutoff date of September 19, 2025; these will be reflected in the filing of the next 2025–2026 Winter Readiness Planning Report, scheduled for November 10, 2025.

²⁵ The existing transformer is in good condition. A failure of T2 would not impact available generation from Upper Salmon; it provides power to some upcountry structures for which there are other contingencies.

²⁶ The unit was initially shipped off site to a manufacturer-affiliated repair facility in the USA for inspection, testing and repair.

tested; however, challenges were encountered with the Factory Acceptance Testing throughout 2023 and 2024. Hydro continued to work with the supplier to expedite repairs and deliver the transformer back to Upper Salmon, with the transformer returned to site in late November 2024; however, on-site acceptance testing at Upper Salmon returned unfavourable results. Upon identifying the issues with the transformer after additional testing and troubleshooting in May 2025, repair plans were made and required materials ordered, with material lead times estimated to be six to ten weeks. Final repairs and testing for the transformer are planned for completion in the fourth quarter of 2025.

4.3 Plant and Equipment Testing

WR testing of generating equipment in hydraulic generation is focused primarily around annual unit maintenance outages. Following these annual outages, units are run up and synchronized and all systems are verified before the unit's operating status is determined and preparedness is confirmed. Unit load tests are also performed as system conditions permit. The WR testing protocol includes the testing of appropriate Balance of Plant components.

The status of equipment and plant testing for hydraulic generation is indicated in Appendix G. All inspection and testing of hydraulic generating facilities is scheduled for completion by December 1, 2025.

4.4 Risk and Risk Mitigation

Bay d'Espoir generation is expected to be fully available by December 1, 2025. Two risks to WR and/or reliable operations are identified in the sections that follow.

4.4.1 Bay d'Espoir Penstocks

As a result of previous ruptures of the Bay d'Espoir Penstocks, with the most recent being September 2019, Hydro decided to complete annual inspections of Bay d'Espoir Penstocks 1, 2, and 3 to monitor penstock condition and ensure reliability in the short-term. One notable change in 2025 is the removal of Bay d'Espoir Penstock 1 from the annual inspection program, since it is currently undergoing major capital investment to extend the reliable service life, which includes inspection activities.²⁷

²⁷ In Board Order No. P.U. 6(2023), Hydro received approval for the refurbishment of Penstock 1 at Bay d'Espoir in 2023, and the project is planned for completion in the fourth quarter of 2025.

Penstock 2 was inspected in May 2025; during the inspection, two new indications were discovered and repaired. As well, four indications discovered in 2024, which posed no material concerns at that time, were also repaired during the 2025 inspection.

The inspection of Penstock 3 is scheduled to commence in early November 2025, the results of which will be discussed in a subsequent 2025–2026 Winter Readiness Planning Report filing.

Although Hydro has mitigated the risk of penstock failure to the extent possible, there is residual risk that a failure could occur on Penstocks 2 or 3 before further life extension work is completed. Modifications remain in place, which are designed to limit the amount of rough zone operation, as well as a more prescriptive operating regime for Units 5 and 6 due to the results of annual inspections of Penstock 3 in recent years.²⁸ Hydro has estimated a 13- to 23-day repair timeline depending on circumstances, should a new failure occur, and has continued to take proactive measures to reduce generating unit downtime in the event of failure.

4.4.2 Hinds Lake Unit Vibration and Shaft Seal Leakage

The Hinds Lake unit is currently experiencing higher-than-normal vibration levels and shaft seal leakage rates, which has resulted in operational modifications until inspection and interventions are completed during the upcoming planned maintenance outage.²⁹ The annual outage for the Hinds Lake unit is scheduled to commence in October 2025, the results of which will be discussed in a subsequent 2025–2026 Winter Readiness Planning Report filing.

It is anticipated that the Hinds Lake Unit will be available at full capacity this coming winter. Hydro continues to monitor both issues, and to mitigate risk should concerns worsen, Hydro has proceeded with the procurement of bearing components and replacement parts for the shaft seal to ensure they are on hand in the event an outage is required. If unit condition does not worsen, Hydro intends to replace the procured parts during the planned 2026 overhaul.

²⁸ Under this operating regime, once dispatched, Units 5 and 6 are limited to a minimum loading of 50 MW and are not cycled or shut down as part of normal system operations. In previous years, operational modifications were in place on Penstock 1 (ie. Units 1 and 2); however, these modifications will no longer be required after capital investment is completed in 2025.

²⁹ Under this operating regime, once dispatched, the Hinds Lake Unit is fixed at 22 MW to reduce the impact of elevated vibration levels.

5.0 Muskrat Falls Assets

5.1 Annual Work Plan and Winter Readiness Status


The status of AWP and WR execution for the Muskrat Falls Assets is summarized in the following charts, including:

- Muskrat Falls Hydroelectric Generating Station (“Muskrat Falls”);
- Labrador-Island Link;
- Labrador Transmission Assets (“LTA”); and
- Soldiers Pond Synchronous Condensers (“SOP SC”).


LIL will be available for bipole operation up to 700 MW this winter. Subject to the completion of high-power testing, which Hydro continues to plan for execution in the fourth quarter of 2025, the LIL will be able to be operated up to 900 MW as system conditions permit.

As the Muskrat Falls assets are in early operation, and considering trends in the occurrence of break-in work, the timing and frequency of the OEM recommended PM activities, and the scheduling of maintenance resources are under review to determine an optimal AWP schedule.

Muskrat Falls Generating Station AWP Activities

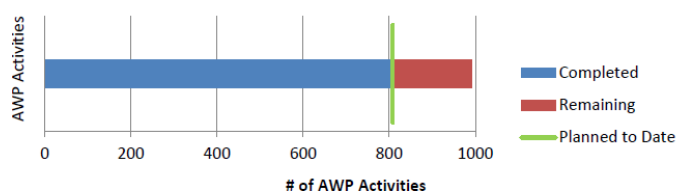

Muskrat Falls Generating Station WR Activities

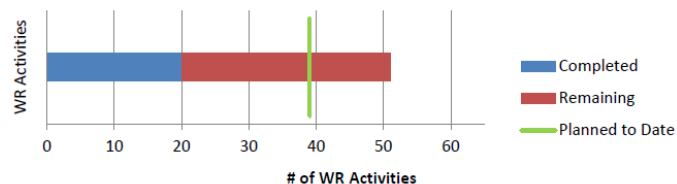


Muskrat Falls Generating Assets

Forecast Completion Status:
On Target


Comments and Schedule Notables:

- Overall AWP completion for Muskrat Falls Units 1 to 4 is 81.0% to date.³⁰
- WR status is 39.2% complete for 2025.³¹
- Annual maintenance outages on Units 2 and 3 have been completed.
- Unit 4 is currently offline on its planned outage, with return to service expected on October 29, 2025.
- The Unit 1 outage is scheduled from October 31 to November 24, 2025.
- All remaining WR activities are scheduled for completion prior to December 1, 2025.

LIL, LTA and SOP SC AWP Activities

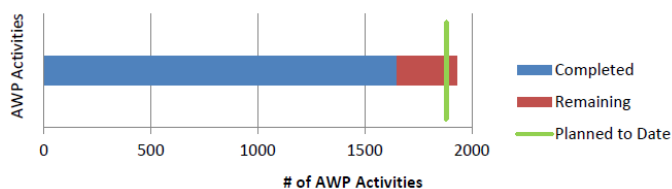

LIL, LTA and SOP SC WR Activities

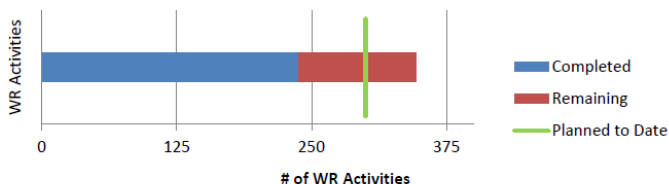

LIL, LTA and SOP SC

Forecast Completion Status:
On Target

Comments and Schedule Notables:

- Overall AWP completion for the LIL, LTA, and synchronous condensers at Soldiers Pond is 85.6% to date.³²
- WR status is 68.6% complete for 2025.³³
- All remaining WR activities are scheduled for completion prior to December 1, 2025.

³⁰ AWP activity status is as of August 29, 2025.

³¹ WR activity status is as of September 24, 2025. Completion of WR activities were delayed by the extension of the planned outage to repair the Unit 2 turbine runner.

³² AWP activity status is as of August 31, 2025.

³³ WR activity status is as of September 22, 2025.

5.2 Critical Spares

A significant fire in spring 2024 in the community of Happy Valley-Goose Bay resulted in the total loss of the storage facility housing Hydro’s Muskrat Falls generation critical spares. As a result, a significant effort has been undertaken to replenish the critical spares inventory, and Hydro has in stock over two-thirds of its critical spares. The remaining parts are at various steps within the procurement process.

Table 4 provides an overview of the critical spares program for Muskrat Falls generation and Appendix H contains a detailed spares list for the facility. Hydro has prioritized ordering of items based on WR, and continues to evaluate its identification of critical spares to set an appropriate target for the purpose of WR.

416 items are at various steps within the procurement process, with 407 items on order and nine items not yet on order. These nine items have been recently added to the critical spares inventory based on newly identified requirements, and are expected to be ordered prior to the next 2025–2026 Winter Readiness Planning Report, scheduled to be filed on November 10, 2025.

Table 4: Critical Spares for Muskrat Falls Generation

Status	Quantity
In Stock	1,021
Procurement Ongoing	416
Total	1,437

5.3 Plant and Equipment Testing

WR testing of generating equipment in hydraulic generation is focused primarily around annual unit maintenance outages. Following these annual outages, units are run up and synchronized and all systems are verified before the unit’s operating status is determined and preparedness is confirmed. Unit load tests are also performed as system conditions permit. The WR testing protocol includes the testing of appropriate Balance of Plant components.

The status of equipment and plant testing for Muskrat Falls generating assets is indicated in Appendix I. All inspection and testing of hydraulic generating facilities is expected to be complete by December 1, 2025.

5.4 Risk and Risk Mitigation

All Muskrat Falls assets are expected to be fully available by December 1, 2025. Existing risk to WR and/or reliable operations related to these assets is discussed in the sections that follow.

5.4.1 Muskrat Falls Unit 1 Intake – Concrete Spalling

During the 2024 planned annual outage to Unit 1, concrete debris was observed in the turbine scroll case. Further inspection indicated some scuffing on the wicket gate lower operating ring caused by the passage of this debris through the turbine, which has since been repaired. This damage did not affect the unit's output or availability.

Remote operated vehicle inspection of the intake civil works identified an area where concrete had cracked and dislodged. In October 2024, a specialized team assessed the condition of the remaining concrete in the area where spalling had been observed. Upon completion of further concrete cutting and removal, sounding of the entire Intake Bay 3 lintel beam was completed with no further areas identified for remedial action. Unit 1 was returned to service on October 16, 2024, with a final repair to the intake civil works planned during the 2025 annual outage.

Due to the unforeseen extension of the planned outage to repair the Muskrat Falls Unit 2 turbine runner, there will be insufficient time to complete final repairs on the Unit 1 intake structures in 2025. The annual maintenance outage for Unit 1 in 2026 will have time allotted to complete the repairs.

To mitigate risk should a similar incident occur this coming winter, Hydro has a response plan in place, and has proceeded with the procurement of required materials to ensure they are on hand in the event a repair is required.

5.4.2 Optical Ground Wires Tower Peak and Top Plate Design

Since 2022, several incidents of damage to the optical ground wires ("OPGW") tower peaks occurred in heavy ice loading conditions, and there were two failures at the connection of the OPGW top plate during an icing event on the line in December 2022. The incidents involving these tower components did not cause a prolonged LIL outage; however, brief outages were required to repair the damage.³⁴

³⁴ As the OPGW relates to communications functionality, Hydro does not anticipate that further occurrences of similar damage would result in a prolonged power interruption or customer outage.

As a result, a new design to reinforce tower peaks and replace the impacted top plates has been completed. Installation work to rectify the tower peaks and two remaining top plates is expected to begin in 2026 with expected completion in 2028.³⁵ To mitigate risk to near-term reliability, Hydro has its Emergency Response Plan in place, and has proceeded with the procurement of required materials to ensure they are on hand in the event a repair is required.

5.4.3 Electrode Conductors

During December 2022, March 2024, and January 2025 there were issues with the electrode conductor during significant ice loading, the root cause of which was determined to be overloading due to ice and ice shedding.

Three alternative suspension clamp designs were installed on the electrode conductor at ten structures, and will be inspected yearly for performance. An assessment of the electrode suspension assembly and a re-design of the assembly was completed in 2025. Additional conductor testing has been completed from these incidents, with further recommendations expected from the most recent investigation report once complete.

To mitigate risk to near-term reliability, Hydro has its Emergency Response Plan in place, and has proceeded with the procurement of required materials to ensure they are on hand in the event a repair is required.

5.4.4 DCCT Cold Weather Operation

In 2023, the OEM and Hydro determined that extremely low air temperatures were influencing the measurement accuracy of some Direct Current Current Transformers (“DCCT”), resulting in false protection trips and power control issues on the LIL. The OEM identified the root cause of the issue to be a manufacturing defect with the Delay Coil Fiber Optical Cable located within the DCCTs; this issue occurred with a select batch of fiber optic cables, affecting six DCCTs at the Muskrat Falls HVdc Converter Station, which have since been replaced.³⁶

³⁵ Analysis confirmed that 63 towers across two tower types (A3 and A4) were identified to have top plates replaced; as of the end of 2024, 61 of 63 were replaced, which represents all A3 towers. The two remaining top plates are on A4 tower types.

³⁶ One of these DCCTs has an operation rating to -40°C, and will be replaced with a DCCT rated to -50°C as soon as is practical.

The OEM has since identified additional DCCTs that could potentially be affected by this issue, and as a precautionary measure, is preparing a plan to replace these as well. While these additional DCCTs have a low risk of the issues materializing, Hydro will continue to work with the OEM to ensure proper mitigation.

5.4.5 Synchronous Condenser Brush Gear Assemblies

Brush equipment performance on the Soldiers Pond synchronous condensers decreased in December 2023, resulting in several scheduled outages to replace damaged brushes, springs and brush holders.

Hydro, in consultation with the OEMs for the brush equipment and the synchronous condensers, has been working to identify the root cause of the brush performance issues. Hydro has continued with the modified brush configurations and operational controls to ensure optimal operating conditions for patina development. These changes have had positive results with regards to brush performance in 2025.


In spring 2024, the existing slip ring was removed from synchronous condenser 1 (“SC1”), and sent for machining to correct a runout causing excessive brush vibration. At this time, a modified brush with the ability to operate in a higher vibration environment was also provided by the OEM and installed. These modifications have resulted in improved performance to date. Hydro will continue to monitor the overall impact of these changes, with the potential to complete this work on SC2 and SC3 in 2025.



General Electric (“GE”) has been working with a different brushgear manufacturer; however, given the positive brush gear performance in 2025, both GE and Hydro recommended not changing the design at this time. As performance of a new brush and holder is unknown until they are installed and tested, the recommendation is to continue to operate under the existing design. GE has provided Hydro with operational limits based on the number of brushes installed per ring to help maintain patina film. Corrective actions on SC1 have yielded positive results, and changes performed in 2024 have aided in achieving acceptable brush performance across all three synchronous condensers.


6.0 Transmission and Terminal Stations

6.1 Annual Work Plan and Winter Readiness Status

The status of AWP and WR execution for transmission line and terminal station facilities on both the Island Interconnected System and the Labrador Interconnected System is summarized in the following charts. All planned WR activities are scheduled for completion by December 1, 2025.

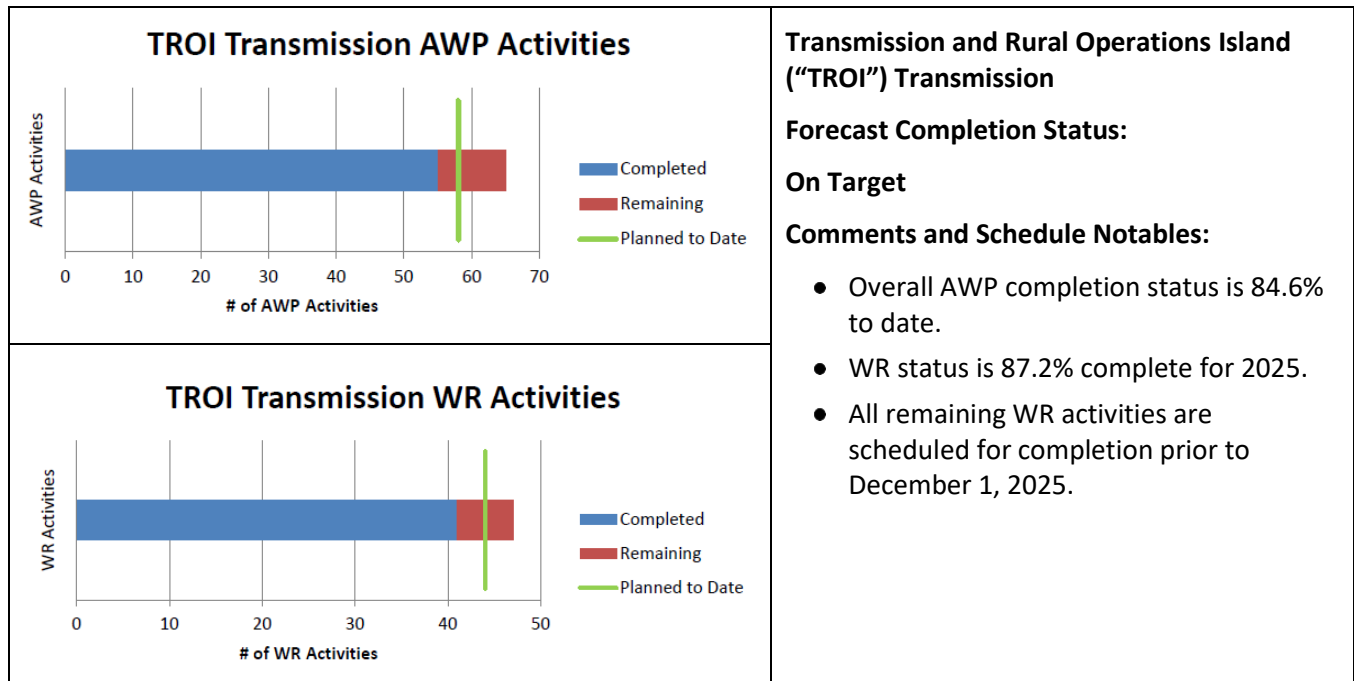

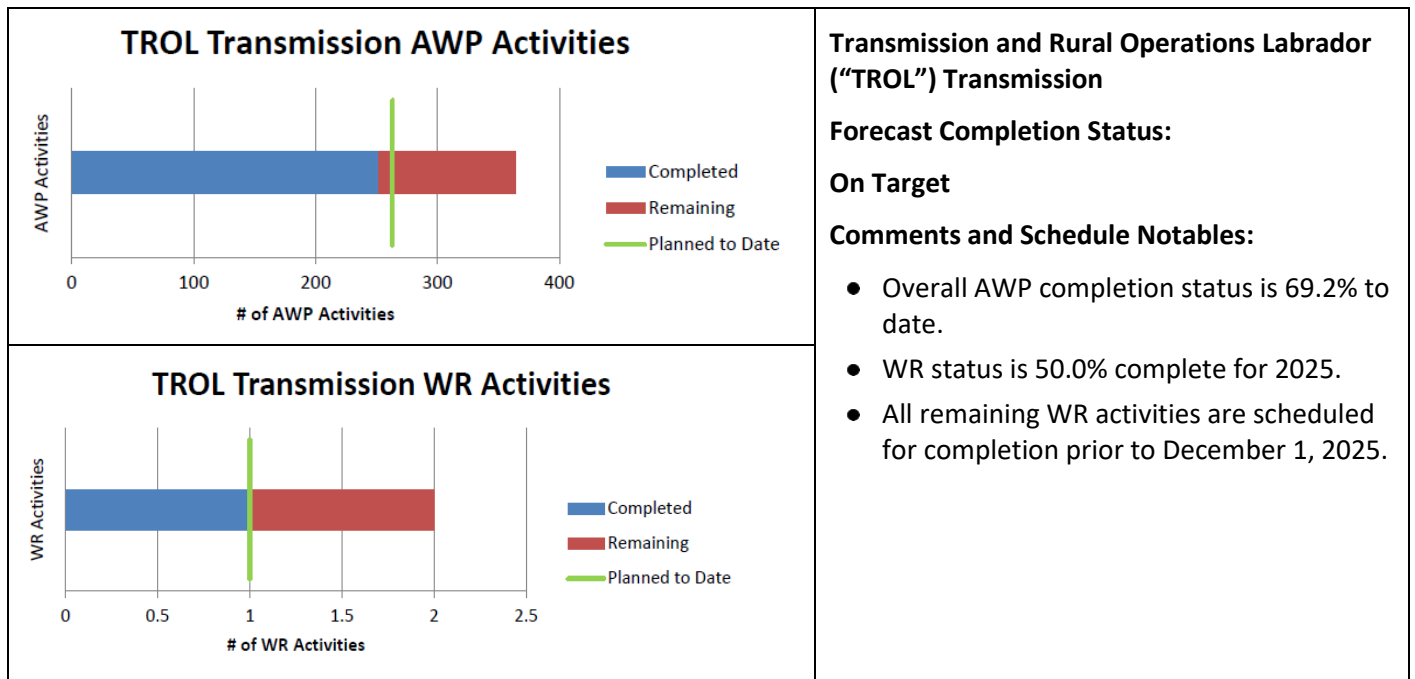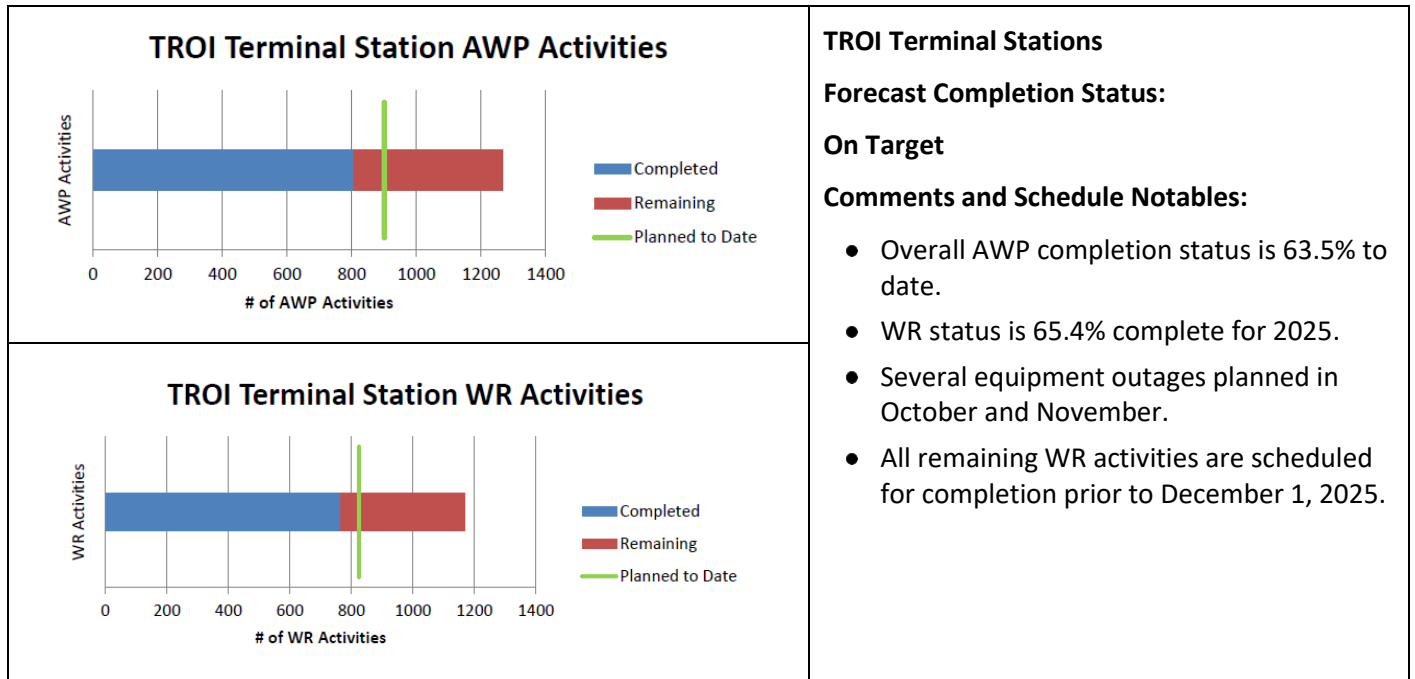

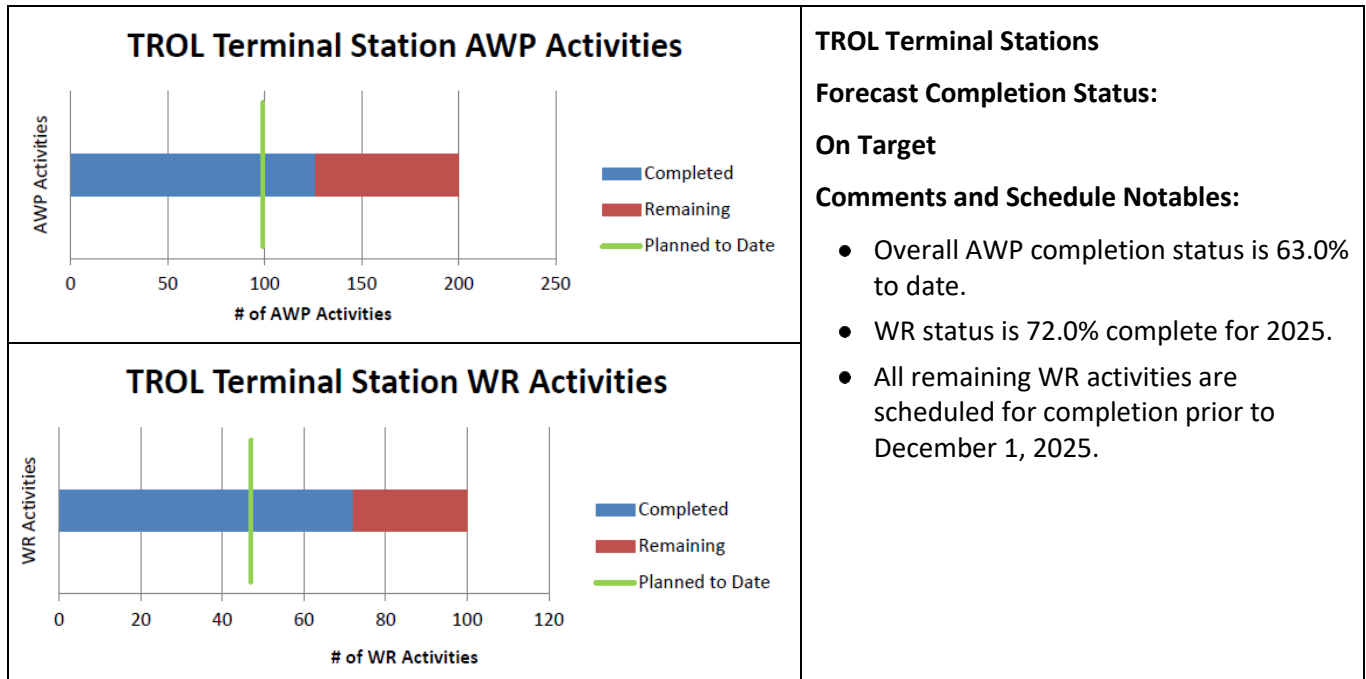

6.2 Plant and Equipment Testing

The AWP for both transmission and terminal stations are predominantly comprised of PMs and CMs, which inherently involve inspection and testing.³⁷ Examples of WR activities that are included in the AWP work scopes include the following:

- Transformer PMs and CMs;
- Annual exercises on all high-voltage circuit breakers;
- Exercise of 230 kV circuit breakers from protection during PM inspections;
- Infrared scans at all terminal stations;
- Annual ultrasonic leak testing on all terminal station air systems; and
- Annual helicopter patrol of transmission lines prior to the winter season.

³⁷ The “Terminal Station Asset Management Strategy – 2025 Update” document outlines the maintenance, refurbishment, and replacement criteria used by Hydro for terminal station assets. For the most recent report please refer to the “2026 Capital Budget Application,” Newfoundland and Labrador Hydro, July 15, 2025, sch. 1, app. F.

6.3 Risk and Risk Mitigation

Existing risk to WR and/or reliable operations related to Hydro’s Transmission and Terminal Station assets are discussed in the sections that follow.

6.3.1 Generator Step-Up Transformer Spares

Generator Step-Up Transformer 6 was repaired by the OEM in January 2024 following its failure in July 2023, and is available for use as a spare at Bay d’Espoir, Granite Canal, or Upper Salmon.³⁸

Hydro does not currently have a spare for the Holyrood TGS generator step-up transformers, and is in the process of procuring a spare.³⁹ This spare is not expected to be delivered until the third quarter of 2028 due to increasing power transformer lead times.

6.3.2 Western Avalon Terminal Station – Replace Bushing Connecting the Gas Insulated Switchgear to Transmission Line TL267

The Western Avalon Terminal Station C phase bushing connecting the gas insulated switchgear to Transmission Line TL267 experienced a failed top terminal seal in July 2023. Leakage of its SF₆ insulating gas was stopped using a temporary seal of a metal repair composite material. While this temporary seal has been effective since its implementation in October 2023, if the leak was to reoccur prior to receiving the replacement bushing, it can be repaired through a short outage to TL267.

Hydro placed an order with the supplier in March 2024 and expected to receive the bushings in time for 2025 installation; however, the order was not properly processed by the supplier. This error has since been corrected and the new expected delivery date is September 2026. Once received, Hydro plans to install the bushings in 2026 when system conditions allow. To mitigate the risk of failure prior to the completion of the bushing replacement work, Hydro performs regular visual inspections, and will apply additional repair material as necessary.

³⁸ Cat Arm also has a spare on site; however, the spare can only be used at that facility due to the connection to the Gas Insulated Switchgear (“GIS”) at that location.


³⁹ “Purchase Spare Generator Step-Up Transformer,” Newfoundland and Labrador Hydro, September 21, 2023, approved in Board Order No. P.U. 28(2023).

7.0 Operational Technology

7.1 Annual Work Plan and Winter Readiness Status

The status of AWP and WR execution for Operational Technology is summarized in the following charts.

All planned WR activities are scheduled for completion by December 1, 2025.

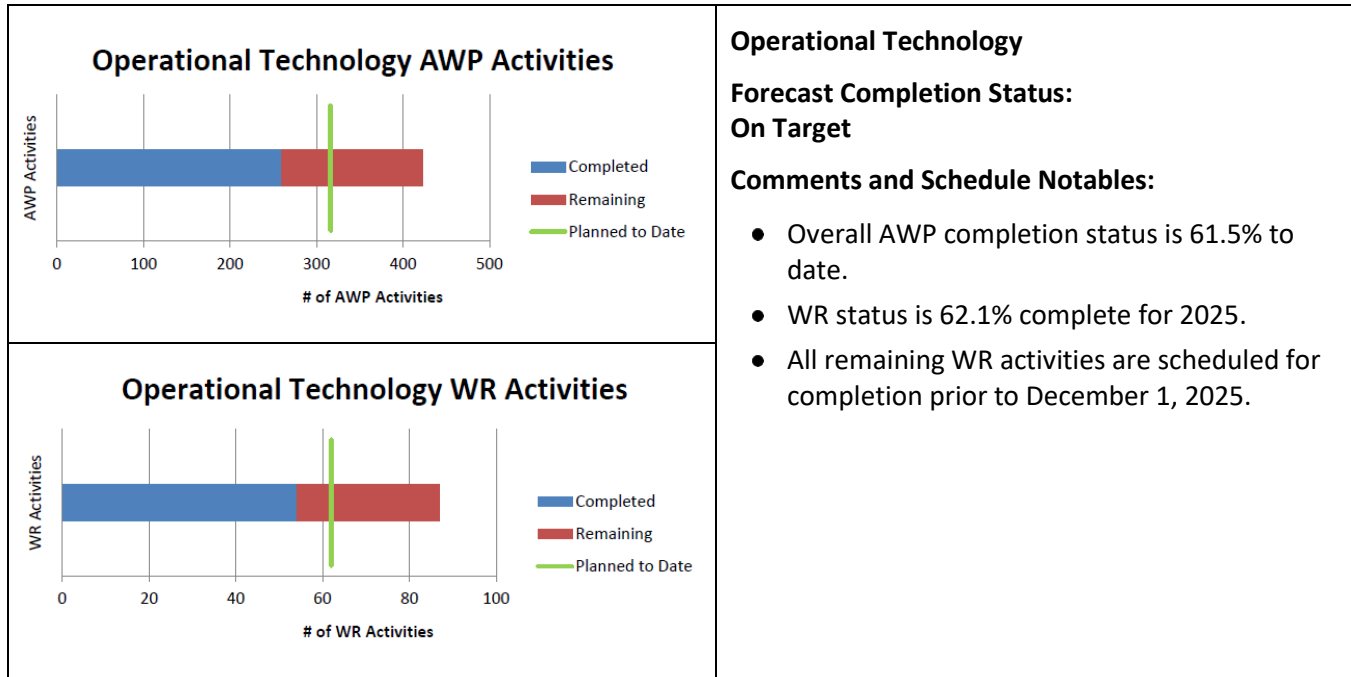

7.2 Plant and Equipment Testing

The AWP for Operational Technology is comprised of PMs and CMs, which inherently involve inspection and testing of various assets and systems. Examples of WR activities that are included in the AWP work scopes include the following:

- Annual Preventative Maintenance on all 48V battery banks; and
- Replenish nitrogen and generator fuel reserves at all microwave repeater sites.

8.0 Status of Winter Readiness for Capital Projects and Programs

The status of 2025 planned capital project and program scopes of work related to 2025–2026 WR for the Island Interconnected System and the Labrador Interconnected System are provided in Appendix A.

Table 5 summarizes the status of the WR scope of these projects and programs by asset category. A

- 1 discussion of the risk and risk mitigation associated with each capital project and program expected to
 2 be completed after December 1, 2025 has been provided within the sections above by operating area.

Table 5: Status of Planned Capital Projects and Programs with WR Scope

Asset Category	Complete as of September 19, 2025	Incomplete, Expected Completion before December 1, 2025	Incomplete, Expected Completion after December 1, 2025	Total
Regulated Hydraulic Generation	-	2	-	2
Regulated Thermal Generation	2	2	2	6
Regulated Terminal Stations	2	1	-	3
Muskrat Falls Generation Assets ⁴⁰	-	-	-	-
Muskrat Falls Transmission Assets ⁴¹	1	-	-	1
Total	5	5	2	12

- 3 As of September 19, 2025, the WR scope for five of the twelve planned capital projects and programs
 4 are complete. WR scope for an additional five projects and programs is expected to be completed by
 5 December 1, 2025. A portion of the WR scope within two projects and programs is expected to be
 6 completed after December 1, 2025, including:

- 7 • Overhaul Turbine and Valves – Unit 3 (2025) – Holyrood
- 8 • Perform Level 2 Condition Assessment Stage 1 & 2 Cooling Water Sump Structures (2025) –
 9 Holyrood

- 10 In addition to the planned scopes of work required for WR, Hydro is executing one unplanned scope
 11 under the Terminal Stations In-Service Failures Program that is expected to be completed after
 12 December 1, 2025:

- 13 • Western Avalon Terminal Station – Replace Gas Insulated Switchgear TL267 Phase C Wall
 14 Bushing

15 9.0 System Energy Capability

- 16 In order to reliably serve customers, Hydro maintains minimum limits for aggregate energy storage in its
 17 major hydroelectric reservoirs on the Island Interconnected System. These limits are developed annually

⁴⁰ There are currently no capital projects or programs that will impact 2025–2026 WR for Muskrat Falls Generation Assets.

⁴¹ The Muskrat Falls Transmission assets include the LIL, LTA, and SOP SC.

to ensure that Hydro is capable of meeting customer demands throughout the year in the event of a repeat of Hydro’s critical dry sequence.⁴² The limits are established such that Hydro will have sufficient hydraulic storage to be able to meet load in this critical sequence, or another less severe sequence, through the use of Island hydraulic production supplemented with maximized deliveries of energy to the Island from Labrador over the LIL. This includes energy from Muskrat Falls as well as recapture energy available to Hydro from the Churchill Falls Hydroelectric Generating Station.

The established limits assume that two Holyrood TGS units will be online, operating at minimum output (70 MW) during winter 2025–2026, and do not include the use of standby thermal generation to support reservoir storage, or the third unit at Holyrood TGS. The minimum storage methodology ensures Hydro’s reservoirs can continue to provide reliable least-cost service to customers in an environmentally responsible manner by supporting Island load with hydroelectric energy instead of thermal energy to the extent possible.⁴³

Since May 2025, Hydro’s Island reservoirs have experienced persistent below average inflows, as reported in Hydro’s Monthly Energy Supply reports. The entirety of the island portion of the province has experienced some level of drought conditions throughout the summer. The portions of the province where Hydro’s reservoirs are located have experienced moderate drought conditions as of the end of August as reflected in Environment and Climate Change Canada Quarterly Climate Summary for summer 2025. Overall inflows to the reservoirs of the Island Interconnected System were 62% below the historical average from May 2025 to September 2025.

Since mid-May, Island system storage has steadily declined due to ongoing low inflows. As of September 30, 2025, aggregate reservoir storage was 1,194 GWh, which is 49% of the maximum operating level and 97% of (approximately 32 GWh below) the minimum storage limit. Figure 1 plots the 2024 and 2025 storage levels, minimum storage limits, maximum operating level storage, and the 20-year average aggregate storage for comparison. Please note that the minimum storage limits for 2025–2026 have been updated as of September 30, 2025 utilizing the LIL transmission limits associated with

⁴² Hydro’s long-term critical dry sequence is defined as January 1959 to March 1962 (39 months). Other dry periods are also considered during this analysis to ensure that no other shorter-term historic dry sequence could result in insufficient storage.

⁴³ The limits also do not consider the availability of imports over the Maritime Link, though imports can provide an additional opportunity to supplement storage and economically reduce the amount of thermal generation required to maintain sufficient energy in storage in the event that import opportunities arise.

1 the “full” or final under-frequency load shedding (“UFLS”) scheme as opposed to the previously
 2 presented and “interim” UFLS scheme, as work is ongoing with Newfoundland Power to implement the
 3 final UFLS scheme this fall. The final UFLS scheme allows for incrementally more LIL energy to be
 4 brought to the Island without conversely needing to export more energy over the Maritime Link export
 5 path. This resulted in a small adjustment downwards of the monthly minimum storage limits.

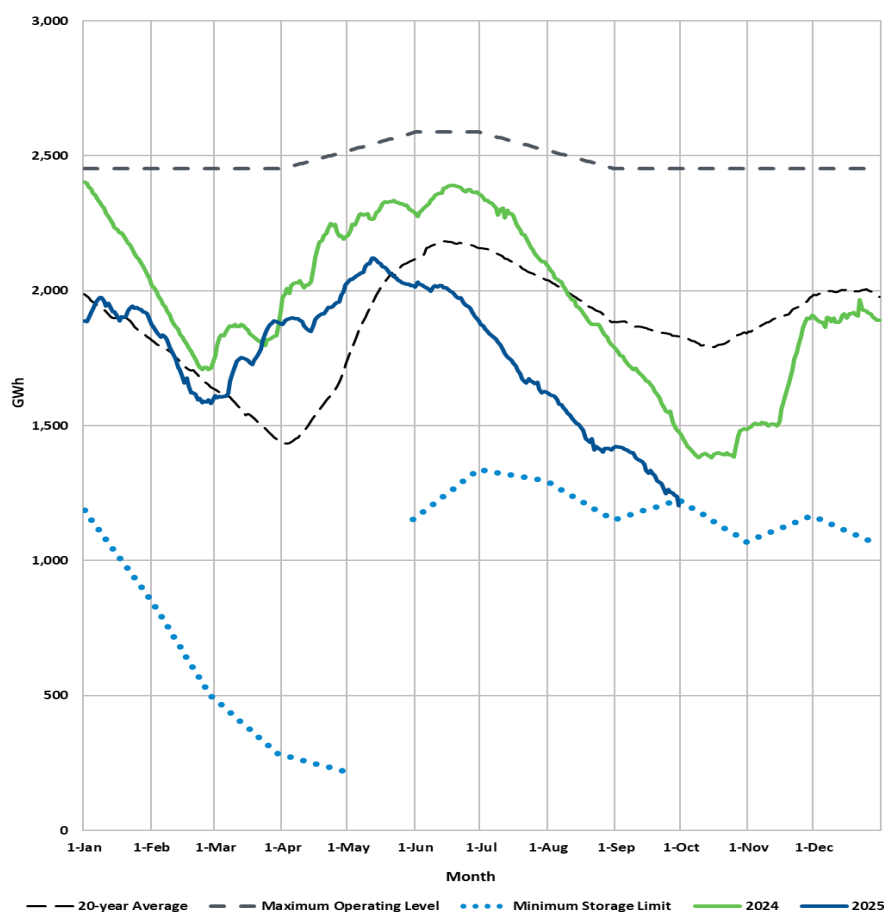


Figure 1: Total System Energy Storage⁴⁴

6 To slow the decline of system storage, Hydro engaged Energy Marketing to seek imports over the
 7 Maritime Link to supplement reservoir storage while the LIL was on a planned bipole outage. Imports
 8 were authorized starting on September 21, 2025 and concluded on September 30, 2025 when the LIL

⁴⁴ Data points in Figure 1 represent storage at the beginning of each day. The body of the report text reports the end-of-day storage value, which results in a small difference between the storage data presented in the text and Figure 1.

returned to service in monopole mode. Approximately 20.4 GWh of non-firm energy was imported to the Island during this period. Deliveries of energy to the Island Interconnected System from Labrador via the LIL are also being maximized to the extent possible to support Island reservoir storage. Hydro has implemented “Economic Monopole Operation” when system conditions permit, which allows for additional energy delivery to the Island during monopole operation. While this mode of operation inherently introduces a risk of Under-Frequency Load Shedding in the event of a trip, the customer impact is limited to the 58.4 Hz block, and customers are quickly restored. This mode of operation balances energy delivery and economic operation with reliability. Exports from Island sources have been placed on hold since July 2025.

On October 1, 2025, Hydro entered into a third six-month power purchase agreement with Corner Brook Pulp and Paper Limited (“CBPP”) as directed by the Government of Newfoundland and Labrador. The power purchase agreement with CBPP provides Hydro with 80 GWh of non-firm energy from October 1, 2025 through March 31, 2026 inclusive.

Currently, the Exploits firm capacity is derated to conserve reservoir storage. This is subject to change as precipitation events occur and inflows into the reservoir increase. Hydro is also currently assessing the opportunity for additional Maritime Link imports once the LIL returns to bipole operation in mid-October.

Hydro will continue to closely monitor Island storage and inflows at both the overall system and the individual reservoir levels to ensure its hydroelectric assets can operate through the winter season at full rated output. At this time, the use of standby generation is not deemed to be required to support reservoir storage.

10.0 Conclusion

Hydro is confident in its ability to serve its customers during the 2025–2026 winter season, and is progressing towards completion of its AWP and WR activities. Hydro’s critical spares status leading into the 2025–2026 winter season is strong. For Holyrood TGS, CTs, and hydraulic generation, 2,533 critical spares have been identified by Hydro’s three generation operations areas. Of this total, 2,502 items are in stock (>98%) and 31 items are in the procurement process.

1 Additionally, for the Muskrat Falls generation assets, 1,437 critical spares have been identified; 1,021
2 items are in stock and 416 items are in the procurement process. As previously reported, a significant
3 fire this spring in the community of Happy Valley-Goose Bay resulted in the total loss of the storage
4 facility housing Hydro's Muskrat Falls generation critical spares.

5 Hydro anticipates the full availability of generating sources by December 1, 2025, with the exception of
6 Unit 3 at the Holyrood TGS. Unit 3's return to service is extended to mid-January 2026 due to the
7 additional work required to refurbish the steam turbine rotor during the Overhaul Turbine and Valves
8 Program. Due to a period of low inflows in its reservoirs, Hydro continues to utilize its portfolio of assets
9 to manage reservoir levels. Hydro will continue to monitor progress and mitigate work execution and
10 operational risks.

11 Hydro will continue to monitor the risks to WR and provide a further update in its next 2025–2026
12 Winter Readiness Planning Report, to be filed on November 10, 2025.

Appendix A

Status of Capital Projects and Programs Related to Winter Readiness





**Status of Planned Winter Readiness Scope
in 2025 Capital Projects and Programs
on the Island and Labrador Interconnected Systems**

Asset Category	Project or Program Title	Expected Completion of Winter Readiness Scope (30-Sep-2025 Update)
Regulated Hydraulic Generation	Bay d'Espoir - Refurbish Intake 1 (2024-2025)	12-Nov-2025
	Bay d'Espoir - Overhaul Hydraulic Units (2025)	28-Nov-2025
Regulated Thermal Generation	Holyrood - Upgrade Unit 1 Control System (2024-2025)	Complete
	Holyrood - Overhaul Unit 1 Turbine Valves and Generator (2024)	Complete
	Holyrood - Overhaul Major Pumps (2025)	28-Nov-2025
	Holyrood - Perform Boiler Condition Assessment and Miscellaneous Upgrades (2025)	28-Nov-2025
	Holyrood - Perform Level 2 Condition Assessment – Stage 1 & 2 Cooling Water Sump Structures (2025)	17-Dec-2025
	Holyrood - Overhaul Turbine and Valves - Unit 3 (2025)	18-Jan-2026
Regulated Terminal Stations	Various Locations - Replace Terminal Station Battery Banks and Chargers (2024-2025)	Complete
	Wabush - Perform Major Inspection – Synchronous Condenser 2 (2025–2026)	Complete
	Various Locations - Upgrade Power Transformers (2024-2025)	21-Nov-2025
Muskrat Falls Transmission Assets	Various Locations – Replace Turnbuckles and Install Airflow Spoilers	Complete

Appendix B

Master Generation Outage Schedule



2025 Generation Outage Schedule ¹																						
Location	Asset	Month Week Starting Capacity (MW)	September					October					November					December				Scheduled Annual Maintenance Outages
			1	7	14	21	28	5	12	19	26	2	9	16	23	30	7	14	21	28		
Holyrood	G1 ²	170.0																				
	G2	170.0																			May 4 to September 17	
	G3	150.0																			June 8 to October 13	
	GT	123.5																			March 30, 2025 to January 18, 2026	
	G1	76.5																			October 14 to 25	
Bay d'Espoir	G2	76.5																			March 31 to November 30	
	G3	76.5																			March 31 to November 30	
	G4	76.5																			November 2 to 14	
	G5	76.5																			November 2 to 14	
	G6	76.5																			October 12 to 31	
Upper Salmon	G7	154.4																			October 12 to 31	
	Unit	84.0																			November 2 to 14	
	Granite Canal	40.0																			November 2 to 14	
	Unit	75.0																			October 12 to 31	
	Hinds Lake	67.0																			October 26 to November 21	
Caf. Arm	G1	67.0																				
	G2	67.0																				
	Unit	8.0																				
	Paradise River	50.0																				
	Hardwoods	50.0																				
Stephenville	GT	50.0																			November 25 to December 2	
	Unit	18.0																			September 2 to 12	
	Star Lake	Unit																			September 8 to October 24	
	Units	63.0																				
	CBPP	8.0																				
Hawkes Bay, Holyrood, St. Anthony	CBPP	8.0																				
	Diesels ⁴	24.7																				
	Hydro & Standby ⁵	119.3																				
	Newfoundland Power	99.1																				
	CBPP 60 Hz	99.1																				
Available Island Capacity ⁶			1,279.0	1,261.0	1,311.0	1,401.1	1,571.1	1,571.1	1,363.2	1,363.2	1,429.7	1,431.1	1,431.1	1,584.1	1,609.1	1,609.1	1,850.0	1,850.0	2,000.0	2,000.0		
Maximum ILL Contribution to Island Reserves at Peak ^{7a}			306.7	316.3	15.0	0.0	0.0	15.0	366.1	366.1	372.5	386.2	392.6	397.9	421.2	437.1	462.6	462.6	462.6	462.6		
Forecasted Gross Island Peak Load			937.0	965.0	1008.7	1044.5	1088.3	1187.6	1239.3	1291.1	1334.8	1440.2	1490.7	1541.2	1591.7	1591.7	1732.1	1732.1	1732.1	1732.1		
Total Island Reserves ¹⁰			698.7	662.3	367.3	406.6	532.8	448.5	540.0	488.2	517.4	377.1	433.0	540.8	538.6	554.5	680.5	680.5	830.5	830.5		
Largest Operating Unit			154.4	154.4	154.4	154.4	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0	170.0		
Island N-1 Reserves			544.3	507.9	212.9	252.2	362.8	278.5	370.0	318.2	347.4	207.1	263.0	370.8	368.6	384.5	510.5	510.5	660.5	660.5		
Labrador Island Link																					P1 outage Sept 15-21; Bipole outage Sept 21-30; P2 outage Oct 1-14	
Happy Valley																					To Be Determined	
																					October 31 to November 24	
Muskat Falls																					August 28 to September 28	
																					October 1 to 29	

Legend			
Available	Unavailable	Derated	Unplanned/Extension
White	Dark Blue	Light Blue	Grey

¹ Preventive maintenance items that require short duration outages are not reflected. They are planned in conjunction with system operation for an appropriate time.
² Holyrood G1 derated to 100 MW due to issue with the main steam control valve sticking. Holyrood G1 will be taken offline to complete repairs after Holyrood G2 has returned to service after completion of scheduled maintenance.
³ Corner Brook Pulp and Paper Limited ("CBPP").
⁴ 24.7 MW includes Hawkes Bay (5 MW), Holyrood Diesel (10 MW), and St. Anthony (9.7 MW).
⁵ 119.3 MW includes Newfoundland Power Hydro (77.8 MW) and Newfoundland Power Standby (41.5 MW).
⁶ Available Island Capacity only includes Island Resources and does not include any contribution from Soldiers Pond, Labrador Island Link, Happy Valley or Muskrat Falls Units.
⁷ Maximum ILL contribution to island reserves at peak is a function of island load, ILL operating mode, number of available Muskrat Falls units and Maritime Link exports, and is measured at Soldier's Pond.
⁸ NL Hydro has the option to use the ILL economic limits during a monopole outage, which would increase the "Maximum ILL Contribution to Island Reserves at Peak."
⁹ September and October Total Island Reserves include CBPP Capacity Assistance (50 MW).
¹⁰ November and December Total Island Reserves include CBPP Capacity Assistance (90 MW) and System Voltage Reduction (20 MW).

Appendix C

Critical Spares Status Listing for Thermal Generation



Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Fire Protection System	Electrical Driven Pump	Pump	Inboard Bearing		BEARING,PEERLESS INBOARD	In Stock
	Electrical Driven Pump	Pump	Outboard Bearing		BEARING,PEERLESS OUTBOARD	In Stock
	Electrical Driven Pump	Pump	Casing Ring		RING,PEERLESS CASING	In Stock
	Electrical Driven Pump	Pump	Casing Gasket		GASKET,PEERLESS CASING	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping	Valves	Day Tank Trip Valve	8" Butterfly Valve and Actuator		VALVE,BTFY 8" 150#	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping		Day Tank Trip Valve	Actuator		ACTUATOR,BETTIS CB520	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping		Fuel Line Block Valve	16" Gate Valve		VALVE,GATE 16" NEWCO	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping		Day Tank Fill Line Control valve	6" Control Valve		VALVE,CONTROL 6" FISHER	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping			Actuator		ACTUATOR,PNEU 1-BSW-5-LT	In Stock
Hydrogen Generation and Storage	Valves	Motorized Valves	1/2 " Valve		SOLENOID,VALVE ASCO 8316	In Stock
Hydrogen Generation and Storage	Tubing		Tubing		TUBING,SS 1" OD X.083 316	In Stock
Powerhouse and Switchyard Single Line	129V DC System	Charger	Control Unit		CONTROL UNIT,BATTERY CHG 129V	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2205C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2206C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3205C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3206C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2203C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2207C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2202C		VALVE,ITT	In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Cation Valve - KV2208C		VALVE,ITT	In Stock



Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare		
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3203C		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3207C		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3202C		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Anion Valve - KV3208C		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4003B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4004A		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4005B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4006B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4007B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4008B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4009B		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4010A		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - KV4011A		VALVE,ITT In Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Mixed Bed Valve - PCV4071	Non-Stock is OK since there are non critical uses for this TX which can be "borrowed)	VALVE,PRESS REGULATING Non-Stock
Raw and Makeup Water System & Water Treatment Plant	Demineralization System	Instrumentation/Controls	Sodium Monitor	Non-Stock is OK since there are non critical uses for this TX which can be "borrowed)	ANALYZER,ORION 2111LEN Procurement Ongoing
Raw and Makeup Water System & Water Treatment Plant	Clarifier	Agitator	Frequency Drive		CONTROLLER,SPEED CLARIFIER In Stock
Raw and Makeup Water System & Water Treatment Plant	Clarifier	Agitator	Recirculator - Double Induction Speed Reducer - In Stock		RECIRCULATOR,STERLIN G 9A6108 In Stock
Raw and Makeup Water System & Water Treatment Plant	Clearwell	Clearwell Pump	Pump, single stage, 750GPM	Critical repair parts stocked for this pump. No need to stock the entire pump.	PUMP ASSY,KSB 6" Non-Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping		Dock Quick Closing Valves	18" Butterfly Valve		VALVE,BTFY 18" 150#	In Stock
Fuel Oil Delivery System Aux. Steam & Fuel Oil Piping		Dock Capstan	Gear Box		CAPSTAN GEARBOX,SADI	In Stock
Fire Protection System	Electrical Driven Pump	Control Panel	Fire Pump Controller	Spare Controller on site in Warehouse	N/A	Non-Stock
Powerhouse and Switchyard Single Line	129V DC System	129 VDC Panel - Unit 1, 2, 3, Common	30A DC Breaker		BREAKER,DC HFD2030 30A	In Stock
Powerhouse and Switchyard Single Line	129V DC System	129 VDC Panel - Unit 1, 2, 3, Common	25A DC Breaker		BREAKER,DC HFD2025 25A	In Stock
Powerhouse and Switchyard Single Line	129V DC System	129 VDC Panel - Unit 1, 2, 3, Common	15A DC Breaker		BREAKER,DC HFD2015 15A	In Stock
Powerhouse and Switchyard Single Line	129V DC System	129 VDC Panel - Unit 1, 2, 3, Common	400A DC Breaker		BREAKER,DC KD3400 400A	In Stock
Powerhouse and Switchyard Single Line	129V DC System	129 VDC Panel - Unit 1, 2, 3, Common	50A DC Breaker		BREAKER,DC HFD2050 50A	In Stock
Powerhouse and Switchyard Single Line	129V DC System	Charger	Control Unit		CONTROL UNIT,BATTERY CHG 129V	In Stock
Circulating Water and Screen Wash System	CW Discharge Valves	Butterfly Valve	36" Butterfly Valve		VALVE,BUTTERFLY 36"	In Stock
Circulating Water and Screen Wash System	CW Discharge Valves	Butterfly Valve	Actuator		ACTUATOR ASSY,ROTORK	In Stock
Circulating Water and Screen Wash System	CW Pumps	Motor	Coils		WINDING COILS	In Stock
Combustion Air & Gas Instruments	Burner Management	Burner Automation	Network Interface Modules		MODULE,NETWORK INTERFACE	In Stock
Combustion Air & Gas Instruments	Burner Management	Burner Automation	Master Fuel Trip Relays		RELAY,AB TYPE P	In Stock
Combustion Air & Gas Instruments	Burner Management	Burner Automation	DCS Control Processor		MODULE,PROCESSOR FOXBORO	In Stock
Combustion Air & Gas Instruments	Burner Management	Flame Scanners	24Vdc Scanner Power Supply		POWER SUPPLY,WEIDMULLER	In Stock
Combustion Air & Gas Instruments	Burner Management	Air Flow Transmitters	Transmitter		TRANSMITTER, DP 1 KPA TO 1 KPA	In Stock
Combustion Air & Gas Instruments	Burner Management	Oil Flow Transmitter	Transmitter - Unit 1	One spare F.O. Flow TX for both units	FLOWMETER,ROSE	In Stock
Condenser Air Extraction System	Vacuum Breakers		6" Flanged		VALVE,AIR & VACUUM 6 FLG	In Stock
Generator	Seal Oil System	Seals	See Parts List #U1&2 - 1 from Service Contractor		HYDROGEN SEAL RINGS,GE	In Stock

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset			Critical Spare		
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Generator	Exciter	Controls	ArcNet Coupler		CARD,ABB UNS0672	In Stock
Generator	Exciter	Controls	Conduction Monitor		CARD,ABB UNS0673	In Stock
Generator	Exciter	Controls	Crowbar		CARD,ABB UNS0017A/AR1	In Stock
Generator	Exciter	Controls	Digital ArcNet		CARD,ABB UPC090	In Stock
Generator	Exciter	Controls	Binary Input		CARD,ABB UFC092	In Stock
Generator	Exciter	Controls	Output Relay		CARD,ABB ARC093	In Stock
Generator	Exciter	Controls	Measuring Card		CARD,ABB UNC4672	In Stock
Generator	Exciter	Controls	Measuring Card		CARD,ABB UNC4673	In Stock
Generator	Exciter	Controls	I/O Connection		CARD,ABB UNC4674	In Stock
Generator	Exciter	Controls	Converter		CARD,ABB UNS3670	In Stock
Generator	Exciter	Controls	Snubber Bridge		SNUBBER,ABB UNS4681V12	In Stock
Generator	Exciter	Controls	Control		CARD,ABB HIEE300900R0001	In Stock
Generator	Exciter	Controls	Power Supply		CARD,ABB KUC321	In Stock
Generator	Exciter	Controls	Pulse Gen		CARD,ABB GDB021	In Stock
Generator	Exciter	Controls	Combined I/O		CARD,ABB UAC326	In Stock
Generator	Exciter	Controls	Control Panel		CARD,ABB AFC094	In Stock
Generator	Exciter	Controls	Breaker		BREAKER,FIELD ABB F3/SE	In Stock
Generator	Exciter		Transformer	On Site	N/A	Non-Stock
Generator	Stator	PT Cubicle	Primary Contact for Generator P.T.		CONTACT ASSY,PT	In Stock
Generator	Seal Oil System	Regulator	1.5" Regulating Valve		SEAL OIL REG KIT, RK	In Stock
Ignitor Light Oil and Air Supply	Light Oil	Trip Valve	1" Valve		VALVE,FISH F.O. TRIP	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Ignitor Light Oil and Air Supply	Light Oil	Igniter Control Box	Ignition Transformer		XFMR,FOSSIL S870-542F	In Stock
Ignitor Light Oil and Air Supply	Light Oil	Igniter Control Box	Sunspot		BASE,AMPLIFIER & TERMINAL	In Stock
Ignitor Light Oil and Air Supply	Light Oil	Igniter Control Box	Valve Assembly / Oil Igniter		IGNITER,ASSEMBLY ALSTOM	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Level Transmitter		TRANSMITTER,LEVEL	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Aquarian Alarm Modules		MODULE,AQUARIAN	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Relays		RELAY,PLUG-IN 12 PIN AC	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Solenoid		SOLENOID,ASCO 8300 125 VDC	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Conductivity Probe		PROBE,GUIDED WAVE	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Level Switch		RADAR 26"	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Level Transmitter		SWITCH,LEVEL MOBREY	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Relay		TRANSMITTER,LEVEL	In Stock
L.P. Feedwater System	Ammonia System		Bulk Chemical		RELAY,PLUG-IN 12 PIN AC	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	12"-150# Gasket Kit		AMMONIUM HYDROXIDE,20% TOTE	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	O-Rings		GASKET,S&K 74S0397V0010	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	Packing		O-RING,S&K 75S0144V0090	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	Packing		PACKING,S&K 24"	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	Packing		PACKING,S&K 16"	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	Packing		PACKING,S&K 12"	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves	Seal washers		SEAL,S&K 75G0181V0020	In Stock
L.P. Feedwater System	L.P. Heaters	NRV Valves - #1&2 LP Heaters	Gasket		GASKET,S&K 67S0064V0010	In Stock
L.P. Feedwater System	L.P. Heaters	NRV Valves	O-Rings		O-RING,S&K 75S0144V0100	In Stock
L.P. Feedwater System	L.P. Heaters	NRV Valves	Packing		PACKING,S&K ROC574051200	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset			Critical Spare		
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
L.P. Feedwater System	L.P. Heaters	NRV Valves	Packing		PACKING,S&K 75G0100V0040	In stock
L.P. Feedwater System	L.P. Heaters	NRV Valves	Seal washers		SEAL,S&K 75G0181V0050	In Stock
L.P. Feedwater System	Polisher Bypass Valve		Valve	Non-Stock is OK since there are full rebuild items identified and stocked	VALVE,FISH 5080326PTBNN	Non-Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2)	Valves	Valve		VALVE KIT,BALL 3	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2)	Valves	Actuator		ACTUATOR KIT,WORCH D-38	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2)	Valves	Valve		VALVE KIT,BALL 2	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2)	Valves	Actuator		ACTUATOR KIT,WORCH C 38	In Stock
Main Steam & Reheat Steam; Turbine Drains	Vacuum Trip Device		Pressure Transmitter - Unit 1		TRANSMITTER,PRESS -30- 0"	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - cable assemblies		CABLE ASSY,SERVO G.E.	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - 50 gal. Intercept Control Valve Servos		VALVE,SERVO 50.0 GPM	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - 50 gal. Main Control Valve Servos		VALVE,SERVO 50.0 GPM	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - 6 gal. Intercept Control Valve Servos (scram)		VALVE,SERVO 9.0-11.0 GPM	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - 6 gal. Main Stop Valve Servos		VALVE,SERVO 9.0-11.0 GPM	In Stock
Turbine Generator System Stage 1	Governor	Governor	Linear Variable Differential Transducer for Intercept Control Valve & Main		TRANSDUCER,GE	In Stock
Turbine Generator System Stage 1	Governor	Governor	Linear Variable Differential Transducers for 1 per Main Stop Valve		TRANSDUCER,GE	In Stock
Turbine Generator System Stage 1	Governor	Governor	Cable		CABLE SET,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Valve		VALVE,FLUID POWER PILOT	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Turbine Generator System Stage 1	Governor	Governor	Sensor		SENSOR,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Coil		COIL,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Go Switch - Limit Switches		SWITCH,LIMIT GO LEVER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Cable Set		CABLE SET,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Valve		VALVE,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Sensor		PILOT	In Stock
Turbine Generator System Stage 1	Governor	Governor	Sensor		SENSOR,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	Coil		COIL,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Governor	O-Ring Kit		O-RING KIT,FLUID POWER	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	RES,50OHM,5%,40 WATT		RESISTOR,500HM	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	DIODE MOD,1200V,45A,SKKD46/12		DIODE,MOD 1200V	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	RELAY		RELAY,12HGA11J52	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	CPF MKS CONTROL POWE		CONTROL,MKS POWER	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	TERMINATOR,93 OHMS		TERMINATOR,93 OHMS	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	RESISTOR		RESISTOR,323A2354P1	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	RESISTOR		RESISTOR,323A2354P2	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	RES 100 OHM 5% 40W		RESISTOR,100 OHM	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	CAP-METALLIZED-MYLAR		CAP,METALLIZED MYLAR	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, C-Core Terminal Board		TERMINAL BOARD,MKV C-CORE	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Terminal Board, Digital I/O		TERMINAL BOARD,DIGITAL I/O	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Terminal Board, Digital I/O		TERMINAL BOARD,DIGITAL I/O	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Terminal Board, Relay/Solenoid		TERMINAL BOARD,MKV RELAY	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Terminal Board, Relay/Solenoid		TERMINAL BOARD,MKV RELAY	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, P-Core Terminal Board		TERMINAL BOARD,MKV P-CORE	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	TERM. BOARD (R-S-T)	DS200QTBAG1A is superseded by DS200QTBAG3A	TERMINAL BOARD,(R-S-T)	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	Main Control Card	New no longer available, reman only	BOARD,GE DS200SDCCG4A	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, LAN Comm Interface Card		BOARD,GE DS200SLCC G3A/PS	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Thermocouple Terminal Board		TERMINAL BOARD,THERMOCOUPLE	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, TERM.BD @R-S-T TC		TERMINAL BOARD,MKV	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKVe, Analog I/O Terminal Board		TERMINAL BOARD,ANALOG I/O	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKVe, Analog I/O Terminal Board		TERMINAL BOARD,ANALOG I/O	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, TERM BD (R-S-T) EXT		TERMINAL BOARD,(R-S-T) EXT	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Common Analog Card	New no longer available, reman only	BOARD,GE DS200TCCAG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, DIG. I/O BD. CONF. C		BOARD,GE DS200TCCAG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Emergency Overspeed Card	New no longer available, reman only, Has age sensitive components,	BOARD,GE DS200TCEAG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, COMM. CIRCUITS FOR T	Has age sensitive components	BOARD,GE DS200TCEBG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	PDM, Switch & Fuse Card		BOARD,GE DS200TCPDG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, DC INPUT PWR SUPPLY	New no longer available, reman only, Has age sensitive components,	BOARD,GE DS200TCPSG1A	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Analog I/O Card		BOARD,GE DS200TCQAG1B	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, (RST) Extended Analog I/O Card	New no longer available, reman only	CARD,EXTENDED MKV (RST)	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, BOARD-(RST) OVERFLOW	New no longer available, reman only	BOARD,GE DS200TCQCG1B	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Relay Output Card		BOARD,GE DS200TCRAG1A/PS	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MKV, Turbine Trip Card	New no longer available, reman only	BOARD,GE DS200TCTSG1A	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	MODULE,AC TO DC	DS2020DACAG1 has been superseded by DS2020DACAG2	MODULE,AC TO DC	In Stock
Turbine Generator System Stage 1	Governor	Turbine Control System	(Commissioning Kit) Fuses, Resistors , Diodes, Relays		SPARE KIT,MKV	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	DC Oil Pump	Pump		PUMP,DC LUBE OIL	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	DC Motor	Motor		MOTOR,DC LUBE OIL PUMP	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	Pressure Switches	Switch		SWITCH,PRESS 0-150 PSI	In Stock
Turbine Generator System Stage 1	Hydraulic Fluid System	Fluid Pumps	Pump		PUMP,HYD FLUID POWER UNIT	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	AC Oil Pumps	Shaft		SHAFT,IR 10 (TYPE 2 ERVH)	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	AC Oil Pumps	Impeller		IMPELLER,IR 2RVH3DX1-813	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	AC Oil Pumps	Sleeve		SLEEVE,J RAND 175B135NX1B-204	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	AC Oil Pumps	Key		KEY,IMPELLER IR 11A9C37	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	AC Motor	Motor		MOTOR,ELECT 20HP 575VAC	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	Oil Pressure Regulator	Diaphragm		DIAPHRAGM,GE 920B10612	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	Pressure Switch 2	Switch		SWITCH,PRESS 0-150 PSI	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Main Steam Valve - Actuator	Bushing		BUSHING,FISH 1E845714012	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Main Steam Valve - Actuator	Diaphragm		DIAPHRAGM,FISH 2E859802202	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Turbine Generator System Stage 1	Steam Seal Regulator	Main Steam Valve - Actuator	Repair Kit		ACTUATOR KIT,FISH R667X000502	In Stock
	Steam Seal Regulator	Main Steam Valve - Body	Packing		PACKING KIT,FISH RPACX0011	In Stock
	Steam Seal Regulator	Main Steam Valve - Body	Positioner		POSITIONER,FISH DVC6200	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Actuator	Diaphragm		DIAPHRAGM,FISH 2N130902202	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Actuator	Repair Kit		ACTUATOR KIT,FISH R667X000702	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Gasket		GASKET SET,FISH RGASKETX232	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Plug/Stem		PLUG/STEM,FISH 27A3965X052	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Cage		CAGE,FISH 20A3245X092	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Ring		RING,FISH 17A3991X022	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Seat Ring		RING,FISH 20A3260X152	In Stock
Units 1 & 2 Air & Flue Gas	Furnace Pressure TX (Trip)	Pressure Transmitter	Pressure Transmittter		TRANSMITTER,DP -8000-8000KPA	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Baskets	Basket Set	To be ordered & stocked as required	BASKET SET,AIR HEATER 21-1/2"	Non-Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Baskets	Basket Set	To be ordered & stocked as required	BASKET SET,AIR HEATER U1	Non-Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Rotating Element & Bearings	Bearing		BEARING,BALL 23034CCX/C3W33	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Rotating Element & Bearings	Seal		SEAL,HOWDEN 68-01-615	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Drive System	Coupling		COUPLING,STEELFLEX 1-1/8 S-4	Procurement Ongoing
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Drive System	Air Motor		AIR MOTOR,ING RAND	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Drive System	Motor		MOTOR,HEATER 1/3HP (XL GEAR)	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Soot Blowers	Sleeve		SLEEVE,RELANCE 411629-6A	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Soot Blowers	Coupling		COUPLING,BORE 3/4X5/8	In Stock
Units 1 & 2 Air & Flue Gas	Rotary Air Heaters	Soot Blowers	Roller assembly		ROLLER,ASSEMBLY	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Gasket		GASKET SET,FISH RGASKETX182	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Stud		STUD,DEW 0282336	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Repair Kit		ACTUATOR KIT,FISH R667X000402	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Cage		CAGE,FISH 2U224033272	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Plug/Stem		PLUG ASSY,FISH 1V6575X0052	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Ring		RING,FISH 1U222646172	In Stock
Units 1 & 2 Fuel Oil System	Combustion Control Valve	Combustion Control Valve	Bushing		BUSHING,FISH 1E682814012	In Stock
Units 1 & 2 Fuel Oil System	Atomizing Steam Valve	Atomizing Steam Valve	2" Flanged Valve		VALVE,FISH ATOM STEAM	In Stock
Units 1 & 2 Fuel Oil System	Main Fuel Oil Trip Valve	Main Fuel Oil Trip Valve	Flanged Valve		VALVE,FISH F.O. TRIP	In Stock
Units 1 & 2 Fuel Oil System	Header Pressure Control Valve	Header Pressure Control Valve	Repair Kit		PACKING KIT,FISH RPACKX00012	In Stock
Units 1 & 2 Fuel Oil System	Header Pressure Control Valve	Header Pressure Control Valve	Diaphragm		DIAPHRAGM,FISH 2E670002202	In Stock
Units 1 & 2 Fuel Oil System	Fuel Oil Pumps	Fuel Oil Pumps	PUMP,IMO C324		PUMP,IMO C324 (COMPLETE)	In Stock
Units 1 & 2 Fuel Oil System	Mechanical Seal	Mechanical Seal	Seal		SEAL,MECHANICAL FUEL C324	In Stock
Units 1 & 2 Fuel Oil System	Short Recirculation Valve	Short Recirculation Valve	Gasket Set		GASKET SET,FISH RGASKETX312	In Stock
Units 1 & 2 Fuel Oil System	Short Recirculation Valve	Short Recirculation Valve	Packing		PACKING KIT,FISH RPACKX00012	In Stock
Units 1 & 2 Fuel Oil System	Short Recirculation Valve	Short Recirculation Valve	Ring		RING,FISH 1U222535072	In Stock
Units 1 & 2 Fuel Oil System	Short Recirculation Valve	Short Recirculation Valve	Plug/stem		PLUG/STEM,FISH 1U8350X0022	In Stock
Units 1 & 2 Fuel Oil System	Short Recirculation Valve	Short Recirculation Valve	Cage		CAGE,FISH 2U215033272	In Stock
Units 1 & 2 Fuel Oil System	Long Recirculation Valve	Long Recirculation Valve	Gasket		GASKET,FISH 10A4154X012	In Stock
Units 1 & 2 Fuel Oil System	Long Recirculation Valve	Long Recirculation Valve	Ring		RING,FISH 1U222835072	In Stock
Units 1 & 2 Fuel Oil System	Long Recirculation Valve	Long Recirculation Valve	Diaphragm		DIAPHRAGM,FISH 2N126902202	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Units 1 & 2 Fuel Oil System	Long Recirculatoiin Valve	Long Recirculatoiin Valve	Cage	Repair Parts Stocked Ref CN116597	CAGE,FISH 2U231833272	In Stock
Units 1 & 2 Fuel Oil System	Fuel Oil Heaters	Fuel Oil Heaters	Gaskets		GASKET,FUEL OIL HEATER	In Stock
Units 1 & 2 Fuel Oil System	Fuel Oil Heaters	Fuel Oil Heaters	Tube Bundles	Annual Inspection plus online Check. To be ordered as required.	HEATER,FUEL OIL STAGE 1	Non-Stock
Units 1 & 2 Fuel Oil System	Burners	Oil Valve	Oil, Steam & Scavange Valves - All Same		VALVE,BALL 3/4 C/W PNEU	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Cage		CAGE,FISH 42B3570X012	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Plug/stem		PLUG/STEM,FISH 36A5366X062	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Ring		RING,FISH 26A5285X012	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Ring		RING,FISH 26A5299X052	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Ring		RING,FISH 10A5411X022	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Pin		PIN,FISH 1V334035072	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Gasket		GASKET,FISH 18A2810X012	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Gasket		GASKET,FISH 26A5314X012	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Ring		RING,FISH 10A5410X012	In Stock
Units 1 & 2 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve - Unit 1	Packing		PACKING,FISH 1R290601012	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Element Assembly (Volute)	Rebuildable Item If this is not in stock, it is out for rebuild.	ELEMENT ASSY,VOLUTE/ROTATING	Procurement Ongoing
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Bushing		BUSHING,BJ 216507LG	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Shaft Driven Oil Pump		PUMP,BJ DWG C1F-238	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			Inventory Status
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Ring		RING,BJ 612987-EH	Procurement Ongoing
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Ring		RING,BJ 634599-BG	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Shoe		SHOE ASSY,BJ 631163-KD	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps - Unit 1 E & W	Cover		COVER,BJ 308952-SA	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	3000HP Motor, 4160Vac (two styles of motor for Stage I, one each stocked	Motor stored off site via service contract	SCIM, sin# 1026366788, frame MGP500B, 3000HP, 4160Vac, 60Hz	Non-Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Gasket		GASKET,FISH 12B7100X082	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Seal		SEAL,FISH 10A4215X012	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Ring	Repair Parts stocked Ref CN12054568	RING,FISH 10A4217X012	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Ring	Repair Parts stocked Ref CN12054568	RING,FISH 10A4219X012	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Ring	Repair Parts stocked Ref CN12054568	RING,FISH 22B9344X012	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Main Feedwater Low Load Control Valve	Plug/Stem		PLUG/STEM,FISH 38A0014X062	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit #1 - All HP Heaters	Level Transmitter		TRANSMITTER, DP 0-120" H2O	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit #2 - HP Heater # 4 & 6	Level Transmitter		TRANSMITTER, DP 0-120" H2O	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit #2 -HP Heater # 5	Level Transmitter		TRANSMITTER, DP 0-120" H2O	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit 1 - All HP Heaters	Aquarian Alarm Modules		MODULE,AQUARIAN	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit #2 - Heater # 4 & 6	Aquarian Alarm Modules		MODULE,AQUARIAN	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit #2 -HP Heater # 5	Aquarian Alarm Modules		MODULE,AQUARIAN	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit 1 & 2 - All HP Heaters	Conductivity Probe	Hi-Level Switch	PROBE, CONDUCTIVITY	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit # 1 & 2 - All HP Heaters	Relay		RELAY, PLUG-IN 12 PIN AC	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	Unit 1 & 2	Solenoid		SOLENOID, ASCO 8300 125 VDC	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Suction Valve Limit Switch	Oil Tight Limit Switch		SWITCH, LIMIT AB 802T-B	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Suction Valve	Packing		PACKING, GRAFOIL 1IDX1-1/20D	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Gasket		GASKET, HOP 30037592	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Spindle		SPINDLE, HOP 44574-011	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Nut		NUT, HOP 35224-508	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Stop		STOP, HOP 8 VALVE 24930W	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Belt		BELT ASSY, HOP 44511-001	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	NRV Valves - Heater # 4	8"- 150# Gasket Kit		GASKET, S&K 7450397V0010	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	NRV Valves - Heater # 5	8"- 300# Gasket Kit		GASKET, S&K 7450397V0010	In Stock
Units 1 & 2 H.P. Feedwater System	H.P. Heaters	NRV Valves - Heater # 6	8"- 600# Gasket Kit		GASKET, S&K 7450397V0010	In Stock
Units 1 & 2 H.P. Feedwater System	Steam Drum	Level Control Transmitters	Level Transmitter		TRANSMITTER, PRESS 5-800	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Suction Line Safety Valve	1/2" x 1" Valve		VALVE, RELIEF 1/2", 110# SE	In Stock
Units 1 & 2 H.P. Feedwater System	Boiler Feed	Boiler Feed Recirculation Valve to DA	4" Valve		VALVE, GATE 4 CS BW 300#	In Stock
Combustion Air & Gas Instruments	Burner Management	Positioner	2.5" x 5 "Pneumatic PowerPositioner (Hagan)		VALVE ASSY, 373218-001	In Stock
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Coupling		COUPLING, METASTREAM	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset			Critical Spare		
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Bearing	Mechanical Engineer to contact Flowserve for bearing spec.	BEARING,JOURNAL MIP 215878E	Non-Stock
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Impeller		IMPELLER,MAT PLA 27881-P	In Stock
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Impeller		IMPELLER,MAT PLA 27882-P	In Stock
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Impeller		O-RING,M&P 775C	In Stock
L.P. Feedwater System	Condensate Extraction Pumps	Pump	Impeller		O-RING,MAT PLA 775D	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Cable	Cable		CABLE,BATTERY 1/0	In Stock
Turbine Generator System Stage 1	Governor	Governor	Mark 5 System - speed probes		PROBE,SPEED PICKUP	In Stock
Turbine Generator System Stage 1	Turbine Lube Oil System	Pressure Switch 1	Switch		SWITCH,PRESS 0-150 PSI	In Stock
Turbine Generator System Stage 1	Steam Seal Regulator	Dump Control Valve - Body	Positioner		POSITIONER,FISH DVG6200	In Stock
Condenser Air Extraction System	Mechanical Vacuum Pumps	Motor	Motor		MOTOR,ELECT 50HP 575V	In Stock
Generator	Stator	PT Cubicle	Potential Transformer (PT)		TRANSFORMER,GE 765X	In Stock
Generator	Stator	Stand Off Insulators	Stand Off Insulator		BUSHING,HIGH VOLTAGE GE	In Stock
Turbine Generator System Stage 1	Governor	Governor	Truck V-Fast Cables		CABLE SET,FLUID POWER	In Stock
Generator	Stator	Stator and Brush Riggng Assembly	Brush		BRUSH,GENERATOR U1 & U2	Procurement Ongoing
Units 1 & 2 Air & Flue Gas	F.D. Fans	Unit 1& 2 - Fans	Inboard Bearing Liner		LINER,BEARING 6"	In Stock
Units 1 & 2 Air & Flue Gas	F.D. Fans	Unit 1& 2 - Fans	Outboard Bearing Liner		SLEEVE,BEARING 6"	In Stock
Units 1 & 2 Air & Flue Gas	F.D. Fans	Unit 1& 2 - Fans	Bearing Set	U1 West (Dodge)	BEARING SET,SLEEVE 6"	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Units 1 & 2 Air & Flue Gas	F.D. Fans	Unit 1& 2 - Fans	200A Power Cell		POWER CELL,SIEMENS 200A	In Stock
Units 1 & 2 Air & Flue Gas	F.D. Fans	Unit 1& 2 - Fans	1500HP Motor, 4160Vac	Motor stored off site via service contract	SCIM, sin# 1026842643, frame MGP500C, 1500HP, 4160Vac, 60Hz	Non-Stock
Powerhouse and Switchyard Single Line	258V DC System	Panel	400A DC Breaker		BREAKER,DC KD2400F 400A	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Panel	40A DC Breaker		BREAKER,DC HFD2040 40A	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-116	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-114-1	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-111-1	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-107-2	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-107-2	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-107-2A	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Electronic Control Cards		CARD,CIGENTEC 81-112-2	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	Rectifier		RECTIFIER,CIGENT 323-230	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger Cigentic	Charger	Individual replacement components stocked	CHARGER,BATTERY 250VDC	Non-Stock
Circulating Water and Screen Wash System	CW Discharge Valves	Valve	36 " Butterfly Valve		VALVE,BUTTERFLY 36"	In Stock
Circulating Water and Screen Wash System	CW Discharge Valves	Actuator	CW Butterfly Valve Actuator		ACTUATOR ASSY,ROTORK	In Stock
Circulating Water and Screen Wash System	CW Pumps	Motor	Coils		COILS,STAGE 2 MOTOR	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Combustion Air & Gas Instruments	Burner Management	Burner Automation	Network Interface Modules		MODULE, NETWORK INTERFACE	In Stock
	Burner Management	Burner Automation	Master Fuel Trip Relays		RELAY, SD 8501XUDO	In Stock
Combustion Air & Gas Instruments	Burner Management	Burner Automation	DCS Control Processor		MODULE, PROCESSOR FOXBORO	In Stock
Combustion Air & Gas Instruments	Burner Management	Elevation Oil Flow Transmitter	Meter & Transmitter		FLOWMETER, PROMASS 83F40	In Stock
Combustion Air & Gas Instruments	Burner Management	Elevation Air Dampers	Positioner		POSITIONER, FISH DVC6200	In Stock
Condenser Air Extraction System	Vacuum Breakers		6" Flange Vacuum Breaker		VALVE, AIR & VACUUM 6 FLG	In Stock
Generator	Stator	Stator and Brush Rigging Assembly	Brush		BRUSH, GENERATOR U3	Procurement Ongoing
Generator	Synchronous Condensor	Thrust Bearing	Bearing Pad		PAD, BEARING U3 SYNC COND	In Stock
Generator	Synchronous Condensor	Thrust Bearing	Seal Ring		RING, SEAL U3 SYNC COND	In Stock
Generator	Synchronous Condensor	Thrust Bearing	Thrust bearing		BEARING, THRUST U3 SYNC COND	In Stock
Generator	Synchronous Condensor	Thrust Bearing	Thrust bearing		BEARING, THRUST U3 SYNC COND	In Stock
Generator	Synchronous Condensor	Thrust Bearing	Seal Ring		RING, SEAL U3 SYNC COND	In Stock
Generator	Synchronous Condensor	Thrust Bearing	Thermocouple		THERMOCOUPLE, U3 SYNC COND	In Stock
Generator	Seal Oil System	Seals	Bellows		BELLOWS, HITACHI	In Stock
Generator	Seal Oil System	Seals	Gaskets		GASKET, HITACHI	In Stock
Generator	Seal Oil System	Seals	Gaskets		GASKET, HITACHI	In Stock
Generator	Seal Oil System	Seals	Gaskets		GASKET, HITACHI	In Stock
Generator	Exciter	Exciter Control System	Converter		CONVERTER, ABB EXCITER	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Generator	Exciter	Exciter Control System	ECT Panel		ECT PANEL,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Controller		CONTROLLER,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Computer		COMPUTER,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Firing Board		BOARD,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Message Module		MODULE,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Input Coupling		INPUT COUPLING UNIT,ABB	In Stock
Generator	Exciter	Exciter Control System	Power Supply		POWER SUPPLY,ABB	In Stock
Generator	Exciter	Exciter Control System	Crowbar		CROWBAR,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Murr		MURR,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	Resistor		RESISTOR,ABB EXCITER	In Stock
Generator	Exciter	Exciter Control System	I/O/ Board		BOARD,ABB COMBINED I/O	In Stock
Generator	Exciter	Exciter Control System	Field Breaker		BREAKER, FIELD ABB E2/E	In Stock
Generator	Stator	Stand Off Insulators	Insulator Bushing		BUSHING,HIGH VOLTAGE HIT	In Stock
Generator	Stator	PT Cubicle	Potential Transformer (PT)		VOLTAGE TRANSFORMER, ABB VIZZ-	In Stock
Generator	Stator	PT Cubicle	Fuse		FUSE,GE EJO-1-CS88L405G1	In Stock
Ignitor Light Oil and Air Supply	Light Oil	Trip Valve	1-1/2" Valve		VALVE KIT,JAMES RKB5MT	In Stock
Ignitor Light Oil and Air Supply	Light Oil	Igniter Control Box	Light Oil / Air Supply Solenoid Valve		SOLENOID,ASCO 8342C1	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Ignitor Light Oil and Air Supply		Igniter Control Box	Purge Solenoid Valve		SOLENOID,ASCO 8262G232	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	Pneumatic Actuator		ACTUATOR,PNEU R16C	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	Ignition Transformer		XFMR,IGNITION 120V 60C	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	Relay		BOX,IGNITOR C/W CABLES N-6	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	Sunspot - Scanner		SCANNER,FOSSIL 9100-1000	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	Snap Action Switch		MICROSWITCH,16CX12-D01	In Stock
Ignitor Light Oil and Air Supply		Igniter Control Box	1/4" Light Oil Air Ball Valves		VALVE,BALL 1/4" U3 IGNITOR	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Level Transmitter LP Heater #1		TRANSMITTER,LEVEL	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Aquarian Alarm Modules		MODULE,AQUARIAN	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Solenoid		SOLENOID,ASCO 8300 125 VDC	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Relay		RELAY,OMRON MM4XP-DC125	In Stock
L.P. Feedwater System	L.P. Heater Controls (Water Induction Protection)		Conductivity Probe		PROBE,CONDUCTIVITY	In Stock
L.P. Feedwater System	Deaerator System	Deaerator	Gauge Glasses		GAUGE,GLASS 3/4X48	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Level Switch		SWITCH ASSY,MAG 89-7401-052	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Solenoid		SOLENOID,ASCO 8320G184M0	In Stock
L.P. Feedwater System	Deaerator System	Level Control	Level Transmitter		TRANSMITTER, DP O-120" H20	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Repair Kit		VALVE KIT,BALL 8"	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Repair Kit		ACTUATOR KIT,WORCH C-38	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Valve		VALVE,FISH 8560-1052-36105	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Disc		DISC,FISH 75B1036X102	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Pin		PIN,FISH 75B1122X052	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Pin		PIN,FISH G13725K0022	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Ring		RING,FISH 75B0311X032	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Shaft		SHAFT,FISH 75B0014X012	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Spring		SPRING,FISH 75B0012X012	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Packing		PACKING,FISH 12A8951X022	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Control Valves	Bearing		BEARING,FISH 75B1076X012	In Stock
L.P. Feedwater System	L.P. Heaters	NRV Valves - #2 LP Heater	20"Dia		GASKET,COVER HIT	In Stock
L.P. Feedwater System	L.P. Heaters	NRV Valves - #1 LP Heater	24" Dia		GASKET,COVER HIT	In Stock
L.P. Feedwater System	Deaerator System	NRV Valves (2)	14" Dia on DA		GASKET COVER HIT	In Stock
L.P. Feedwater System	Deaerator System	Safety Valves	Disc		DISC,VALVE SAFETY RELIEF	In Stock
L.P. Feedwater System	Polisher Bypass Valve		Parts to Repair		VALVE,FISH 8560-1052-36105	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Valves	Valve Kit		VALVE KIT,BALL 3	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Valves	Actuator Kit		ACTUATOR KIT,WORCH D-38	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Valves	Valve Kit		VALVE KIT,BALL 2	In Stock
L.P. Feedwater System	Condensate Polishers (Units 1, 2, 3)	Valves	Actuator Kit		ACTUATOR KIT,WORCH C 38	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Main Steam & Reheat Steam; Turbine Drains	Vacuum Unloading Device		Bellows		BELLOW ASSY,HIT L1000-1	In Stock
Powerhouse and Switchyard Single Line	258V DC System	Charger	400A DC Breaker		BREAKER,DC KD2400F 400A	In Stock
Powerhouse and Switchyard Single Line	258V DC System		40A DC Breaker		BREAKER,DC HFD2040 40A	In Stock
Turbine Generator System Stage 2	Governor	Governor	Piston		PISTON RING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Oil Seal		OIL SEAL,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	O-Ring		O-RING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	O-Ring		O-RING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Bushing		BUSHING,HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	Packing		PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Bushing		BUSHING,HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	O-Ring		O-RING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Bearing		BEARING,HITACHI LOAD LIMIT	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	Bearing		BEARING,HITACHI LOAD LIMIT	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	Piston		PISTON RING,HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	Packing		PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Sleeve		SLEEVE,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Trunnion		TRUNNION,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Bearing		BEARING,BALL HITACHI	Procurement Ongoing

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Turbine Generator System Stage 2	Governor	Governor	Pin		SPLIT PIN,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Governor	Bearing		BEARING,BALL HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Governor	Oil Seal		OIL SEAL,HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Packing		PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Piston		PISTON RING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Washer		WASHER,HITACHI	In Stock
Turbine Generator System Stage 2	Governor	Electrical Trip Test Device	Seat Packing		SEAT PACKING,HITACHI	In Stock
Turbine Generator System Stage 2						

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Turbine Generator System Stage 2	Turbine Lube Oil System	DC Lube (Flushing) Oil Pump	Auto Start Pressure Switch		SWITCH,PRESS 10-300 TYPE ACW2	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Seal Ring		SEALRING,10P-067-551-17	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Seal Ring		SEALRING,10P-067-551-18	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	O-Ring		O-RING,HITACHI	Procurement Ongoing
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Ring		RING,HIT 10P 067-551-13	Procurement Ongoing
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Ring		RING,HIT 10P 067-551-17	Procurement Ongoing
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Ring		RING,HIT 10P 067-551-18	Procurement Ongoing
Turbine Generator System Stage 2	Turbine Lube Oil System	Shaft Driven Oil Pump	Brush		BRUSH,HIT 10P 067-551-38	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Auxiliary Oil Pump	Bearing		BEARING,PLANE HIT ITEM 35	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Auxiliary Oil Pump	Bearing		BEARING,PLANE HIT ITEM 36	In Stock
Turbine Generator System Stage 2	Turbine Lube Oil System	Auxiliary Oil Pump	Motor	Refurbishable item. If it is not in stock, it is out for refurbishment.	MOTOR,AUX OIL YELLOW	Procurement Ongoing
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Seat		SEAT,10P-061-226-123	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Pin		PIN,10P-061-226-207	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Lockring		LOCKRING,10P-061-226-208	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Lockring		LOCKRING,10P-061-226-209	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Pin		PIN,HIT 10P-061-226/16	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Upper	Pin		PIN,HIT 10P-061-226/98	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Description	Inventory Status
	Sub-System	Asset	Defined Spare	Notes			
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Lower	Bushing			BUSHING,HIT T-9201	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Lower	Pin			PIN,HIT 10P-061-228-125	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Lower	Crosshead			CROSSHEAD,HIT 10P0612283	Procurement Ongoing
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Lower	Pin			PIN,HIT 10P-061-228/98	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Control Valve - Lower	Pin			PIN,HIT 10P-061-228/16	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Gasket			GASKET,STL #16	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Gasket			GASKET,HIT 10P-038-197-16	Procurement Ongoing
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Gasket			GASKET,HIT 10P-038-197-71	Procurement Ongoing
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Bushing			BUSHING,10P-038-197/15	In Stock
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Seal Ring			SEAL RING,10P-038-197/14	Procurement Ongoing
Turbine Generator System Stage 2	Main Steam Chest Assembly	Stop Valves	Bushing			BUSHING,HIT 10P-038-197/18	In Stock
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Bushing			BUSHING,HIT 10P0611582	Procurement Ongoing
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Bushing			BUSHING,HIT 10P0611586	Procurement Ongoing
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Bushing			BUSHING,HIT 10P06115814	Procurement Ongoing
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Rivet			RIVET,HIT 10P-061-158-63	Procurement Ongoing
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Stem			STEM,HIT 10P061158/7	In Stock
Turbine Generator System Stage 2	Reheat Steam Chest Assembly	Reheat/ICV Valves	Pin			PIN,HIT 10P06115872	Procurement Ongoing
Turbine Generator System Stage 2	Steam Seal Regulator		Pressure Transmitter - Unit 3			TRANSMITTER,PRESS O-200	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Turbine Generator System Stage 2	Steam Seal Regulator	2" Valve	Bushing		BUSHING,FISH 1E845714012	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator	Main Steam Control Valve - Actuator	Diaphragm		DIAPHRAGM,FISH 2E859602202	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator	Main Steam Control Valve - Actuator	Actuator repair kit		ACTUATOR KIT,FISH R667X000502	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator	Main Steam Control Valve - Body	Packing Kit		PACKING KIT,FISH RPACX0011	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator	Main Steam Control Valve - Positioner	Positioner		POSITIONER,FISH DVC6200	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator	Auxiliary Steam Control Valve - actuator	Aux Steam Control Valve - Actuator - Unit 3		ACTUATOR KIT,FISH R470X000032	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Aux Steam Control Valve - Body - Unit 3		BODY,VALVE FISH 3N192029022	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Dump Control Valve - Actuator - Repair Kit - Unit		ACTUATOR KIT,FISHER R667	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Ring		RING,FISH 17A3990X022	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Ring		RING,FISH 1U508039102	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Pin		PIN,FISH 1V326035072	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Cage		CAGE,FISH 2U505939102	In Stock
Turbine Generator System Stage 2	Steam Seal Regulator		Plug		PLUG,FISH 27A3953X012	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Series 8500 size 95 w/ 95" @ 100% width wheel	Thrust Plate		THRUST PLATE KIT,DODGE 132221	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Drive Motor	Formed Coils		COIL,WINDING U3 FD FAN	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Fan Assembly	Liner		LINER ASSY,DODGE 132423	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Fan Assembly	Collar		COLLAR,DODGE 132154	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Fan Assembly	Opposite side bearing		LINER ASSY,DODGE 132951	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Unit 3 Air & Flue Gas	F.D. Fans	Fan Assembly	2 - Temperature probes installed in bearings		THERMOCOUPLE,TYPE T	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Fan Assembly	Falk Steelflex coupling		COUPLING,STEELFLEX GRID	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	2 - Independent bearing pedestals	Gasket		GASKET,DODGE 132170	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	Outlet damper	Damper	To be ordered & stocked as required	DAMPER,STOCKBRIDGE 0.866"	Non-Stock
Unit 3 Air & Flue Gas	F.D. Fans	Outlet damper	Damper	To be ordered & stocked as required	DAMPER,STOCKBRIDGE 1.004"	Non-Stock
Unit 3 Air & Flue Gas	F.D. Fans	variable Inlet vanes	Actuator Repair Kit		DRIVE KIT,BAILEY 532694C1	In Stock
Unit 3 Air & Flue Gas	F.D. Fans	variable Inlet vanes	Actuator repair kit		DRIVE KIT,BAILEY 256111A0	In Stock
Unit 3 Air & Flue Gas	Rotary Air Heaters	Gearbox	Gearbox		GEARBOX,AIR HEATER U3	In Stock
Unit 3 Air & Flue Gas	Rotary Air Heaters	Pneumatic Drive System	Air Drive Motor		AIR MOTOR,ING RAND	In Stock
Unit 3 Air & Flue Gas	Rotary Air Heaters	Baskets	Basket Set	To be ordered & stocked as required	BASKET SET,AIR HEATER 22-1/2"	Non-Stock
Unit 3 Air & Flue Gas	Rotary Air Heaters	Baskets	Basket Set	To be ordered & stocked as required	BASKET SET,HOT END 22-1/2	Non-Stock
Unit 3 Air & Flue Gas	O2 Analyzers		Probe		PROBE,OXYGEN ANALYZER	In Stock
Unit 3 Air & Flue Gas	O2 Analyzers		Analyser		ANALYZER,ROSE 3000 OXY	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Gasket		GASKET SET,FISH RGASKETX362	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Packing		PACKING KIT,FISH RPACX0002	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Actuator		ACTUATOR KIT,FISH R667X000502	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Regulator		REGULATOR KIT,FISH WR67AFRX011	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Bushing		BUSHING,FISH 1E845714012	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Diaphragm		DIAPHRAGM,FISH 2E859802202	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Trip Valve	Cage		CAGE,FISH 2U236033272	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Ring		RING,FISH 1U217305092	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Seat		SEAT,FISH 1U222046172	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Plug/Stem		PLUG/STEM,FISH 1V6571X0042	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Cage		CAGE,FISH 2U215333272	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Gasket		GASKET SET,FISH RGASKETX242	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Packing		PACKING KIT,FISH RPACKX00012	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Bushing		BUSHING,FISH 1E682814012	In Stock
Unit 3 Fuel Oil System		Combustion Control Valves	Diaphragm		DIAPHRAGM,FISH 2E669902202	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Cage		CAGE,FISH 2U223733272	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Ring		RING,FISH 1U222646172	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Plug/Stem		PLUG ASSY,FISH 1V6575X0052	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Packing		PACKING KIT,FISH RPACKX0002	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Gasket		GASKET SET,FISH RGASKETX182	In Stock
Unit 3 Fuel Oil System		Atomizing Steam Valve	Diaphragm		DIAPHRAGM,FISH 2E670002202	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Packing		PACKING KIT,FISH RPACKX0002	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Repair Kit		ACTUATOR KIT,FISH R667X000402	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Bushing		BUSHING,FISH 1E682814012	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Retainer		RETAINER,FISH 1V710935072	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Disc		DISC,FISH 1V711006242	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Seat		SEAT,FISH 1V711135072	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Diaphragm		DIAPHRAGM,FISH 2E669902202	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Trip Valves (3)	Cage		CAGE,FISH 2U227633272	In Stock
Unit 3 Fuel Oil System		Header Pressure Control Valve	Repair Kit		ACTUATOR KIT,FISH R667X000402	In Stock
Unit 3 Fuel Oil System		Header Pressure Control Valve	Bushing		BUSHING,FISH 1E682814012	In Stock
Unit 3 Fuel Oil System		Header Pressure Control Valve	Diaphragm		DIAPHRAGM,FISH 2E669902202	In Stock
Unit 3 Fuel Oil System		Fuel Oil Pumps	Pump		PUMP,MAIN FUEL OIL KRAL	In Stock
Unit 3 Fuel Oil System		Main Fuel Oil Recirculation Valve	1" Welded Flange Valve w/ Actuator		VALVE ASSY,JAMES 1052 1"	In Stock
Unit 3 Fuel Oil System		Level Fuel Oil Recirculation Valves	3/4" Welded Valve w/ Actuator		VALVE ASSY,JAMES 1052 3/4"	In Stock
Unit 3 Fuel Oil System	Burners	Oil Valve	1/2"Ball Valve		VALVE KIT,JAMES RKB5MT	In Stock
Unit 3 Fuel Oil System	Burners	Steam Valve	Gasket		GASKET SET,FISH RGASKETX312	In Stock
Unit 3 Fuel Oil System	Burners	Steam Valve	Packing		PACKING KIT,FISH RPACKX00012	In Stock
Unit 3 Fuel Oil System	Burners	Steam Valve	Plug/Stem		PLUG/STEM,FISH 1U2161X0082	In Stock
Unit 3 Fuel Oil System	Burners	Steam Valve	Ring		RING,FISH 1U222546172	In Stock
Unit 3 Fuel Oil System	Burners	Steam Valve	Cage		CAGE,FISH 2U215033272	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare			
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Unit 3 Fuel Oil System	Burners	Scavenge Valve	Gasket		GASKET SET,FISH RGASKETX312	In Stock
Unit 3 Fuel Oil System	Burners	Scavenge Valve	Packing		PACKING KIT,FISH RPACKX00012	In Stock
Unit 3 Fuel Oil System	Burners	Scavenge Valve	Plug/Stem		PLUG/STEM,FISH 1U2161X0082	In Stock
Unit 3 Fuel Oil System	Burners	Scavenge Valve	Ring		RING,FISH 1U222546172	In Stock
Unit 3 Fuel Oil System	Burners	Scavenge Valve	Cage		CAGE,FISH 2U215033272	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Rotating Assembly		CASE ASSY,BWL (INNER)	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Shoe Assembly		SHOE ASSY,KI-00166-A- 3740	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Throttle bushing [(2 req'd)		BUSHING,BWL 3106181	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Bearing		BEARING,HIT 9-60-1	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Bearing		BEARING,HIT 9-60-2	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Balance bushing		BUSHING,BWL 3106181	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Thrust bearing		BEARING ASSY,THRUST JHJ-5	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	Gaskets		GASKET,BWL T-101204JG	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Boiler Feed Pumps	2350HP Motor, 4160Vac	Motor stored off site via service contract	SCIM, sin# 1026842642, frame MGP450D,	Non-Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	6" - EHT valve 1500lb - Welded		DIAPHRAGM,FISH 2R6376X00	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 10A5411X022 -Seal Ring		RING,FISH 10A5411X022	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 13A5599X052 - O-Ring		O-RING,FISH 13A5599X052	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 26A52990X52 - Seat Ring Retainer		RING,FISH 26A5299X052	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 27A2798X042 - Seat Ring, O-Ring		RING,FISH 27A2798X042	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 42B3570X012 - Cage, Eq%		CAGE,FISH 42B3570X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 36A5366X062 - Plug/Stem Bal		PLUG/STEM,FISH 36A5366X062	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	2 - 26A5314X012 - Gasket		GASKET,FISH 26A5314X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 1J872906332 - Upper Wiper		WIPER,FISH 1J872906332	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 1J873435072 - Packing Box Ring		RING,FISH 1J873435072	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 1R290601012 - Packing Set		PACKING,FISH 1R290601012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 1H7441X0022 - Bushing Seal		SEAL,FISH 1H7441X0022	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - 2R6376X0082 - Diaphragm		DIAPHRAGM,FISH 2R6376X00	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	Main Feed Water Control Valve	1 - R667X000802 - Repair Kit		ACTUATOR KIT,FISHER R667	In Stock
Unit 3 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)	All HP Heaters	Conductivity Probe		PROBE,CONDUCTIVITY	In Stock
Unit 3 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)		Aquarian Alarm Module		PROBE,AQUARIAN	In Stock
Unit 3 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)		Level Transmitter		TRANSMITTER, DP 0-120" H2O	In Stock
Unit 3 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)		Relay		RELAY,OMRON MM4XP-DC125	In Stock
Unit 3 H.P. Feedwater System	H.P. Heater Controls (Water Induction Protection)		Solenoid		SOLENOID,ASCO 8300 125 VDC	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Bushing		BUSHING,DEW 0800109	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Clip		CLIP,DEW 0540097	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Ring		RING,DEW 0760093	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset		Critical Spare				Inventory Status
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Ring		RING,DEW 668215DEW	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Screw		SCREW,DEW 0440024	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Spacer		SPACER,DEW 0660065	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Spring		SPRING,DEW 6580312 (3/SET)	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Stem		STEM,DEW 0040851	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Stud		STUD,DEW 0282351	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Stud		STUD,DEW 0280514	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Packing		PACKING,DEW 6442946	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	Motorized Bypass Valves	Nut		NUT,DEW P71ER250	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	NRV Valves - #6 HP Heater	6" Dia		GASKET,COVER HIT	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	NRV Valves - #5 HP Heater	8" Dia		GASKET,COVER HIT	In Stock
Unit 3 H.P. Feedwater System	H.P. Heaters	NRV Valves - #4 HP Heater	10" Dia		GASKET,COVER HIT	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Stud		STUD,DEW 0280443	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Stud		STUD,DEW 0280513	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Disc		DISC,DEW 051095	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Ring		RING,DEW 0760072	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Ring		RING,DEW 2004920	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Stud		STUD,DEW 0440024	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Nut		NUT, DEW #2003863	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Nut		NUT, DEW 2000006	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Motorized Discharge Valves	Nut		NUT, KEYSTONE 903-735	In Stock
Unit 3 H.P. Feedwater System	Steam Drum	Level Control Transmitters	Transmitter		TRANSMITTER, PRESS 5-800	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Cage		CAGE ASSY, FISH 22A3525X022	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Packing		PACKING, FISH 1R290601012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Plug/Stem		PLUG/STEM, FISH 22A3527X052	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Gasket		GASKET, FISH 10A4155X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Gasket		GASKET, FISH 10A4154X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Ring		RING, FISH 10A4210X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Ring		RING, FISH 12A3529X012	In Stock
Unit 3 H.P. Feedwater System	Feed Water Flow Controls	LL Control Valve	Ring		RING, FISH 11A3306X012	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	Suction Line Safety Valve	1/2" Dia		VALVE, RELIEF 1/2" 110# SE	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Body		BODY, VALVE MASON 37-79264	Procurement Ongoing
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Ring		RING KIT, MASON 01148734399	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Gasket		GASKET, MASON 356154-152-825	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Seal		SEAL, MASON 354810-034-779	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Retainer		RETAINER, MASON 358754-000-163	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Seal		SEAL, MASON 358753-000-210	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Pin		PIN, MASON 971342-023-250	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Stem		STEM, MASON 358738-113-210	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Plug		PLUG, MASON 011509398-206-0000	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Seat		SEAT, MASON 358748-000-596	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Liner		LINER, MASON 011509395-213-0000	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Diaphragm		DIAPHRAGM, MASON 010275-040-77	In Stock
Unit 3 H.P. Feedwater System	Boiler Feed	DA Recirculation Block Valve	Stem		STEM, MASON 770354-027-152	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Feeder to MCC E1 - breaker C4	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Feeder to MCC C12 - breaker C7	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Feeder to Power Centre - breaker C14	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Feeder to Power Centre - breaker C15	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C3	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C5	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C6	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER, EATON 600V	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C8	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C9	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C10	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C11	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C12	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	breaker C13	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Circuit Breaker to Bus - breaker C16	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Circuit Breaker to Bus - breaker C17	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Feeder to MCC - breaker C18	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Circuit Breaker to Bus - breaker C19	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Station Board SB12 (SSB1)			SSB-3 Relay	Shares spare with CGE IACS1 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Relays	Shares spare with CGE IACS1 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Relays	Shares spare with CGE IACS1 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Station Board SB12 (S5B1)			Feeder to transformer ATC breaker SSB-3	Shares spare with Feeder to Station Board - breaker SSB-1, 5HK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB12 (S5B1)			SSB-4 Relay	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB12 (S5B1)			SSB-4 Relay	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB12 (S5B1)			Feeder to Station Board - breaker SSB-2	Shares spare with Feeder to Station Board - breaker SSB-1, 5HK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB12 (S5B1)			Feeder to Station Board - breaker SSB-4	Shares spare with Feeder to Station Board - breaker SSB-1, 5HK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Boiler Area MCC BAB3 - breaker SDB-34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	GPB34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	AC34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	CWP34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	LDP34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	WTP34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Diesel Bus DB34 - Breaker DB34	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Diesel Bus - D2	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Diesel Bus - DBT	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)			breaker ST34 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			breaker ST34 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			breaker TB12 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			breaker TB12 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			breaker SAT34 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			breaker SAT34 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)	TB3 (Tie Breaker Between Station Board SB34 & Unit Board UB3)		TB3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)	TB3 (Tie Breaker Between Station Board SB34 & Unit Board UB3)		TB3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB34 (ST34)			Feeder to Station Board - breaker ST34 & relays	Shares spare with Feeder to Station Board - breaker SSB-1, SHK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB34 (ST34)			Feeder to Station Board - breaker TB12 & relays	Shares spare with Feeder to Station Board - breaker SSB-1, SHK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB34 (ST34)	TB3 (Tie Breaker Between Station Board SB34 & Unit Board UB3)		Circuit Breaker TB3	Shares spare with Feeder to Station Board - breaker SSB-1, SHK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB34 (ST34)			breaker PSM3 & relay	Shares spare with Feeder to transformer SAT34 - breaker SAT34, SHK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

Asset			Critical Spare		
System	Sub-System	Asset	Defined Spare	Notes	Inventory Description
Station Board SB34 (ST34)			breaker TB12 relays	Shares spare with MAVS devices - replaced by ABB SYN5201-0271	SYNCHROTRACT,SYN5201
Station Board SB34 (ST34)			breaker TB12 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
Station Board SB34 (ST34)	TB3 (Tie Breaker Between Station Board SB34 & Unit Board UB3)		TB3 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
Station Board SB34 (ST34)	TB3 (Tie Breaker Between Station Board SB34 & Unit Board UB3)		TB3 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
UB1-1 (Tie Breaker Between Station Board SB12 & Unit Board UB1)			Circuit Breaker UB1-1	Shares spare with Feeder to Station Board - breaker SSB-1.	BREAKER,EATON 4160V 2000A
UB1-1 (Tie Breaker Between Station Board SB12 & Unit Board UB1)			UB1-1 Relay	Shares spare with MAVS devices - replaced by ABB SYN5201-0271	SYNCHROTRACT,SYN5201
UB1-1 (Tie Breaker Between Station Board SB12 & Unit Board UB1)			UB1-1 Relay	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
UB1-1 (Tie Breaker Between Station Board SB12 & Unit Board UB1)			UB1-1 Relay	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
UB2-12 (Tie Breaker Between Unit Board UB2 & Station Board SB12)			Circuit Breaker UB2-12	Shares spare with Feeder to Station Board - breaker SSB-1.	BREAKER,EATON 4160V 2000A
UB2-12 (Tie Breaker Between Unit Board UB2 & Station Board SB12)			UB2-12 Relay	Shares spare with MAVS devices - replaced by ABB SYN5201-0271	SYNCHROTRACT,SYN5201
UB2-12 (Tie Breaker Between Unit Board UB2 & Station Board SB12)			UB2-12 Relay	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
UB2-12 (Tie Breaker Between Unit Board UB2 & Station Board SB12)			UB2-12 Relay	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C
UB2-12 (Tie Breaker Between Unit Board UB2 & Station Board SB12)			UB2-12 Relay	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	Inventory Status
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1) (Alternate Feed Transfer Bus A9)	Feeder to Power Centre A - A1	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1) (Alternate Feed Transfer Bus A9)	Feeder to Power Centre A - A9	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1)	Feeder to transformer LT-A - breaker A3	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1)	Feeder to MCC A1 - breaker A4	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1)	A5	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1)	A6	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1)	A7	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock
Unit Board UB1 (UB1-2)			UB1-4 relay	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB1 (UB1-2)			UB1-9 relay	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB1 (UB1-2)			UB1-11 relay	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB1 (UB1-2)			UB1-2 relays	Shares spare with CGE HFA devices	RELAY,AUXILIARY RXMA- 2	In Stock
Unit Board UB1 (UB1-2)			UB1-2 relays	Shares spare with CGE HFA devices	RELAY,AUXILIARY RXMA- 1	In Stock
Unit Board UB1 (UB1-2)			UB1-2 relays	Shares spare with CGE HFA devices	RELAY,AUXILIARY RXMS- 1	In Stock
Unit Board UB1 (UB1-2)			UB1-2 relays	Shares spare with CGE HFA devices	RELAY,AUXILIARY RXMH- 2	In Stock
Unit Board UB1 (UB1-2)			UB1-3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit Board UB1 (UB1-2)			UB1-3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1) (Alternate Feed Transfer Bus A9)	Relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB1 (UB1-2)			Feeder to Unit Board UB1 - breaker UB1-2	Shares spare with Feeder to Station Board - breaker 5SB-1, 5HK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Unit Board UB1 (UB1-2)			Feeder to transformer ATA breaker UB1-3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-4	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-5	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-6	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-7	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-8	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-9	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-10	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			breaker UB1-11	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB1 (UB1-2)			UB1-2 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Feeder to Power Centre B - breaker B1	Shares spare re-build kit/critical spares kit with other CGE AK breakers.	BREAKER,EATON 600V	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Description	Inventory Status
	Sub-System	Asset	Defined Spare	Notes			
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Feeder to transformer LT-B - breaker B4	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Feeder to MCC B1 - breaker B5	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	B2	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	B6	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	B7	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	B8	Shares spare re-build kit/critical spares kit with other CGE AK breakers.		BREAKER,EATON 600V	In Stock
Unit Board UB2 (UB2-1)			UB2-3 relay	Shares spare with all other P&B Golds devices.		RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB2 (UB2-1)			UB2-4 relay	Shares spare with all other P&B Golds devices.		RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB2 (UB2-1)			UB2-9 relay	Shares spare with all other P&B Golds devices.		RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB2 (UB2-1)			UB2-10 relay	Shares spare with all other P&B Golds devices.		RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB2 (UB2-1)			UB2-1 relays	Shares spare with CGE HFA devices		RELAY,AUXILIARY RXMA-2	In Stock
Unit Board UB2 (UB2-1)			UB2-1 relays	Shares spare with CGE HFA devices		RELAY,AUXILIARY RXMA-1	In Stock
Unit Board UB2 (UB2-1)			UB2-1 relays	Shares spare with CGE HFA devices		RELAY,AUXILIARY RXMS-1	In Stock
Unit Board UB2 (UB2-1)			UB2-1 relays	Shares spare with CGE HFA devices		RELAY,AUXILIARY RXMH-2	In Stock
Unit Board UB2 (UB2-1)			UB2-2 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C		RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB2 (UB2-1)			UB2-2 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C		RELAY,OVERCURRENT SEL 551C	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit Board UB2 (UB2-1)			Feeder to Unit Board - breaker UB2-1 & relays	Shares spare with Feeder to Station Board - breaker SSB-1.	BREAKER,EATON 4160V 2000A	In Stock
Unit Board UB2 (UB2-1)			Feeder to Transformer ATB, breaker UB2-2	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-4	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-5	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-6	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-7	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-8	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-9	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-10	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB2 (UB2-1)			UB2-1 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Relays	Spares spare with CGE IAC51 and ICA53 devices	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Relays	Spares spare with CGE IAC51 and ICA53 devices	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Feeder to Aux Board - breaker UAB-3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Feeder to transformer LDP-3 - breaker LDP-3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Feeder to MCC BAB3 - breaker BAB-3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	AOP3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	TAB3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	ACL2	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Tie Breaker to Station Board - breaker ATB3	Shares spare re-build kit/critical spares kit with other FP breakers.	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Relays	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB3 (UT3)			UT3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)			UT3 relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)			UAT3 Relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)			UAT3 Relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB3 (UT3)			Feeder to Unit Board - breaker UT3	Shares spare with Feeder to Station Board - breaker SSB-1.	BREAKER,EATON 4160V 2000A	In Stock
Unit Board UB3 (UT3)			Feeder to transformer UAT3 - breaker UAT3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit Board UB3 (UT3)			BFE3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			BFW3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			FDE3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			FDW3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			CEN3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			CE33	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			CWE3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			CWW3	Shares spare with Feeder to transformer SAT34 - breaker SAT34, 5HK-VR-250-1200A	BREAKER,EATON 4160V 1200A	In Stock
Unit Board UB3 (UT3)			UT3 relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Relays	Shares spare with other Westinghouse relays - replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C	In Stock
Station Board SB12 (SSB1)			SSB-3 Relay	Replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Station Board SB12 (SSB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Relays	Replaced by SEL701	RELAY,PROTECTION SEL701	In Stock
Station Board SB12 (SSB1)			Feeder to Station Board - breaker SSB-1 & Relays	Direct replacement breaker 5HK-VR-250-2000A	BREAKER,EATON 4160V 2000A	In Stock
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB SYN5201-0271	SYNCHROTRACT, SYN5201	In Stock
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB SPAU121C	RELAY,VOLTAGE ABB SPAU121C	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB RXMA/RXMH	RELAY,AUXILIARY RXMA-2	In Stock
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB RXMA/RXMH	RELAY,AUXILIARY RXMA-1	In Stock
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB RXMA/RXMH	RELAY,AUXILIARY RXMS-1	In Stock
Station Board SB12 (SSB1)			SSB-1 Relay	Replaced by ABB RXMA/RXMH	RELAY,AUXILIARY RXMH-2	In Stock
Station Board SB34 (ST34)			breaker PSM3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB1 (UB1-2)			UB1-5 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB1 (UB1-2)			UB1-6 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB1 (UB1-2)			UB1-7 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB1 (UB1-2)			UB1-8 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB1 (UB1-2)			UB1-10 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB2 (UB2-1)			UB2-5 relay	Replaced by SEL701	RELAY,PROTECTION SEL701	In Stock
Unit Board UB2 (UB2-1)			UB2-6 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB2 (UB2-1)			UB2-7 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB2 (UB2-1)			UB2-8 relay	Replaced by SEL701	RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			BFE3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			BFW3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			FDE3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			FDW3 relay		RELAY,PROTECTION SEL701	In Stock

Inventory Status

In Stock

Non Stock

Procurement Ongoing

Critical Spares - Thermal Generation

Explanation

Stock quantity of '1' or more in warehouse inventory

Item is not stocked, '0' quantity in Warehouse, ordered as required. See NOTES.

Quantity of '0' stock in warehouse, procurement ongoing for quantity of 1 or more.

NOTE: Items may be listed as critical for multiple components, resulting in multiple "Procurement Ongoing" Status'.

System	Asset		Critical Spare			Inventory Status
	Sub-System	Asset	Defined Spare	Notes	Inventory Description	
Unit Board UB3 (UT3)			CEN3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			CES3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			CWE3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)			CWW3 relay		RELAY,PROTECTION SEL701	In Stock
Unit Board UB3 (UT3)	Unit Aux Transformer (UAT3)	Aux Board UAB3 (UAB3)	Relays		RELAY,PROTECTION SEL701	In Stock
Station Board SB12 (SB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1) (Alternate Feed Tie Breaker to Transfer Bus C15)	Feeder to Power Centre - breaker C1	Purchasing re-build kit/critical spares kit for AK-150 frame breaker	BREAKER,EATON 600V	In Stock
Station Board SB12 (SB1)	Aux Transformer ATC - SSB3	Power Center C SAB12 (C1)	Feeder to MCC C1 - breaker C2	Purchasing re-build kit/critical spares kit for AK-2-25 frame breaker	BREAKER,EATON 600V	In Stock
Station Board SB34 (ST34)			Feeder to transformer SAT34 - breaker SAT34 & relays	Direct replacement breaker 5HK-VR-250 1200A	BREAKER,EATON 4160V 1200A	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Station Board - breaker SAB34	Purchasing re-build kit/critical spares kit for 65H frame breaker	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	Feeder to Station Board - breaker ATB12	Purchasing re-build kit/critical spares kit for 50H-2 frame breaker	BREAKER,SCHNEIDER 600V	In Stock
Station Board SB34 (ST34)	Station Aux Transformer (SAT34)	Station Aux Board (SAB34)	WAM34	Purchasing re-build kit/critical spares kit for 50H-3 frame breaker	BREAKER,SCHNEIDER 600V	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1) (Alternate Feed Transfer Bus A9)	Relays	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock
Unit Board UB1 (UB1-2)	UB13 (Aux Transformer ATA)	Power Center A UAB1 (A1) (Alternate Feed Transfer Bus A9)	Relays	Shares spare with CGE IAC51 and ICA53 devices - replaced by SEL-551C	RELAY,OVERCURRENT SEL 551C	In Stock
Unit Board UB2 (UB2-1)	Aux Transformer ATB (UB22)	Power Center B UAB2 (B1)	Relays	Shares spare with all other P&B Golds devices.	RELAY,RETRO. PBSJ3ESN11	In Stock

Appendix D

Status of Winter Readiness Testing of Plant and Equipment Testing for Thermal Generation



26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Plant: Holyrood Operations			
Following Annual Outages, Unit is Run Up, Synchronized and all Systems Verified Before Operating Status Determined, as per Energy Control Centre ("ECC"), Prior to Coming Winter Operating Season to Ensure Preparedness. A Unit Load Test is Performed at This Time.			
Black Start Test of the Black Start Systems is Performed Prior to the Winter Operating Season	N/A	N/A	Y
Perform Megger Testing of 600 V Motors Prior to the Winter Operating Season	N/A	N/A	N/A

Safety			
Boiler Service Pressure Test Performed as Required by Regulator	Y	S/U	S/U
Safety Valves Testing as Required (Post Start-Up)	S/U	S/U	S/U
Boiler Operational Offline High/Low Drum Level Trip Tests	Y	S/U	S/U
Hydrogen ("H ₂ ") Emergency Venting Valving	S/U	S/U	S/U
Breaker and Disconnect Operation Verified by Operations Department and Whitbourne Crew	Y	S/U	S/U

Service Air and Instrument Air Systems			
All Stationary Air Compressors Available	N/A	N/A	N/A
All Portable Air Compressors Available	N/A	N/A	N/A
Air Compressor Operational Checks Performed (e.g., Oil Levels, Cooling Water, etc.)	N/A	N/A	N/A
Air Compressor Standby/Sequencing Capability	N/A	N/A	N/A

Raw and Makeup Water System			
Quarry Brook Dam Integrity	N/A	N/A	N/A
Raw Water Sump Water Supply Control Valve Operational	N/A	N/A	N/A
Raw Water Pumps Operational	N/A	N/A	N/A
Adequate Supply of Chemicals (1172, 1179, Polymer, etc.)	N/A	N/A	N/A
1172, 1179, Polymer Injection Pumping Sets, Pumps, Valves, Lines, Agitators, etc. Operational	Y	Y	Y
Portable Diesel Pump Check of Emergency Plant Water Supply from Quarry Brook Dam	N/A	N/A	N/A
Adequate and Readily Available Supply of Hoses for the Portable Diesel Pump from Quarry Brook Dam to Plant	N/A	N/A	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Raw and Makeup Water System and Water Treatment Plant				
Instrumentation and Controls Operational	Y	S/U	S/U	N/A
Analytical Rack Sample Cooler Filters Cleaned/Replaced as Required	Y	S/U	S/U	N/A
Analytical Rack Sample Coolers Cooling Water In Service	Y	S/U	S/U	N/A
Two Sample Cooling Water Pumps Availability	N/A	N/A	N/A	Y

Clarifier				
Clarifier Recirculator, Variable Frequency Drive ("VFD") Motor, VFD Controller	N/A	N/A	N/A	Y
Clarifier Recirculator Scraper	N/A	N/A	N/A	Y
Clarifier Badger Meter and Clearwell Instrumentation	N/A	N/A	N/A	Y

Sand Filters				
Sand Filters (Nos. 1, 2 and 3) Resin Integrity	N/A	N/A	N/A	Y
Sand Filters (Nos. 1, 2 and 3) Valve Operation (Normal and Backwashing, etc.)	N/A	N/A	N/A	Y
Two Clearwell Pumps Available	N/A	N/A	N/A	Y

Demineralization System				
Cation and Anion Trains (A, B and C) Resin Integrity	N/A	N/A	N/A	Y
Adequate Supply of Chemicals (Caustic Soda, Sulphuric Acid, 1172, 1179, Polymer, etc.)	N/A	N/A	N/A	Y
Sulphuric Acid and Caustic Soda Transfer Pumps, Valves, Lines, etc.	N/A	N/A	N/A	Y
Sulphuric Acid and Caustic Soda Regeneration Sets, Pumps, Valves, Lines, etc.	N/A	N/A	N/A	N
Caustic Injection Pumping Sets, Pumps, Valves, Lines, Agitators, etc.	N/A	N/A	N/A	Y
Brine Injection Pumping Sets, Pumps, Valves, Lines, Agitators, etc.	N/A	N/A	N/A	Y

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Reserve Feedwater System ("RFW")				
RFW Transfer Pump Oil Normal Operating Level	Y	Y	Y	N/A
RFW Transfer Pumps Operational	Y	Y	S/U	N/A

Circulating Water ("CW") and Screen Wash System				
Vacuum Seal Pits Operational	Y	S/U	S/U	N/A
All CW Travelling Screens Operational	Y	S/U	S/U	N/A
CW Pump Motorized Discharge Valves 'Manual' and 'Auto', 'Cracked' Position Operation Verified	Y	S/U	S/U	N/A
CW Pump Motors Oil Normal Operating Level	Y	S/U	S/U	N/A
CW Pumps Operational	Y	S/U	S/U	N/A
CW Pump Discharge Vacuum Breakers Operational	Y	S/U	S/U	N/A
CW Travelling Screens Wash Pumps Operational	Y	S/U	S/U	N/A
Condenser Flushed	Y	S/U	S/U	N/A
Condenser Backwashed	Y	S/U	S/U	N/A
General Service ("GS") Coolers Backwashed, Cleaned, etc.	Y	S/U	S/U	N/A
Turbine/Generator ("TG") Coolers Backwashed, Cleaned, etc.	Y	S/U	S/U	N/A
Vacuum Pump Coolers Backwashed, Cleaned, etc.	Y	S/U	S/U	N/A

Boiler				
Pre-Outage Valve Survey Conducted of Boiler Drains	Y	Y	Y	N/A
Service Pressure Test on Boiler for Tube Leaks	Y	S/U	S/U	N/A

Condenser Air Extraction System				
Vacuum Pumps Available and Tested for Standby 'Auto-Start'	Y	S/U	S/U	N/A
Vacuum Pump Seal Water Tank Water Level Controller Operational	Y	S/U	S/U	N/A
Vacuum Pump Seal Water Pump Operational	Y	S/U	S/U	N/A
Condenser Vacuum Breakers Operational	Y	S/U	S/U	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

High Pressure ("HP") Feedwater System				
Boiler Feed Pumps				
Boiler Feed Pumps Available	Y	S/U	S/U	N/A
Boiler Feed Pump Oil Tank Normal Operating Level and Checked for Moisture Content	Y	S/U	S/U	N/A
Boiler Feed Pump Auxiliary Oil Pumps Available	Y	S/U	S/U	N/A
Boiler Feed Pump Suction Valves and Limit Switches	Y	S/U	S/U	N/A
Boiler Feed Pump Emergency Gland Seal Injection Pump Available	Y	S/U	S/U	N/A
Boiler Feed Pump Emergency Gland Seal Pump Oil Normal Operating Level	Y	S/U	S/U	N/A
Boiler Feed Pump Gland Seal Water Available from the Emergency Pump and Condensate Extraction Pumps	Y	S/U	S/U	N/A
Boiler Feed Pump Gland Seal Water Control Valve Operational	Y	S/U	S/U	N/A
Boiler Feed Pump Gland Seal Water Drains Tank Level Float Operated Valve Operational (Units 1 and 2)	Y	S/U	N/A	N/A
Boiler Feed Pump Gland Seal Water Transfer Pumps Operational (Units 1 and 2)	Y	S/U	N/A	N/A
Boiler Feed Pump Gland Seal Water Drains Tank Level Control Valve Operational (Unit 3)	N/A	N/A	S/U	N/A
Boiler Feed Pump Gland Seal Water Transfer Pumps Operational (Unit 3)	N/A	N/A	S/U	N/A
Boiler Feed Pump Recirculation Control Valves Operational	Y	S/U	S/U	N/A
Boiler Feed Pump Motorized Discharge Pilot and Main Valves Operational	Y	S/U	S/U	N/A
Low Load Feedwater Isolator and Control Valves Operational	Y	S/U	S/U	N/A
Main Feedwater Isolator and Control Valves Operational	Y	S/U	S/U	N/A
HP Heater Motorized Valves (Inlet, Outlet and Bypass) Checked for Proper Operation, Sequencing, etc.	Y	S/U	S/U	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Miscellaneous			
Economizer 'Manual' Operated Valve Operational	Y	S/U	S/U
Economizer Motorized Recirculation Valve Operational (Unit 3)	N/A	N/A	S/U
Boiler Drum Level Instrumentation Operational	Y	S/U	S/U
HP Heater Bled Steam Check Valves Operational	Y	S/U	S/U
Start-Up Desuperheater Steam and Water Valving Operation/Position Verified	Y	S/U	S/U
Main Steam and Reheat Steam Desuperheater Spray Water Isolators and Control Valves Operational	Y	S/U	S/U
Auxiliary Steam Desuperheater Spray Water Control Valve Operational	Y	S/U	S/U

Low Pressure ("LP") Feedwater System			
Condenser			
Condenser Hotwell Makeup/Surplus Control Valves Operation Verified	Y	S/U	S/U
Condenser Hotwell Makeup Motorized Isolating Valve Operation Verified	Y	S/U	S/U
Condenser Dye Test for Leaks, as Required	Y	S/U	S/U

Ammonia and Control System			
Adequate Supply in Place	Y	S/U	S/U
Pumps Operational	Y	S/U	S/U
Control Instrumentation Operational	Y	S/U	S/U

Condensate Extraction Pumps			
Condensate Extraction Pumps Available	Y	S/U	S/U
Condensate Extraction Pump Motors Bearing Oil Normal Operating Level	Y	S/U	S/U
Condensate Extraction Pump Motor Cooling Water Available (Unit 3)	N/A	N/A	S/U

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Condensate Polishers			
Resin Integrity Verified	Y	S/U	S/U
Two Polishers Rinsed and Available	Y	S/U	S/U
Valve Operation (Normal and Regenerating, etc.)	Y	S/U	S/U
Regeneration System Skids Available (Valving, Pumps, Flowmeters, Tanks, etc.)	Y	S/U	S/U
Condensate Polisher Bypass Control Valve Operational	Y	S/U	S/U

LP Heaters			
Low Load Recirculation Control Valve Operation	Y	S/U	S/U

Deaerator			
Deaerator Normal Operating Level	Y	S/U	S/U
Deaerator Steam Coil Operational	Y	S/U	S/U
Deaerator Pegging Steam Operational	Y	S/U	S/U
Deaerator Low Level Trip Test	Y	S/U	S/U

Miscellaneous			
Condenser Flash Tank Control Valve Operation/Position	Y	S/U	S/U
Turbine LP Exhaust Hood Spray Motorized Valve Operation	Y	S/U	S/U
Start-Up Desuperheater Steam and Water Valving Operational (Units 1 and 2)	Y	S/U	N/A
LP Heater Bled Steam Check Valves Operational	Y	S/U	S/U

Bled Steam and Heater Drains System			
LP and HP Instrumentation and Control Operational	Y	S/U	S/U
LP and HP Heater Level Control Operational	Y	S/U	S/U
LP Heater Condensate Drains Pumps Operational	N	N	N
#4 HP Heater Condensate Drains Pump Operational	N	S/U	S/U

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Air and Flue Gas System				
Instrumentation and Control Operational	Y	S/U	S/U	N/A

Forced Draft ("FD") Fans and Air Dampers				
Two FD Fans Available	Y	S/U	S/U	N/A
Bearing Oil Normal Operating Level	Y	S/U	S/U	N/A
Cooling Water on to Fans	Y	S/U	S/U	N/A
Stroke Variable Inlet Vanes	Y	S/U	S/U	N/A
Stroke Discharge Dampers	Y	S/U	S/U	N/A
FD Fan Motor Variable Speed Drives Operational	N/A	N/A	N/A	N/A
All Burner Auxiliary Air Dampers/Positioners Operation (Units 1 and 2)	Y	S/U	N/A	N/A
All Elevation Air Flow Dampers/Positioners Operation (Unit 3)	N/A	N/A	S/U	N/A

Rotary Air Heaters				
Rotary Air Heaters Operational	Y	S/U	S/U	N/A
Rotary Air Heaters Bearing Oil (Top and Bottom) Normal Operating Level	Y	S/U	S/U	N/A
Rotary Air Heaters Bearing Cooling Water On	Y	S/U	S/U	N/A
Rotary Air Heaters Electric Motor Drives Operational	Y	S/U	S/U	N/A
Rotary Air Heaters Air Supply to Air Heater Air Motor Drives Open	Y	S/U	S/U	N/A
Rotary Air Heaters Start-Up of Air Motor Drive Upon Loss of Alternating Current ("AC") Power Supply to the Normal Operating Electric Drive Motor	Y	S/U	S/U	N/A
Rotary Air Heaters Steam Supply Control Valves Operational (*Note: Two Steam Supplies on Units 1 and 2)	Y	S/U	S/U	N/A
Rotary Air Heaters Sootblowers Operational	Y	S/U	S/U	N/A

Boiler Sootblowing System				
Sootblower Control Panel Operational	Y	S/U	S/U	N/A
Sootblowers Steam Supply Control Valve Operational	Y	S/U	S/U	N/A
Sootblowers Overhauled During Annual Outage Verify Operation (e.g., Rotation, Travel Advancing/Retracting from Furnace, Leaks, etc.) First Time Unit is Placed Online	Y	S/U	S/U	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Light Fuel Oil System			
Hydro Pad Operational	Y	S/U	S/U
Light Oil Pumps Available	Y	S/U	S/U
Pumps, Valves (Including Control and Trip), Lines, Strainers, Pressure (Locally and UCB)	Y	S/U	S/U
Check Light Oil Supply and Return Lines to/from Plant Respectively	Y	S/U	S/U
Suction Strainers Cleaned with Covers Secured	Y	S/U	S/U
Ignitors Cleaned, Securely in Place with Associated Lines Securely Fastened	Y	S/U	S/U
Ignitors all Checked for Operation During Unit Start-Up (e.g. Ignitor Control Box, Valve Operation, Lighting, etc.)	Y	S/U	S/U

Fuel Oil Delivery System, Auxiliary Steam and Fuel Oil Piping System			
Adequate Heavy Oil Storage	N/A	N/A	N/A
Heavy Oil Piping from Dock to Tankfarm, Tankfarm to Plant Day Tank and Day Tank to Heavy Oil Sets	N/A	N/A	N/A
Adequate Light Oil Storage	N/A	N/A	N/A
Light Oil Piping from Road Tanker Transfer Pump to Tanks and from Tanks to Light Oil Sets in Plant	N/A	N/A	N/A
All Storage Tanks Suction Heaters Available when Required	N/A	N/A	N/A
All Storage Tanks Platform Heaters Available when Required	N/A	N/A	N/A
Auxiliary Steam for Suction Heaters Available	N/A	N/A	N/A
Auxiliary Steam for Platform Heaters Available	N/A	N/A	N/A
Auxiliary Steam for Heat Tracing Available	N/A	N/A	N/A
Electrical Heat Tracing for Fuel Oil Lines Available	N/A	N/A	N/A
Day Tank Supply Line Trip Valve Tested	N/A	N/A	N/A
Day Tank Available to Receive Oil	N/A	N/A	N/A
Day Tank Steam Coil Available	N/A	N/A	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Fuel (Heavy) Oil System			
Fuel Oil Heating Sets	Y	S/U	S/U
Fuel Oil Heaters Available	Y	S/U	S/U
Fuel Oil Heaters Cleaned and Inspected	Y	S/U	S/U
Steam Supply to Heavy Oil Set Heaters Available as Required	Y	S/U	S/U
Fuel Oil Heaters Temperature Steam Control Valve Operational	Y	S/U	S/U
Suction Strainers Cleaned (including standby and extras) with Covers Secured	Y	S/U	S/U
Fuel Oil Accumulator Operational	N	N	S/U
Fuel Oil Pumps Available	Y	S/U	S/U
Pumps 'Auto-Start' Check Offline	Y	S/U	S/U
Header Pressure Control Valve Operational	Y	S/U	S/U
Fuel Oil Meter Operational	Y	S/U	S/U

Fuel Oil Supply Control, Trip, Long and Short Recirculation Valves			
Fuel Oil Supply Control Valve Operational	Y	S/U	S/U
Fuel Oil Trip Valve Operational	Y	S/U	S/U
Fuel Oil Long Recirculation Valve Operational (Units 1 and 2)	Y	S/U	N/A
Fuel Oil Short Recirculation Valve Operational (Units 1 and 2)	Y	S/U	N/A
Elevation Fuel Oil Trip Valves Operational (Unit 3)	N/A	N/A	S/U
Elevation Fuel Oil Minimum Supply Control Valves Operational (Unit 3)	N/A	N/A	S/U
Elevation Fuel Oil Supply Control Valves Operational (Unit 3)	N/A	N/A	S/U
Main Fuel Oil Recirculation Valve Operational (Unit 3)	N/A	N/A	S/U
Elevation Recirculation Valves Operational (Unit 3)	N/A	N/A	S/U

Burners			
All Burners Cleaned, Securely in Place with Associated Lines Securely Fastened	Y	S/U	S/U
All Burners Checked for Operation During Unit Start-Up (e.g. Advancing/Retracting, Valve Operation, Lighting, etc.)	Y	S/U	S/U
All Burner Tilts Checked for Operation (Units 1 and 2)	Y	S/U	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Fuel Additive System			
Adequate Supply Available	N/A	N/A	N/A
Pumps Available	N/A	N/A	N/A
Tanks, Agitators, etc. Available	N/A	N/A	N/A

GS System			
GS Heat Exchangers Backwashed, Cleaned, etc.	Y	S/U	S/U
Stage I GS Plate Cooler Strainers Cleaned	Y	S/U	S/U
Stage I GS 'Auto-Clean' Strainer Operational	N/A	N/A	N/A
Stage I GS Duplex Strainers Cleaned	Y	S/U	N/A
GS Pump Suction Strainers Cleaned	Y	S/U	S/U
GS Pump Oil Normal Operating Level	Y	S/U	S/U
GS Pumps Available and Tested for Standby 'Auto-Start'	Y	S/U	S/U

TG Auxiliary Cooling System			
TG Head Tank Normal Operating Level	Y	S/U	S/U
Turbine Lube Oil Coolers Operational	Y	S/U	S/U
TG Heat Exchangers Backwashed, Cleaned, etc.	Y	S/U	S/U
TG Pump Oil Normal Operating Level	Y	S/U	S/U
TG Pumps Available and Tested for Standby 'Auto-Start'	Y	S/U	S/U

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.



Holyrood Thermal Generating Station
Winter Readiness Testing

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

TG System			
Hydraulic System Units 1 and 2			
Hydraulic System Accumulators Operational	Y	S/U	N/A
Hydraulic System Storage Tank Normal Operating Level and Checked for Moisture Content	Y	S/U	N/A
Hydraulic System Storage Tank Air Purging of Moisture in Place	Y	S/U	N/A
Hydraulic Set Primary, Secondary Filter Indications Ok	Y	S/U	N/A
Two Hydraulic Fluid Pumps Availability	Y	S/U	N/A
Hydraulic Pump Auto-Start Testing	Y	S/U	N/A
Two Hydraulic Fluid Pump Coolers Availability	Y	S/U	N/A

Valves			
Pre-Outage Valve Survey Conducted of Boiler Drains	Y	S/U	N/A
Turbine Main Stop Valve Testing (Units 1 and 2)	Y	S/U	N/A
Turbine Two Main Stop Valves Testing (Unit 3)	N/A	N/A	N/A
Turbine 'Left-Hand' and 'Right Hand' Reheat Stop and Intercept Control Valve Testing Verified	Y	S/U	N/A
Turbine Six Main Control Valve Operation (Units 1 and 2)	S/U	S/U	N/A
Turbine Four Main Control Valve Operation (Unit 3)	N/A	N/A	N/A
Turbine Blowdown Valve Operation	Y	S/U	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.



Hollyrood Thermal Generating Station
Winter Readiness Testing

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Lubricating System			
Lube Oil Tank Normal Operating Level and Checked for Moisture Content	Y	S/U	S/U
Portable Centrifuge Operational	N/A	N/A	N/A
Lube Oil Tank Vapor Extractor Operation	Y	S/U	S/U
Bowser Oil Conditioner Vapor Extractor Operation (Units 1 and 2)	S/U	S/U	N/A
Two ac Lube Oil Pumps Available and Tested for Standby 'Auto-Start' (Units 1 and 2)	Y	S/U	N/A
Direct Current ("DC") Pump Testing and Starting from UCB (Units 1 and 2)	Y	S/U	N/A
Verify Discharge Pressure of Each AC Lube Oil Pumps (Locally and UCB) (Units 1 and 2)	Y	S/U	N/A
Verify Discharge Pressure of DC Lube Oil Pump (Locally and UCB) (Units 1 and 2)	Y	S/U	N/A
Jacking Oil Pump Testing and Starting from UCB (Unit 3)	N/A	N/A	S/U
Verify Discharge Pressure of Jacking Oil Pump (Locally and UCB)	N/A	N/A	S/U
Auxiliary Oil Pump ("AOP") Testing and Starting from UCB and Turbine Lube Oil Tank (Unit 3)	N/A	N/A	S/U
Verify Discharge Pressure of AOP Pump (Locally and UCB) (Unit 3)	N/A	N/A	S/U
AC Pump Testing and Starting from UCB and Turbine Lube Oil Tank (Unit 3)	N/A	N/A	S/U
Verify Discharge Pressure of AC Flushing Oil Pump (Locally and UCB) (Unit 3)	N/A	N/A	S/U
DC Pump Testing and Starting from UCB and Turbine Lube Oil Tank (Unit 3)	N/A	N/A	S/U
Verify Discharge Pressure of DC Flushing Oil Pump (Locally and UCB) (Unit 3)	N/A	N/A	S/U

Barring/Turning Gear			
Turning Gear Operation Verified	Y	S/U	S/U
Perform Trip Test of Turning Gear	Y	S/U	S/U

Miscellaneous			
Steam Seal Regulator Operational	Y	S/U	S/U
Operational Online/Offline Overspeed Trip Tests	Y	S/U	S/U

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

H₂ and Carbon Dioxide ("CO₂") System			
H₂ Generation and Storage System			
System in Operation	N/A	N/A	Y
Electrolyzer/H ₂ Generator Operational	N/A	N/A	N/A
Chiller Operational	N/A	N/A	N/A
DI Water Purifier Operational	N/A	N/A	N/A

H₂ and CO₂ Bulk Packs			
Adequate H ₂ Bulk Packs on Hand for Contingency Purposes	N/A	N/A	Y
CO ₂ Adequate Bulk Packs on Hand	N/A	N/A	Y

Generator			
Generator Exciter Operation Checked Offline and Online	Y	S/U	S/U
Seal Oil System Tested with 'Air' on Generator in Preparation for Leak Testing	Y	S/U	S/U
Seal Oil Regulator Operational	Y	S/U	S/U
AC Seal Oil Pumps Available and Tested for Standby 'Auto-Start' (Units 1 and 2)	Y	S/U	N/A
AC Seal Oil Pump Available (Unit 3)	N/A	N/A	S/U
DC Seal Oil Pump Available and Tested for Standby 'Auto-Start'	Y	S/U	S/U
Seal Oil Vacuum Pumps Available	Y	S/U	S/U
Vacuum Tank Level Control Operational	Y	S/U	S/U
H ₂ System in Operation and/or Adequate Bulk Packs on Hand for Contingency Purposes	N/A	N/A	Y
CO ₂ Adequate Bulk Packs on Hand	N/A	N/A	Y
Leak Testing Performed Prior to 'Gassing Up' Generator	Y	S/U	S/U
Purity, Dew Point, etc. Instrumentation Operation Verified	Y	S/U	S/U

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

26-Sep-25

Status of Test		
Unit 1	Unit 2	Unit 3
Balance of Plant		

Powerhouse and Switchyard Single Line			
Plant 129 V System			
129 V Battery Banks Checked Stage I and II	Y	Y	Y
129 V Battery Chargers Checked Stage I and II	Y	Y	Y
Plant 258 V System			
258 V Battery Banks Checked Stage I and II	Y	Y	Y
258 V Battery Chargers Checked Stage I and II	Y	Y	Y
Plant Uninterrupted Power Supplies ("UPS")			
Nos. 1, 2, 3 and 4 UPS including Batteries, Cooling Fans, etc., Checked	Y	Y	Y
Emergency Diesel Generators			
Stage I and II Emergency Diesel Generators Tested for Emergency Stop	N/A	N/A	N/A
Stage I and II Emergency Diesel Generators Tested for Manual and Auto-Start Operation along with Auto Breaker Closure as well as Emergency Manual Closing of Breakers	N/A	N/A	N/A
Diesel Bus Tie Breaker Operation Verified	N/A	N/A	N/A
Fire Protection System			
All Fire Protection Zones in Service	N/A	N/A	N/A
Fire Control/Alarm Panel Status	N/A	N/A	N/A
Fire Alarm Beacons Operational	N/A	N/A	N/A
Diesel Fire Pump Checked for 'Manual' and 'Auto' Start, etc.	N/A	N/A	N/A
Diesel Fire Pump Controller, Charger and Battery Check	N/A	N/A	N/A
Electric Fire Pump Checked for 'Manual' and 'Auto' Start, etc.	N/A	N/A	N/A
Electric Fire Pump Controller Check	N/A	N/A	N/A
Public Address System Status	N/A	N/A	N/A

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.

Y - Test completed.

N/A - Not Applicable for specific unit or Balance of Plant, as indicated.



Holyrood Thermal Generating Station
Winter Readiness Testing

26-Sep-25

Status of Test			
Unit 1	Unit 2	Unit 3	Balance of Plant

Holyrood Main Powerhouse			
Backup ECC and Guardhouse Propane Generator	N/A	N/A	N/A
			Y

Plant Air Conditioning System			
Control and Relay Rooms	N/A	N/A	N/A
UPS #1 Room	N/A	N/A	N/A
Generator Excitation and UPS #'s 2, 3 and 4 Room (Unit 3)	N/A	N/A	N/A
			Y

Plant Heating Steam			
All Systems Operational for When Required	N/A	N/A	N/A
			Y

S/U - Final confirmation completed during Start Up. When possible, test also completed during annual outage.
Y - Test completed.
N/A - Not Applicable for specific unit or Balance of Plant, as indicated.

Appendix E

Critical Spares Status Listing for Combustion Turbine Generation





Critical Spares Status
Hardwoods and Stephenville – Gas Turbines
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
High Energy Ignition Unit, Gas Generator, Prime Mover Systems	In Stock	High	N/A	
Bearing (494047), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Bearing (494056), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Vibration Transducer, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Jacking Oil Pump, Main Lube Oil System, Auxiliary Systems	In Stock	High	N/A	
Fuel Filter, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Oil Filter Unit - Complete (B.108506), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Filter (494064), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Proximity Switch, Clutch, Prime Mover Systems	In Stock	Medium	N/A	
Altair Quick Shutoff Valve (AV-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	High	N/A	
Fuel Valve (FC-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	High	N/A	
Fuel Recirculation Solenoid Valve (LF-7), Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Fuel Regulator (LF-4), Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Jacking Oil Permissive Pressure Switch, Main Lube Oil System, Auxiliary Systems	In Stock	High	N/A	
Valve (181536), Power Turbine Model CT2, Prime Mover Systems	In Stock	Low	N/A	
Primary Ratchet Ring, Clutch, Prime Mover Systems; A side	In Stock	High	N/A	
Primary Ratchet Ring, Clutch, Prime Mover Systems; B side	In Stock	High	N/A	
Secondary Ratchet Ring, Clutch, Prime Mover Systems; A side	In Stock	High	N/A	
Secondary Ratchet Ring, Clutch, Prime Mover Systems; B side	In Stock	High	N/A	
Ring that the Primary Pawl and spring are installed	In Stock	Medium	N/A	
Primary Pawl Spring, Clutch, Prime Mover Systems	In Stock	High	N/A	
Primary Pawl, Clutch, Prime Mover Systems	In Stock	High	N/A	
Secondary Pawl, Clutch, Prime Mover Systems	In Stock	Medium	N/A	
Limit Switch, Snow Door Assembly, Exhaust, Prime Mover Systems, SVL GT	In Stock	Medium	N/A	
Thermocouple (181398N1), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Speed Pickup (181487), Power Turbine Model CT2, Prime Mover Systems	In Stock	High	N/A	
Thermocouple (181397), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Thermocouple (181398N2), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Probe (181414N1), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Probe (181414N2), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Thermocouple (184847), Power Turbine Model CT2, Prime Mover Systems	In Stock	High	N/A	
Motor Operated Tank Shutoff Valve (LF-38), Liquid Fuel System, Auxiliary Systems, HWD GT	In Stock	High	N/A	
Final Fuel Filter (F-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Heater Filter Coalescer, Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Prefilter, Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
High Efficiency Farr HP-100 Filter (2'x2'x2"), Filter Box - Curtiss Wright, Prime Mover Systems	In Stock	Medium	N/A	
Filter (F-GGLO-1), Gas Generator Lube Oil System, Auxiliary Systems	In Stock	High	N/A	
Unloading Filter, Liquid Fuel System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Duplex 25u Filter (F-LO-1), Main Lube Oil System, Auxiliary Systems	In Stock	Medium	N/A	
Filter/Coalescer Heater (HTR-LF-1), Liquid Fuel System, Auxiliary Systems, HWD GT	In Stock	Medium	N/A	
P3 Pressure Transducer (PT-P3-1), Liquid Fuel System, Auxiliary Systems	In Stock	High	N/A	



Critical Spares Status
Hardwoods and Stephenville – Gas Turbines
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
Fuel Supply Thermocouple (TC-LF-1), Liquid Fuel System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Alternator Cooling Air Temperature Thermocouple (TC-A-1), Alternator Cooling System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Common Drain Clutch B Thermocouple (TC-LO-11), Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Compressor Start-Stop Pressure Switch (PS-CA-1), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Compressor Start-Stop Pressure Switch (PS-CA-2), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Anti-Icing Hot Air Valve - Complete (810-501-0747), Gas Generator, Prime Mover Systems	In Stock	Low	N/A	
Gas Generator Permissive Start Pressure Switch, Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Starter Overpressure Pressure Switch (PS-CA-3), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Pressure Regulating Valve (LO-8), Main Lube Oil System, Auxiliary Systems	In Stock	Medium	N/A	
Inlet Temperature Thermocouple, Gas Generator Enclosure with Septum Doors, Prime Mover Systems	In Stock	Medium	N/A	
Resistance Temperature Detector Probe, Gas Generator Enclosure with Septum Doors, Prime Mover Systems	In Stock	Medium	N/A	
NC Solenoid Valve (SV-CA-3), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Combustion Chamber, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Lower Fuel Pump Assembly, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Outer Fuel Pump Drive Assembly (BDA.7591), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Upper Fuel Pump Assembly, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Exciter Bearing, 63MVA 50MW Generator, Power Generation Systems	In Stock	High	N/A	
Rotor Bearing, 63MVA 50MW Generator, Power Generation Systems	In Stock	High	N/A	
Pressure Switch, Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Oil to Clutch A Pressure Transducer (PT-LO-1), Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	High	N/A	
Fuel Pressure Transducer (PT-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Oil Pump - Complete, Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Outer Oil Pump Drive Assembly (47-1-1-006409), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Outer Starter Drive Assembly (BDA.1153), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
Scavenge Pump Assembly (47-1-1-006418), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
HP Compressor Magnetic Pickup, Gas Generator, Prime Mover Systems	In Stock	Low	N/A	
LP Compressor Magnetic Pickup, Gas Generator, Prime Mover Systems	In Stock	Low	N/A	
Low Liquid Level Alarm Switch (LL-GL-1), MLO/Glycol Cooling System, Auxiliary Systems	In Stock	Medium	N/A	
Heater Control Temperature Switch (TS-GLO-1), Gas Generator Lube Oil System, Auxiliary Systems	In Stock	Medium	N/A	
Heater Control Temperature Switch (TS-LO-1), Main Lube Oil System, Auxiliary Systems	In Stock	Medium	N/A	
Final Fuel Filter Differential Pressure Switch (PSD-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	Medium	N/A	
Inlet Pressure Transducer, Gas Generator Enclosure with Septum Doors, Prime Mover Systems	In Stock	Medium	N/A	
Clutch Control Solenoid Valve (LO-6), Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	Medium	N/A	
Proximity Switch, Snow Door Assembly, Exhaust, Prime Mover Systems, HWD GT	In Stock	Low	N/A	
Vibration Pickup (181571), Power Turbine Model CT2, Prime Mover Systems	In Stock	Medium	N/A	
Liquid Fuel Burner - Complete (BDC.3026), Gas Generator, Prime Mover Systems	In Stock	Medium	N/A	
NC Solenoid Valve (SV-CA-2), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
NO Solenoid Valve (SV-CA-1), Gas Generator Air Starter System, Auxiliary Systems	In Stock	High	N/A	
Pressure Switch, Main Lube Oil System, Auxiliary Systems	In Stock	High	N/A	
Pressure Switch, Liquid Fuel System, Auxiliary Systems, HWDGT	In Stock	Medium	N/A	
Pressure Switch, Gas Generator Lube Oil System, Auxiliary System, HWDGT	In Stock	Medium	N/A	



Critical Spares Status
Hardwoods and Stephenville – Gas Turbines
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
3-Way Thermostatic Valve (GL-2), MLO/Glycol Cooling System, Auxiliary Systems	In Stock	Low	N/A	
Alternator Bearing Drain Oil Thermocouple (TC-LO-3), Main Lube Oil System, Auxiliary Systems, HWD GT	In Stock	Low	N/A	
Oil Drain Alternator Bearing Thermocouple, Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	Low	N/A	
Oil Drain Clutch Bearing Thermocouple, Main Lube Oil System, Auxiliary Systems, SVL GT	In Stock	Low	N/A	
Oil Drain Thermocouple (TC-LO-2), Main Lube Oil System, Auxiliary Systems, HWD GT	In Stock	Low	N/A	
Oil Supply Thermocouple (TC-LO-1), Main Lube Oil System, Auxiliary Systems	In Stock	Low	N/A	
Fuel Temperature Sensor (TS-LF-1), Liquid Fuel System, Auxiliary Systems	In Stock	Low	N/A	
Snow Door Pneumatic Cylinder	In Stock	Medium	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
TURBINE EXHAUST TUNNEL - THERMAL DETECTOR, KIDDE-FENWAL:12-H27121-020-08	Provided Under Service Contract	Medium	N/A	
FIRE CONTROL PANEL TROUBLE ALARM TO DCS, DET-TRONICS:U9500A	Provided Under Service Contract	Low	N/A	
FIRE CONTROL PANEL DISCHARGE- ALARM TO DCS, NOTIFIER:AFP-300	Provided Under Service Contract	Low	N/A	
LP COMPRESSOR BLEED VALVE, 18", METSO AUTOMATION:815W 11 22HB XZC VA	In Stock	High	N/A	
HP COMPRESSOR BLEED VALVE, 14", FISHER:A31A-1031/33082 SR80	In Stock	High	N/A	
Module, ControlNet - Combination Generator Control Module with ControlNet communication	On Hand - Under Parts Management Agreement	High	N/A	
IFM, Analog, 16 channel - Fusible 16 Channel Analog IFM, 24V Blown Fuse Indicators, 5 Terminals per Input, Analog Interface Module	On Hand - Under Parts Management Agreement	Medium	N/A	
IFM, analog, 8 channel - Feed-Through 8 Channel Analog IFM, 3 Terminals per Input, Analog Interface Module	On Hand - Under Parts Management Agreement	Medium	N/A	
IFM, digital, 40 point - 40-Point Isolated Fusible Digital IFM, 5 x 20mm Fuse Clips, 24V AC/DC Blown Fuse Indicators, 4 Terminals per Input, Digital Interface Module	On Hand - Under Parts Management Agreement	Medium	N/A	
Module, relay expander - Relay Expander Module, 24V DC, 16 Relays with Fusing	On Hand - Under Parts Management Agreement	Medium	N/A	
10 Slot ControlLogix Chassis	On Hand - Under Parts Management Agreement	Medium	N/A	
4 Slot ControlLogix Chassis	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlNet Interface Module (100 connections)	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlNet Redundant Interface Module (100 connections)	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlNet Redundant Bridge Module (40-48 connections)	On Hand - Under Parts Management Agreement	Medium	N/A	
EtherNet 10-100M Interface Module (supports 128 TCP/IP connections)	On Hand - Under Parts Management Agreement	Medium	N/A	
EtherNet 10-100M Interface Module (supports 64 TCP/IP connections)	On Hand - Under Parts Management Agreement	Medium	N/A	
10-30 VDC Isolated Input 16 Pts (36 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	
10-30 VDC Individually Isolated Input 16 Pts (36 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	
Analog Input - Current/Voltage 16 Pts (36 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	
Controller, controlLogix 5570, 2MB	On Hand - Under Parts Management Agreement	High	N/A	
ControlLogix 5570 Controller with 2 MB Memory, USB Port, 4 Character Alpha/Numeric Display.	On Hand - Under Parts Management Agreement	High	N/A	
Controller, ControlLogix 5570, 4MB	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlLogix 5570 Controller with 4 MB Memory, USB Port, 4 Character Alpha/Numeric Display.	On Hand - Under Parts Management Agreement	Medium	N/A	
10-31 VDC Output 32 Pts (36 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	
10-31 VDC Output 32 Pts (36 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	
Analog Output - Current/Voltage 8 Pts (20 Pin)	On Hand - Under Parts Management Agreement	Medium	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
ControlLogix, 85-265 VAC Power Supply (10 Amp @ 5V)	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlLogix, 85-265 VAC Power Supply (13 Amp @ 5V)	On Hand - Under Parts Management Agreement	Medium	N/A	
Redundancy Module	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlLogix Position and Time Services	On Hand - Under Parts Management Agreement	Medium	N/A	
Stratix 5700 Switch, Managed, 16 Fast Ethernet Copper Ports, 2 Fast Ethernet Fiber SFP Slots, Lite Software, DLR	On Hand - Under Parts Management Agreement	Low	N/A	
Networks and Communication Products, ControlNet Repeater Adapter Module	On Hand - Under Parts Management Agreement	Low	N/A	
Networks and Communication Products, Long-distance Fiber Ring Repeater Module	On Hand - Under Parts Management Agreement	Low	N/A	
Networks and Communication Products, Long-distance Fiber Ring Repeater Module	On Hand - Under Parts Management Agreement	Low	N/A	
Networks and Communication Products, Right-angle T-tap	On Hand - Under Parts Management Agreement	Low	N/A	
Networks and Communication Products, Right-angle Y-tap	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, ControlNet FLEX I/O Adapter Module	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Input Module, 24VDC, 16 Sink Inputs	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Input Module, 24VDC, 32 Sink Inputs	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Analog Input Modules, 8 Single-Ended Inputs	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Analog Input Modules, 8 Single-Ended Inputs	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Analog Input Module, 16 Bit, 4 Point Isolated	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, 2-Channel High Resolution Frequency	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Input Module, 8 Point RTD	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Input Module, Non-Isolated, Thermocouple / RTD / Mv	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Input Module, Thermocouple, 8 Point	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Output Module, 24V DC, 16 Source Outputs	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Output Module, 24V DC, 32 Source (2 groups of 16) Outputs, Protected	On Hand - Under Parts Management Agreement	Low	N/A	
1794 Flex, Flex Ex, Flex XT I/O System, Analog Output Module, 16 Bit, 4 Point Isolated	On Hand - Under Parts Management Agreement	Low	N/A	
PF750-24V I/O Module-2AI,2AO,6DI,2RO	On Hand - Under Parts Management Agreement	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
PowerFlex Architecture Class DeviceNet Communication Adapter	On Hand - Under Parts Management Agreement	Medium	N/A	
PowerFlex 753 AC Drive, with Embedded I/O, Air Cooled, AC Input with DC Terminals, Open Type, 14 Amps, 10HP ND, 7.5HP HD, 480 VAC, 3 PH, Frame 2, Filtered, CM Jumper Removed, DB Transistor, Blank (No	On Hand - Under Parts Management Agreement	Medium	N/A	
PowerFlex Architecture Class Remote Enhanced HIM, IP66 (NEMA 4X/12) Indoor Use Only. Includes 1202-C30 cable.	On Hand - Under Parts Management Agreement	Medium	N/A	
PanelView Plus Display Keypad/Touch, 15-inch TFT Display, Color, No Options	On Hand - Under Parts Management Agreement	Medium	N/A	
PanelView Plus Display Touch Screen, 12.1-inch TFT Display, None, High Bright	On Hand - Under Parts Management Agreement	Medium	N/A	
ControlNet Scheduled and Unscheduled Communication Module for Marine Certified PanelView Plus 700-1500 and PanelView Plus CE	On Hand - Under Parts Management Agreement	Low	N/A	
PanelView Plus 6 Logic Module, Windows CE 6.0, 80 MB Non Volatile storage for applications, DC Power Input, No Options	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 1.0-5.0A, NEMA 2	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 3-15A, NEMA 2	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 5-25A, NEMA 2	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 9-45A, NEMA 2	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 9-45A, NEMA 3	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 18-90A, NEMA 3	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 0.4-2.0A, NEMA 00	On Hand - Under Parts Management Agreement	Medium	N/A	
592 E3 and E3 Plus Solid-State Overload Relays, E3 Plus, 60-302A, NEMA 5	On Hand - Under Parts Management Agreement	Medium	N/A	
ProSoft Technology DNP 3.0 Ethernet Server Communication Module	On Hand - Under Parts Management Agreement	Low	N/A	
ProSoft Technology Modbus Master/Slave Enhanced Communication Module	On Hand - Under Parts Management Agreement	Low	N/A	
PURGE SOLENOID REPAIR KIT, SURESITE:3153515	In Stock	Low	N/A	
BARKSDALE HEATER CONTROL TEMPERATURE SWITCH, MODEL # T1X-5154-A, STAINLESS STEEL	In Stock	Low	N/A	
WAS MARKED AS IN STOCK JDE=0	In Stock	Low	N/A	
VALVE, SHUTDOWN PURGE	In Stock	High	N/A	
1", QS0065-4 DXP-L21GNEB JBHC8327G041-125VDC	In Stock	High	N/A	
VALVE, CONTINUOUS PURGE	In Stock	High	N/A	
3", QS0600-4 DXP-L21GNEB EFHC8321G1	In Stock	Low	N/A	
FUSE, LOW VOLTAGE DC	In Stock	Low	N/A	
REPLACEMENT FUSE (LOW VOLTAGE DC PIM), BENTLY NEVADA: 1720045	In Stock	Medium	N/A	
MODULE, DC POWER SUPPLY	In Stock	Medium	N/A	
HIGH VOLTAGE DC POWER SUPPLY MODULE, BENTLY NEVADA:129486-01	In Stock	Medium	N/A	
MODULE, POWER SUPPLY	In Stock	Medium	N/A	
LOW VOLTAGE DC POWER SUPPLY MODULE, BENTLY NEVADA:133292-01	In Stock	Medium	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
MODULE, POWER INPUT LOW VOLTAGE DC POWER INPUT MODULE (PIM), BENTLY NEVADA:133300-01	In Stock	Medium	N/A	
MANUAL, POWER SUPPLY MODULE POWER SUPPLY MODULE, MANUAL, BENTLY NEVADA:129767-01	In Stock	Medium	N/A	
E-CELL 55A CURRENT TRANSDUCER, PHOENIX CONTACT:3062518	In Stock	Low	N/A	
E-CELL 32A CONTACTOR, GENERAL ELECTRIC:3060877	In Stock	Low	N/A	
PANEL HEATER 120V 60HZ 400W, PH40011	In Stock	Low	N/A	
SOLAR SPARK PLUG IGNITER, CENTAUR:903316C1	In Stock	Low	N/A	
SHAFT, FISHER				
SHAFT, FISHER:7000400800	In Stock	Low	N/A	
PUMP, CONVERTER CHARGING TORQUE CONVERTER CHARGING PUMP, KOENIG:X216228-J	In Stock	Low	N/A	
REPAIR KIT, SSS CLUTCH MINOR KOENIG:S117998MNKT	In Stock	Medium	N/A	
VALVE, CHECK 3"	In Stock	Medium	N/A	
3MB60-6047-WR				
VALVE, SS POPPET CHECK SS POPPET CHECK VALVE, SWAGELOCK:SS-6C-1	In Stock	Low	N/A	
VALVE, FUEL CHECK FUEL LINE CHECK VALVE, PARKER:10A-CBG8L-10-PF-SS, VOGT:SW9871T,	In Stock	High	N/A	
VALVE, CHECK CHECK VALVE, SUN HYDRAULICS:CXDA-XAN	In Stock	Low	N/A	
SOLENOID SOLENOID VALVE, SUN HYDRAULICS:DILDA-MCN	In Stock	Low	N/A	
VALVE, FUEL BYPASS MANUFACTURER:FISHER, MODEL:1008 HANDWHEEL ACTUATOR W/LOCKING MECHANISM, SIZE 40, TRAVEL LENGTH:3/4", CAPABLE OF GIVING PRECISE MANUAL - THROTTLING CONTROL, TRAVEL INDICATOR MOUNTED ON ACTUATOR - YOKE FOR VISUAL VALVE PLUG POSITION	In Stock	High	N/A	
REPAIR KIT, BYPASS VALVE REPAIR KIT FOR FUEL START-UP BYPASS VALVE, MANUFACTURER:FISHER, MODEL:EZ, SIZE:1", TRIM:1/4" M-FORM, USED FOR THROTTLING ON-OFF CONTROL OF LIQUID OR GASES, SINGLE PORT, GLOBE-STYLE BODY FOR - QUICK CHANGE TRIM & POST GUIDED UNBALANCED VALVE PLUG				
VALVE, PUMP DISCHARGE PUMP DISCHARGE PRESSURE REGULATING VALVE, MOOG/FISHER:ET-657-DVC-6200, SERIAL # F000642304, TYPE:ET CAV 111, SIZE 1-1/2, PORT SIZE:1-5/16, RATING:CL600/1500 PSI CWP, PLUG:SST, STEM:SST, BODY:STL, SEAT:SST	In Stock	Low	N/A	
VALVE, PRESSURE RELIEF HYDRAULIC FLUID PRESS RELIEF VALVE, REXROTH:R900341066	In Stock	Low	N/A	
PUMP DISCHARGE - PRESSURE RELIEF VALVE, REXROTH:R900420276	In Stock	Low	N/A	
VALVE MANIFOLD PRESSURE RELIEF VALVE, REXROTH:R900423723	In Stock	Low	N/A	
MAIN PUMP DISCHARGE - PRESSURE RELIEF VALVE, REXROTH:R900424147	In Stock	Low	N/A	
PRESSURE CONTROL VALVE, SUN HYDRAULICS:RDBA-LAN	In Stock	Low	N/A	
SOLENOID VALVE, TYCO: 52-287-10-024	In Stock	Low	N/A	
AIR CONTROL SOLENOID VALVE, 24VDC MINI, INGERSOLL RAND 633658	In Stock	Low	N/A	
VALVE, STOP FISHER 3", 560iit-TH66 QS1600-4 DXP-L21GNEB	In Stock	Low	N/A	
FILTER, WATER - CLARK RELIANCE 2500PW	In Stock	Medium	N/A	
INST AIR DEW POINT ANALYZER, MICHELL INSTRUMENTS:EA-XP-TX-EX1-CL-D1-E2-F1-G1-H1	In Stock	Low	N/A	
ACTUATOR, TYPE PNEUMATIC RACK & PINION, FLOWSERVE:20E39SWZ24D	In Stock	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
ATOMIZING AIR RECEIVER INLET VALVE, WORCESTER:5166TT150	In Stock	Low	N/A	
MODEL AD-1 AUTOMATIC DRAIN VALVE, TYCO:52-793-2-004	In Stock	Low	N/A	
MODEL ASV-1 AUTOMATIC - SHUT-OFF VALVE, TYCO:92-343-1-021	In Stock	Low	N/A	
COMBUSTOR SHELL DISCHARGE - TEMPERATURE THERMOCOUPLE DUPLEX TYPE K	In Stock	Medium	N/A	
COOLING AIR FILTER BLEED DRAIN VALVE, 1", WORCHESTER:84446 XG SW	In Stock	Low	N/A	
COIL, OVERSPEED TRIP				
ELECTRONIC OVERSPEED TRIP, 9501W38	In Stock	High	N/A	
TORQUE CONVERTER MAGNETIC SPEED PICK-UP COIL, KOENIG:9501W14	In Stock	High	N/A	
1 SERIES NEEDLE VALVE, SWAGELOCK-B-1VM4-S4/SS-1VM4-S4	In Stock	Low	N/A	
FEMALE NEEDLE VALVE, MCMASTER CARR:4644K33, 3/8"NPT	In Stock	Low	N/A	
PARKER VALVE, MODEL# 6Z-PR4-BNT-SS	In Stock	Low	N/A	
GLOBE VALVE, STEEL, VOGT:SW9871T, LUBE OIL FILTER TOWER #1 VENT VALVE	In Stock	Low	N/A	
INDICATOR, SIGHT				
1-1/2", JACOBY:100-S(NF)	In Stock	Low	N/A	
PILOT VALVE ASSEMBLY, CLIPPARD FV-SP W/M/PA-3P, CLIPPARD:LWT3732	In Stock	High	N/A	
FLOAT, SURESITE:88111	In Stock	Low	N/A	
HYD FLUID SUPPLY FILTER SELECTION VALVE, PALL:1319232	In Stock	Low	N/A	
THROTTLE VALVE, NFBC-LCN	In Stock	Low	N/A	
GASKET, FILTER HOUSING				
GASKET,CLARK RELIANCE:A10137455, NFS# 10117455	In Stock	Low	N/A	
O-RING, BUNA				
HEAD TO BOWL O-RING BUNA, PALL:UK19672	In Stock	Low	N/A	
O-RING, FISHER				
O-RING, FISHER:T1205106562	In Stock	Low	N/A	
BUSHING ASSY, FISHER POT				
POT/BUSHING ASSEMBLY, FISHER:27B6208X012	In Stock	Low	N/A	
FILL KIT, SF6				
ABB BREAKER SF6 FILL KIT, (HECS 80S), S/N 1HC211015861	In Stock	Low	N/A	
BELT, ECODYNE:1320-BLT-S-EHX19-90				
COUPLING, PUMP/MOTOR	In Stock	Medium	N/A	
JOHN CRANE:A045-3578-1270, 1-1/2" - 2-3/8", ROUGH BORE	In Stock	Low	N/A	
PUMP, GEAR				
DANFOSS-BERENDEN FLUID POWER SNP 2/11	Procurement Ongoing	Medium	N/A	Expected Oct 2025
COUPLING, PUMP-MOTOR				
COUPLING, REXNORD-OMEGA: REX ELASTOMER-ES-4(STANDARD ORANGE),PUMP-MOTOR	In Stock	Low	N/A	
COUPLING, PUMP-MOTOR				
COUPLING, REXNORD-OMEGA: ELASTOMER-ES-5 (STANDARD ORANGE) PUMP-MOTOR	In Stock	Low	N/A	
REPAIR KIT, INJ. PUMP				
CHEMICAL INJECTION PUMP REPAIR KIT, GRAINGER:K4PTC1	In Stock	Medium	N/A	
FILTER, FUEL CAT 1R0749				
FOR USE ON STAGE I AND II, EMERGENCY DIESEL MANUAL PRIMING PUMPS, CATERPILLAR #1R-0749	In Stock	Medium	N/A	
ELEMENT 0180MA0003BN (3µm), P/N 2059438, SPIN ON ELEMENT, MANUFACTURER:HYDAC	In Stock	Low	N/A	
FILTER, LIQUID FUEL				
CLARK RELIANCE 2200A3	In Stock	High	N/A	
FILTER, AIR (ELEMENT)				
INGERSOLL RAND 32012957	In Stock	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
ELEMENT, PRE-FILTER				
PRE-FILTER ELEMENT 105 SCFM, INGERSOLL RAND 85565679	In Stock	Low	N/A	
FILTER, AIR				
GEN AIR FILTERS, COMPACT FILTER G4/F7 287 X 292 X 300, SIEMENS	In Stock	Medium	N/A	
FILTER, AIR				
GEN AIR FILTERS, COMPACT FILTER, G4/F7 592 X 292 X 300, SIEMENS	In Stock	Medium	N/A	
FILTER KIT, FUEL				
LOW PRESSURE FUEL FILTER REPLACEMENT KIT, CENTAUR:912555C3	In Stock	High	N/A	
KIT, OIL FILTER & O-RING				
LUBE OIL FILTER & O-RING KIT, CENTAUR:9161283C1	In Stock	Low	N/A	
FILTER, FUEL BOOST KIT - LOW PRESSURE, 912343C1	In Stock	Low	N/A	
FILTER, IGV ACTUATOR - MOOG:B64567-1V	In Stock	Medium	N/A	
FILTER, TMP-95 FINAL				
PNEUMAFIL:S5253881, V-CELL STMPM16 STATIC BARRIER FILTER, 24"X24"X12", INJECTION MOLDED PLASTIC FRAME, 100% SYNTHETIC MEDIA, NEOPRENE SPONGE RUBBER GASKET - DOWN STEAM SIDE	In Stock	Medium	N/A	
PRE-FILTER, Z-100				
PNEUMAFIL:S52709C1, PRE-FILTER PANEL, 24"X24"X4"73 (FT2) SYNTHETIC MEDIA, PLASTIC FRAME FOR HIGHER PERFORMANCE AND LOWER PRESSURE DROP	In Stock	Medium	N/A	
PRE-FILTER, PARKER AIR DRYER				
PARKER AIR DRYER PRE-FILTER, PARKER FILTER CARTRIDGE# 6C10-050	In Stock	Low	N/A	
AFTER-FILTER, AIR DRYER				
AIR DRYER AFTER FILTER, PN 25-178-50C, PARKER FILTER CARTRIDGE # 10C10-050	In Stock	Low	N/A	
FILTER, PRESSURE				
PALL: ELEMENT HC9600FCP4H	In Stock	Medium	N/A	
ELEMENT, POST FILTER				
POST FILTER ELEMENT 105 SCFM, INGERSOLL RAND 85565661	In Stock	Medium	N/A	
TRANSMITTER, PRESSURE				
ROSEMOUNT:3051S2TG3A2A11A1AM5Q4	In Stock	Medium	N/A	
FILTER, LUBE OIL				
LUBE OIL FILTER, CLARKE RELIANCE:A2200A4, NFS:2200A4	In Stock	High	N/A	
SOFT PARTS KIT, CLARKE RELIANCE:A10400107, NFS:10400107	In Stock	Medium	N/A	
FILTER AUTOMATIC FLOW CONTROL, 4"FNPT, MODEL:ST-400-25, 240GPM, PENTAIR:LWT 3949	In Stock	Medium	N/A	
FILTER AUTOMATIC BACKWASH FLOW CONTROL, 4" FNPT, MODEL:ST-400-25, 245GPM, MODULAR PIPING SUPPLY INC: LWT5430	In Stock	Medium	N/A	
CARTRIDGE, DESICCANT				
PNEUMATIC PRODUCTS:3153517	In Stock	Low	N/A	
FILTER, OIL 275-2604				
OIL FILTER, CAT:275-2604	In Stock	Low	N/A	
FILTER, AIR 4P0710S				
AIR FILTER, CAT: 4P0710	In Stock	Low	N/A	
PRE-FILTER, AIR COOLING				
PRE-FILTER, AIR COOLING	In Stock	Low	N/A	
METER, FLOW				
ROSEMOUNT:3051SFC1C30N065-T33EA1A5Q4E6M5	In Stock	Medium	N/A	
LIQUID FUEL TEMPERATURE TRANSMITTER, ROSEMOUNT 644HAK6MSQ416	In Stock	Medium	N/A	
PUMP SUPPLY PRESSURE SWITCH, CCS 646GZEM1	In Stock	Medium	N/A	
PUMP DISCHARGE PRESSURE TRANSMITTER, ROSEMOUNT 3051CGSA22A1A5B4C6M5Q4	In Stock	Medium	N/A	
PNEUMATICALLY ACTUATED THROTTLE VALVE, FISHER ET-677-DVC-6200	In Stock	Medium	N/A	



Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
PUMP DISCHARGE PRESSURE SWITCH, CCS 646GZEM5	In Stock	Medium	N/A	
METER, FLOW				
ROSEMOUNT:3051SFC1C030NXT33DA1A5DQ4E6M5	In Stock	Medium	N/A	
CONTROLLER, STEP LIFO				
8 STAGES, SCL4000-8	In Stock	Low	N/A	
LIMIT CONTROLLER (0-2502-F), SA100LKA3-MN-4*NN-D1/Y	In Stock	Low	N/A	
STEP CONTROLLER LIFO (4 STAGES), SCL4000-4	In Stock	Low	N/A	
INSTRUMENT AIR DRYER DIFFERENTIAL PRESSURE, DIFFERENTIAL PRESSURE TRANSMITTER,				
ROSEMOUNT:3051S2CD3A2A11A1A1L1L2L4M5Q4	In Stock	Low	N/A	
DIFFERENTIAL PRESSURE SWITCH,JOHNSON CONTROLS:JCI P 233 A-10-AAC	In Stock	Low	N/A	
FUEL OIL INLINE HEATER SUPPLY FLOW SWITCH, MAGNETROL TD2-7D01-0G0 C/W TEA-A110-004, THERMAL DISPERSION FLOW SWITCH	In Stock	Low	N/A	
FUEL UNLOADING PUMPS OUTLET PRESURE/GAUGE PRESSURE TRANSMITTER, ROSEMOUNT:3051S2TG3A2E11A1AB4KM5Q4	In Stock	Low	N/A	
FUEL OIL TANK 1 LEVEL RADAR LEVEL TRANSMITTER, ROSEMOUNT:5402AH1E64SPVDAM1C1S3	In Stock	Medium	N/A	
FUEL OIL TANK HIGH LEVEL SWITCH, ULTRASONIC GAP LEVEL SWITCH, MAGNETROL:961-2DA0-030 C/W 9A1-A43A-018	In Stock	Medium	N/A	
FUEL OIL INLINE HEATER DISCHARGE TEMPERATURE TRANSMITTER, ROSEMOUNT:644HAK616M4	In Stock	Medium	N/A	
FUEL OIL INLINE HEATER DISCHARGE TEMPERATURE RTD, ROSEMOUNT:68 SERIES/0068D21C30A020T26	In Stock	Medium	N/A	
FUEL OIL DAY TANK LEVEL RADAR LEVEL TRANSMITTER, ROSEMOUNT:5402AH1E64PNACAM1C1	In Stock	Medium	N/A	
FUEL OIL TANK HIGH LEVEL SWITCH, DISPLACER LEVEL SWITCH, MAGNETROL MODEL # A15-1E2B-HM3, SERIAL # 744243-01-001	In Stock	Medium	N/A	
SWITCH ASSEMBLY, LIMIT				
MICROSWITCH # LSA2B	In Stock	Low	N/A	
CABLE,SOLAR, IGNITER				
CENTAUR:919340C2	In Stock	Medium	N/A	
PICKUP, MAGNETIC				
CENTAUR:P/N 190430-1	In Stock	Medium	N/A	
SWITCH, OVERSPEED				
CENTAUR KIT P/N1071653-2600	In Stock	Medium	N/A	
INLET GUIDE VANE POSITION TRANSMITTER, FISHER:4200 SERIES (4200)	In Stock	Medium	N/A	
RAC FILTER DRAIN SOLENOID VALVE, PARKER:H2223N	In Stock	Low	N/A	
LUBE OIL FILTER DELTA HIGH PRESS SWITCH, MIDWEST:120-AA-09-0-CZ	In Stock	Medium	N/A	
LUBE OIL COOLER OUTLET TEMP GAUGE, ASHCROFT:600B-01-CEXSG	In Stock	Low	N/A	
BEARING LUBE OIL HEADER PRESS#1 LOW, PRESSURE SWITCH, UNITED ELECTRIC CONTROLS: J402-146-1521	In Stock	Medium	N/A	
BEARING LUBE OIL PRESSURE CONTROL VALVE, FISHER:ED-655	In Stock	Medium	N/A	
EMERGENCY LUBE OIL PUMP DISCHARGE - PRESSURE SWITCH, UNITED ELECTRIC CONTROLS - J400-146-1521	In Stock	Medium	N/A	
LUBE OIL RESERVOIR VACUUM - PRESSURE INDICATOR, ASHCROFT:45-11877SS-04B	In Stock	Low	N/A	
LUBE OIL RESERVOIR TEMPERATURE SWITCH, HONEYWELL:T775A2009	In Stock	Low	N/A	
MAIN LUBE OIL PUMP #1 - DISCHARGE PRESSURE SWITCH, UNITED ELECTRIC CONTROLS: J402-164-1521	In Stock	Medium	N/A	
OVERSPEED TRIP SENSOR #1, ELECTRO CORP:3090A35	In Stock	High	N/A	
INLET AIR MANIFOLD PRESSURE SWITCH, UNITED ELECTRIC CONTROLS: J400K-455-1520	In Stock	Low	N/A	
DIFFERENTIAL PRESSURE SWITCH, PNEUMAFIL:552033-81	In Stock	Medium	N/A	
INTAKE AIR STATIC FILTER DIFFERENTIAL- PRESSURE SWITCH, SOR:107AL-K12-P1-F1A	In Stock	Low	N/A	
INLET SCROLL TEMPERATURE TRANSMITTER #1, YOKAGAWA:YTA320-EA2NN/FU1/D2/Z	In Stock	Low	N/A	
RTD, #1 PRIMARY SIGNAL				
INLET SCROLL RTD #1 PRIMARY SIGNAL, ROSEMOUNT:0078-N-25-N-00-A-060-T26-XA	In Stock	Low	N/A	
INSTRUMENT AIR SYSTEM PRESSURE SWITCH, UNITED ELECTRIC CONTROLS: H122-184, MFG PN 0409-007	In Stock	Low	N/A	
INSTR-AIR COMPRESSOR RECEIVER - LOW PRESSURE ALARM SWITCH, UNITED ELECTRIC CONTROLS: H122-274	In Stock	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
INST AIR SYSTEM ISOLATION SOLENOID VALVE, ASCO:HCL8316G66MB	In Stock	Low	N/A	
INSTR-AIR COMPRESSOR START STOP, PRESSURE SWITCH, HUBBELL INDUSTRIAL CONTROL: 69HA109779U	In Stock	Low	N/A	
INSTRUMENT AIR COMPRESSOR LOW - OIL LEVEL INDICATOR, INGERSOLL RAND:22102388	In Stock	Low	N/A	
GENERATOR MAIN JACKING OIL PUMP - PRESSURE SWITCH, BARKSDALE-BIT-H04	In Stock	High	N/A	
GENERATOR TURBINE END BEARING - JACKING OIL FLOW SWITCH, MEISTER:DKM/A-1/10	In Stock	High	N/A	
HYD FLUID AIR BLEED VALVE, HYDAC:AEV6/5 00230023	In Stock	Low	N/A	
HYD FLUID PUMP #1 DISCHARGE - PRESSURE SWITCH, REXROTH:HED 3 OAEV63/12	In Stock	Low	N/A	
HYD FLUID RESERVOIR - LEVEL TRANSMITTER, GEMS:XT-800	In Stock	Low	N/A	
HYD FLUID RESERVOIR LEVEL INDICATOR, REXROTH:CS3615-244910	In Stock	Low	N/A	
HYD FLUID HEADER SUPPLY - PRESSURE TRANSMITTER, ROSEMOUNT: 3051TG4A2A21AM5Q4	In Stock	Low	N/A	
HYD FLUID COOLER FAN MOTOR - TEMPERATURE SWITCH (OFF), UNITED ELECTRIC CONTROLS: C402-120-1070-M202 135/120F	In Stock	Low	N/A	
HYD FLUID COOLER FAN MOTOR - TEMPERATURE SWITCH (ON), UNITED ELECTRIC CONTROLS: C402-120-1070-M202 135/120F	In Stock	Low	N/A	
HYD FLUID RESERVOIR HEATER - TEMPERATURE SWITCH, UNITED ELECTRIC CONTROLS: C402-120-1070-M202 73/86F	In Stock	Low	N/A	
HYD FLUID SUPPLY FILTER - DIFFERENTIAL PRESSURE SWITCH, PALL:RC0113CZ097H	In Stock	Low	N/A	
HYD FLUID RESERVOIR THERMOCOUPLE, OMEGA:NB1-CASS-14U-12" DUAL	In Stock	Low	N/A	
CHLORINE INJECTION FLOW SWITCH, DWYER INSTRUMENTS:FS2	In Stock	Low	N/A	
DOUBLE ACTING PNEUMATIC ACTUATOR, KEYSTONE MORIN, TYCO:MRP-004	In Stock	Low	N/A	
O-500 PRESSURE TRANSMITTER - RO SKID, AUTOMATION DIRECT: PTD25-20-0500H	In Stock	Medium	N/A	
PRESSURE TRANSMITTER, AUTOMATION DIRECT:PTD25-20-0100H, 0-100 PSI - VARIOUS SKIDS	In Stock	Medium	N/A	
ANALOG INPUT CARD FOR PLC, VARIOUS SKIDS, AUTOMATION DIRECT:FO-04A51	In Stock	Medium	N/A	
VALVE, BALL				
1.5", STAINLESS STEEL, MCMASTER CARR: 45995K84	In Stock	Low	N/A	
PRESSURE SWITCH, BARKSDALE:XIT-4100-25	In Stock	Medium	N/A	
PRESSURE SWITCH, DRUCKSCHALTER: D1 TM80 55	In Stock	Medium	N/A	
LEVEL SWITCH MODULES, SURESITE: 87480	In Stock	Medium	N/A	
ELECTRICAL PACKAGE LOUVER ACTUATOR, ML4115B1008	In Stock	Low	N/A	
MECHANICAL PACKAGE - VENTILATION THERMOSTAT, T631C1012	In Stock	Low	N/A	
E-CELL STACK FITTINGS KIT, GENERAL ELECTRIC:3019638	In Stock	Low	N/A	
SINGLE POLE RELAYS - VARIOUS SKIDS, AUTOMATION DIRECT:781-1C-120A	In Stock	Low	N/A	
IGV ACT HYD FLUID FILTER-DIFF PRESS HIGH SWITCH, MOOG:G4444-2	In Stock	Medium	N/A	
MULTIFUNCTION MONITOR - ORP OR CONDUCTIVITY, RYAN HERCO:5924-562	In Stock	Low	N/A	
24VDC POWER SUPPLY, AUTOMATION DIRECT:PSB24-060D	In Stock	Low	N/A	
ORP SENSOR, RYAN HERCO:5909-751, RAW WATER PUMP - VARIOUS SKIDS	In Stock	Medium	N/A	
CONDUCTIVITY SENSOR - RO, RYAN HERCO:5926-200	In Stock	Medium	N/A	
MANIFOLD, PRESSURE TRANSMITTER				
ROSEMOUNT 0305RC22B11	In Stock	Low	N/A	
ATOMIZING AIR HEADER PRESSURE GAUGE, PRESSURE TRANSMITTER, ROSEMOUNT:3051S2TG3A2A11A1AM5Q4	In Stock	Low	N/A	
BLUE MOISTURE INDICATOR, INGERSOLL RAND 705001-5P	In Stock	Low	N/A	
THERMOMETER, RESISTANCE				
SIEMENS:WQ 0233 2XPT100, INSTALLATION LENGTH 250MM, HAN 8D	In Stock	Low	N/A	
THERMOCOUPLE, SHELL				
SIEMENS:MQ 0206-PVDF8 3XTC(K), INSTALLATION LENGTH 375MM, HAN 8D	In Stock	High	N/A	
FUEL OIL UNLOADING FLOW LIQUID TURBINE FLOWMETER, HOFFER FLOW / CONTROLS: HO SERIES/6X6-75-1250-CB-1M/XE2-F1CS-EXP	In Stock	Medium	N/A	
HYDRUALIC FLUID PUMP #1 - DISCHARGE PRESSURE INDICATOR, REXROTH:2-1/2/1500PUA31-10A-4 JIC	In Stock	Low	N/A	
HYDRUALIC FLUID CONDITIONING LOOP - FILTER DIFFERENTIAL PRESSURE SWITCH, PALL:RC0113CZ090H	In Stock	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
RAW WATER FLOW MAGNETIC FLOWMETER, ROSEMOUNT:8705TSA060C1W0N0G1	In Stock	Low	N/A	
RAW WATER STORAGE TANK LEVEL RADAR - LEVEL TRANSMITTER, ROSEMOUNT:5402AH1E64SPVCAM1C1S3	In Stock	Low	N/A	
RAW WATER PUMP 1 & 2, DISCHARGE GAUGE, PRESSURE TRANSMITTER, ROSEMOUNT: 3051S2TG2A2A11A1A84M5Q4	In Stock	Low	N/A	
REGULATOR, SIGNAL, PRESSURE				
STAGE 2 TEMPERATURE CONTROL VALVE - AIR SIGNAL PRESSURE REGULATOR, FISHER:67CF-1663-38656	In Stock	Low	N/A	
LP COMPRESSOR BLEED VALVE SOLENOID, ASCO:JKC8316G034V	In Stock	Medium	N/A	
COMPRESSOR BLADE PATH THERMOCOUPLE, DUPLEX TYPE K	In Stock	High	N/A	
STARTING PACKAGE TORQUE CONVERTER PRESSURE GAUGE, KOENIG:BAC-160-25	In Stock	Low	N/A	
CAPSUHELIC GUAGE 0-6" W.C, PNEUMAFIL:551646-B1	In Stock	Low	N/A	
INTAKE AIR STATIC FINAL-FILTER - DIFFERENTIAL PRESSURE INDICATOR, DWYER INSTRUMENTS:4006	In Stock	Low	N/A	
INTAKE AIR STATIC PRE-FILTER - DIFFERENTIAL				
PRESSURE INDICATOR, DWYER INSTRUMENTS:4002	In Stock	Low	N/A	
CAPSUHELIC GAUGE 0-2" W.C, PNEUMAFIL:551646-B6	In Stock	Low	N/A	
PRESSURE TRANSMITTER 0-300 PSI 4-20MA, ROSEMOUNT:3051TA3A2B21AE5	In Stock	Medium	N/A	
PRESSURE REGULATOR - AIR SUPPLY FROM INST AIR COMPRESSOR, FISHER:F564-29	In Stock	Medium	N/A	
INSTR. AIR COMPRESSOR PRESSURE GAUGE, AIR CENTERS OF FLORIDA:5ZP76	In Stock	Medium	N/A	
PRESSURE GAUGE - FOR INSTR AIR COMPRESSOR, ASHCROFT:45-13772204b, RANGE:0-200 PSI	In Stock	Low	N/A	
PRESSURE REGULATING GAUGE - AIR SUPPLY FROM INSTR AIR COMPRESSOR, FAIRCHILD:4066AT	In Stock	Low	N/A	
PRESSURE GAUGE 0-160PSI, LIQUID FILLED BACK MOUNT, STAINLESS STEEL, AUTOMATION DIRECT:G25-SL160-4LB	In Stock	Low	N/A	
PRESSURE GAUGE 0-100PSI, LIQUID FILLED LOWER MOUNTED, STAINLESS STEEL, AUTOMATION DIRECT:G25-S0100-4LS	In Stock	Low	N/A	
PRESSURE GAUGE 0-100PSI, LIQUID FILLED BACK MOUNTED, STAINLESS STEEL, AUTOMATION DIRECT:G25-S0100-4CS	In Stock	Low	N/A	
PRESSURE GAUGE 0-500PSI, LIQUID FILLED BACK MOUNTED, STAINLESS STEEL, DWYER INSTRUMENTS:SGY-D11142N-GF	In Stock	Low	N/A	
PRESSURE GAUGE 0-500 PSI, LIQUID FILLED LOWER MOUNTED, STAINLESS STEEL, DWYER INSTRUMENTS:SGY-D11122N-GF	In Stock	Low	N/A	
TRANSMITTER, DEW POINT -100F				
-40F AND -100F, INGERSOLL RAND P/N 23182603	In Stock	Medium	N/A	
TRUCK UPLOADING GROUND VERIFICATION MONITOR, 8030-120 GROUND VERIFICATION MONITOR, CIVACON	In Stock	Low	N/A	
MOTOR, FLAP ACTUATOR				
JOHNSON CONTROLS, JCI M9132-GGA-1	In Stock	Low	N/A	
BRUSH, CARBON MOTOR				
1 SET = 2 PIECES, ABB: GPFX052143 P0098	In Stock	Medium	N/A	
GENERATOR JACKING OIL - SOLENOID VALVE, SUN HYDRAULICS:DIDA-MCN	In Stock	Medium	N/A	
MOTOR, 10 HP DC TURNING GEAR				
KOENG: DG6711A	In Stock	High	N/A	
MOTOR, BALDOR				
BALDOR:VEM3770T NEMA	In Stock	Medium	N/A	
TURNING GEAR MOTOR BRUSH SET, 419904-51AC	In Stock	Low	N/A	
COUPLING, PUMP/MOTOR				
SIZE 1040T20, FLEXIBLE GRID TYPE, VERTICAL ORIENTATION, MANUFACTURER:FALK	In Stock	Low	N/A	
RELAY, DPDT 120VAC				
RCP8002 120AC	In Stock	Medium	N/A	
RELAY, TPDT 120VAC				
RCP1103 120AC	In Stock	Medium	N/A	
CUT-OUT, AUTO				
AUTO CUT-OUT, CHROMOLOX:168-053169-1 05	In Stock	Low	N/A	
FUSE, AGC 1A 250V				
AGC 1	In Stock	Low	N/A	
FUSE, AGC 3A 250V	In Stock	Low	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
FUSE, POWER CLASS J 45A A4J45	In Stock	Low	N/A	
FUSE, PRIMARY 20A ATQR20	In Stock	Low	N/A	
FUSE, SECONDARY 8A ATQR8	In Stock	Low	N/A	
CONTACTOR, 50A 120VAC 42CF35AF	In Stock	Low	N/A	
FUSE, PANEL HEATER 4.5A PANEL HEATER FUSE 4.5A, ATQR4.5	In Stock	Low	N/A	
FUSE, AC 25A ATQR25	In Stock	Low	N/A	
FUSE, SIEMENS PG SIEMENS PG 840C208FO1	In Stock	Low	N/A	
FUSE, 15.0A BUSSMAN:LP-CC-15.0	In Stock	Low	N/A	
FUSE, 5.0A BUSSMAN:LP-CC-5.0	In Stock	Low	N/A	
FUSE, 1.0A BUSSMAN:LP-CC-1	In Stock	Low	N/A	
FUSE, 2.0A 300 VDC BUSSMAN:LP-CC-2	In Stock	Low	N/A	
FUSE, 3.0A BUSSMAN:LP-CC-3.0	In Stock	Low	N/A	
FUSE, 12A FUSE 12A, SIEMENS:S00232012	In Stock	Low	N/A	
FUSE, 2AMP FUSE 2 AMP, GMC-2-A, BUSSMAN:GMC-2-A	In Stock	Low	N/A	
FUSE, 3AMP GMC-R FUSE 3AMP, BUSSMAN:GMC-3-R	In Stock	Low	N/A	
FUSE, 3A E-CELL E-CELL FUSE 3A, BUSSMAN:3060756	In Stock	Low	N/A	
FUSE, 25A E-CELL E-CELL FUSE 25A, BUSSMAN:1154697	In Stock	Low	N/A	
FUSE, 2A E-CELL E-CELL FUSE 2A, BUSSMAN:3060755	In Stock	Low	N/A	
FUSE, 6A GMC-6A 6AMP, GMC-6A, BUSSMAN:LWT7345	In Stock	Low	N/A	
FUSE, 1.25A GMC-1.25A FUSE 1.25 AMP, GMC-1.25-A, BUSSMAN:LWT9119	In Stock	Low	N/A	
FUSE, 8A E-CELL E-CELL FUSE 8A, MERSEN ELECTRIC POWER:3060752	In Stock	Low	N/A	
REPLACEMENT FUSE FOR AC PIMS, BENTLY NEVADA:1720025	In Stock	Low	N/A	
CONTACT BLK 1NC, SIEMENS:52BAK	In Stock	Low	N/A	
PILOT LIGHT ASSEMBLY AMBER 120VAC, A13200-05	In Stock	Low	N/A	
MODULE, TMR I/O I/O MODULE WITH INTERNAL BARRIERS - (INTERNAL TERMINATIONS)(4 X PROX/ACCEL)	In Stock	High	N/A	



Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
MODULE, TMR I/O				
PROX/SEISMIC TMR I/O WITH EXTERNAL TERMINATIONS, BENTLY NEVADA:126632-01	In Stock	High	N/A	
MODULE, PROX/VELOM I/O				
PROX/VELOM I/O MODULE WITH INTERNAL TERMINATIONS, BENTLY NEVADA:140471-01	In Stock	High	N/A	
MODULE, PROX/VELOM I/O				
PROX/VELOM I/O MODULE WITH EXTERNAL TERMINATIONS, BENTLY NEVADA:140482-01	In Stock	High	N/A	
MODULE, SHAFT ABSOLUTE				
SHAFT ABSOLUTE I/O MODULE WITH EXTERNAL TERMINATIONS, BENTLY NEVADA:138708-01	In Stock	High	N/A	
PROX/SEISMIC I/O MODULE WITH EXTERNAL TERMINATIONS, BENTLY NEVADA:128240-01	In Stock	High	N/A	
I/O MODULE WITH INTERNAL BARRIERS - (INTERNAL TERMINATIONS) (4 X VELOMETER), BENTLY NEVADA:135489-03	In Stock	High	N/A	
SHAFT ABSOLUTE I/O MODULE WITH - EXTERNAL TERMINATIONS, BENTLY NEVADA:138700-01	In Stock	High	N/A	
PROX/SEISMIC I/O MODULE WITH INTERNAL TERMINATIONS, BENTLY NEVADA:128229-01	In Stock	High	N/A	
I/O MODULE WITH INTERNAL BARRIERS - (INTERNAL TERMINATIONS), (2 X PROX/ACCEL + 2 X VELOMETER), BENTLY NEVADA:135489-02	In Stock	High	N/A	
DISCRETE INTERNAL BARRIERS I/O MODULE WITH INTERNAL TERMINATIONS, BENTLY NEVADA:136703-01	In Stock	High	N/A	
3500/42M PROXIMATOR/SEISMIC MONITOR, BENTLY NEVADA:140734-02	In Stock	High	N/A	
DISCRETE I/O MODULE WITH - EXTERNAL TERMINATIONS, BENTLY NEVADA:133434-01	In Stock	High	N/A	
3500 BUFFERED SIGNAL OUTPUT MODULE, BENTLY NEVADA:147364-01	In Stock	High	N/A	
DISCRETE I/O MODULE WITH - INTERNAL TERMINATIONS, BENTLY NEVADA:133422-01	In Stock	High	N/A	
115VAC PILOT LAMP - VARIOUS SKIDS, RADWELL INTERNATIONAL:D5N130	In Stock	Low	N/A	
3500/50 MODULE, BENTLY NEVADA:133388-02	In Stock	High	N/A	
WEATHER STATION DRY BULB TEMP A, VAISALA: HMT3301A0B101CGAB200B01CABAA1	In Stock	Low	N/A	
R-DIODE				
SIEMENS PG:840C411F04	In Stock	Medium	N/A	
F-DIODE				
SIEMENS PG:840C411F03	In Stock	Medium	N/A	
CAPACITOR ASSEMBLY/RC				
SIEMENS PG:153C684	In Stock	Medium	N/A	
DESICCANT, 4-8 GRADE D				
INGERSOLL RAND 50# BAG	In Stock	Low	N/A	
ELECTRICAL PACKAGE THERMAL DETECTOR, KIDDE-FENWAL:27121-160	In Stock	Low	N/A	
MECHANICAL PACKAGE THERMAL DETECTOR, KIDDE-FENWAL:27121-225	In Stock	Low	N/A	
SMOKE DETECTOR, NOTIFIER:FSI-851	In Stock	Low	N/A	
TURBINE ENCLOSURE THERMAL DETECTOR, KIDDE-FENWAL:27121-325	In Stock	Medium	N/A	
E-CELL SOLENOID VALVE, EMERSON:3022390	In Stock	Low	N/A	
STAGE #3 DISC CAVITY TEMPERATURE - CONTROL VALVE, 3", FISHER:A41-1032425AS	In Stock	High	N/A	
LO BEARING PRESSURE REGULATING VALVE, FISHER:44 ACTUATOR 4 BODY 655ED	In Stock	Medium	N/A	
INLET SHUTTLE VALVE, SURESITE:4010031	In Stock	Low	N/A	
TRANSMITTER, GROUND FAULT				
SIEMENS PG:153C691G02	In Stock	Medium	N/A	
BEARING LUBE OIL SUPPLY TEMPERATURE - THERMOCOUPLE, PYCO:02-3174 W/16-0049 (TYPE K)	In Stock	Medium	N/A	
TURBINE GENERATOR SPEED PICK UP, BRAUN:A5S08T165C0.5	In Stock	High	N/A	
GENERATOR MAIN JACKING OIL PUMP - PRESSURE SWITCH, BARKSDALE-BIT-H32	In Stock	Medium	N/A	
HYD FLUID CONDITIONING LOOP - PRESSURE INDICATOR, 2-1/2", REXROTH-/400PUA31-10A-4 JIC	In Stock	Low	N/A	
HYD FLUID RESERVOIR LOW LEVEL SWITCH, REXROTH:500PUA31-05 2 SW	In Stock	Low	N/A	
SPEED CONTROL, BRONZE, NUMATICS A1MN, EMERSON:1WT21254	In Stock	Low	N/A	
ORP PREAMPLIFIER, RYAN HERCO:5905-273	In Stock	Medium	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
THERMOCOUPLE/DISC CAVITY LPG INDUSTRIES INC. P/N: 2335C32-001 (THERMOCOUPLE ONLY)	In Stock	Medium	N/A	
THERMOCOUPLE/DISC CAVITY DISC CAVITY THERMOCOUPLE LPG INDUSTRIES INC. P/N: 2335C32-004 (THERMOCOUPLE ONLY)	In Stock	Medium	N/A	
THERMOCOUPLE/DISC CAVITY DISC CAVITY THERMOCOUPLE LPG INDUSTRIES INC. P/N: 2335C32-003 (THERMOCOUPLE ONLY)	In Stock	Medium	N/A	
TWO LAYER CONTACT BRUSH, SIEMENS-EMT 513-005, 20X8X32 EGSU/AG20 POLISHING LOOP PRESSURE RELIEF VALVE, REXROTH:RR00347261	In Stock	Medium	N/A	
HP BLEED VALVE OPEN LIMIT SWITCH, WESTLOCK:2007XBY/4SPDT	In Stock	Low	N/A	
LP BLEED VALVE OPEN LIMIT SWITCH, WESTLOCK:2007XBY/6SPDT	In Stock	Medium	N/A	
TORQUE CONVERTER SPEED PICK UP, ELECTRO CORP:725833	In Stock	Medium	N/A	
SWITCH, STAGER 48-03	In Stock	Medium	N/A	
STAGER (110V) SERIES 48-03 - W/HOMING SWITCH, OSMONICS: 48-03	In Stock	Low	N/A	
VALVE, ACTUATOR	In Stock	Low	N/A	
ACTUATOR, VALWORX:561055A, ELECT FOR RO INLET VALVE & RINSE VALVE -RO SKID	In Stock	Low	N/A	
SENSOR, VIBRATION	In Stock	High	N/A	
GENERATOR TURBINE END VIBRATION X, BENTLY NEVADA: 3300 SERIES	In Stock	High	N/A	
TURBINE EXHAUST END VIBRATION X	In Stock	High	N/A	
RELATIVE SENSOR, BENTLY NEVADA: 3500 SERIES	In Stock	High	N/A	
ANLZR,COND,8619 24V 4-20MA,BUR	In Stock	Medium	N/A	
WATERTECH SERVICES: 3059496	In Stock	Medium	N/A	
E-CELL INLINE FLOW SENSOR, BURKERT: 3059466	In Stock	Medium	N/A	
E-CELL PRESSURE SWITCH, AUTOMATION DIRECT:3039305	In Stock	Medium	N/A	
PLC-GE, QP+, 7" COLOR, 24VDC,	In Stock	Medium	N/A	
WATERTECH SERVICES: 3134672	In Stock	Medium	N/A	
SENSOR-FLOW, BUR, INLINE, SE30	In Stock	Medium	N/A	
WATERTECH SERVICES: 3059466	In Stock	Medium	N/A	
E-CELL FLOW SENSOR 8020 SHORT, BURKERT:3033067	In Stock	Medium	N/A	
METER, 30-199.9 MV	In Stock	Low	N/A	
E-CELL 30-199.9 MV METER, GENERAL ELECTRIC: 3038073	In Stock	Low	N/A	
TRANSMITTER, PRESSURE	In Stock	Medium	N/A	
E-CELL PRESSURE TRANSMITTER, BURKERT:3059497	In Stock	Medium	N/A	
COMBUSTOR SHELL PRESS TRANSMITTER, SIEMENS:7MF4233-1HA10-1AC1-Z+B21+Y01+Y15	In Stock	High	N/A	
BEARING OIL PRESSURE TRANSMITTER, SIEMENS: 7MF4033-1CA10-1AC7-Z+B21+A02+Y01+Y21+Y15+Y16	In Stock	Low	N/A	
THERMOCOUPLE, TEMPERATURE	In Stock	Low	N/A	
STARTING PACKAGE MOTOR STATOR - TEMPERATURE THERMOCOUPLE, S102629PD-120T305Z96	In Stock	Medium	N/A	
THERMOCOUPLE, TEMPERATURE	In Stock	Medium	N/A	
STARTING PACKAGE MOTOR FORWARD - BEARING TEMPERATURE T/C, S16820PD-300Z96	In Stock	Medium	N/A	

Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25



Recommended Component	Stock	Risk Score	Expected Delivery	Comments
SWITCH, AUXILIARY	In Stock	Low	N/A	
AUX SWITCH, SIEMENS:A01.1LD64				
OIL COMPRESSOR	In Stock	Medium	N/A	
ALL SEASON SELECT OIL, INGERSOLL RAND 38436721	In Stock	Low	N/A	
KIT, E-CELL CLAMP SET: 3033064	In Stock	Medium	N/A	
PLC-AB, ANLG, 4-20, MA, 4IN, 1762-1F4: 1227751	In Stock	Medium	N/A	
SENSOR, CONDUCTIVITY	In Stock	Medium	N/A	
SENSOR-COND,PVDF,0.01CEL,BUR,8220: 3059495	In Stock	Low	N/A	
TERMINAL-FUSE,1P TYPE CC,AB: 1235396	In Stock	Low	N/A	
TERMINAL-FUSE,LED,10-57VAC/VDC,1492-H5: 1152328	In Stock	Low	N/A	
FUSE-DELAY,600V,CLASS CC,6A,BUS: 3054531	In Stock	Low	N/A	
FUSE-BLOCK,600V,100A,MODULAR,BUS: 3020468	In Stock	Low	N/A	
FUSE-FAST,700V,80A,BUS: 3010595	In Stock	Low	N/A	
FUSE-DELAY,600V,CLASS CC,3,5A,LP-CC,BUS: 3126308	In Stock	Low	N/A	
FUSE-DELAY,600V,CLASS CC,2A,BUS: 3060753	In Stock	Low	N/A	
FUSE-DELAY,600V,CLASS CC,4A,LP-CC-4,BUS: 3060754	In Stock	Low	N/A	
FUSE-FAST,250V,CERAMIC,1A,BUS: 3055154	In Stock	Low	N/A	
FUSE-DELAY,600V,CLASS CC,1A,BUS: 3029658	In Stock	Low	N/A	
FUSE-BLOCK,690V,MIDGET,MERSEN,USM1: 3146420	In Stock	Medium	N/A	
PLC-GE,QP+,7" COLOR,24VDC,C755CSW07CDA: 3134672	In Stock	Medium	N/A	
PLC-AB,DIGITAL,24VDC,8 IN,1762-IQ8: 1224240	In Stock	Medium	N/A	
PLC-AB,20DI/12DO/4AI/4AO,1766-132BXBA: 3060729	In Stock	Medium	N/A	
XFMR-CONTROL	In Stock	Medium	N/A	
XFMR-CNTRL,230/575,115-50/60,500VA,SQ-D: 3060802	In Stock	Low	N/A	
POWER SUPPLY, 24VDC	In Stock	Low	N/A	
POWER-SUP,PHOENIX,TRIO,24VDC,5A: 3037802	In Stock	Low	N/A	
SWITCH, PUSH BUTTON	In Stock	Low	N/A	
SWITCH-P-B,IEC,1NC,MAN,BLK,800FP: 3007466	In Stock	Low	N/A	
SWITCH-PUSH PULL,24VDC,IEC,MUSHRM,IL,RED: 3006380	In Stock	Medium	N/A	
RELAY,3PDT,24VDC,10A,700-HA33224: 1152099	In Stock	Medium	N/A	
RELAY,SPDT,24VDC,10A,FINDER,40.31: 3040656	In Stock	Medium	N/A	
E-CELL EDI STACKS, MK3X	In Stock	Low	N/A	
SEAL MECHANICAL FOR FORWARDING PUMPS: 98511844	In Stock	Low	N/A	
SEAL MECHANICAL FOR RO PUMP: 9644664	In Stock	Low	N/A	
FLOW SENSOR TURBINE W/ CABLE - VARIOUS SKIDS: CW237	In Stock	Low	N/A	
BLUEWHITE CHEMICAL INJECTION PUMP: A1N00F-4T	In Stock	Low	N/A	
SOFT STARTER FOR RO: TLOAT52222D4756U	In Stock	Low	N/A	
PLC, PREPROGRAMMED- RO SKID	In Stock	Medium	N/A	
PREPROGRAMMED PLC - RO SKID: DO-06DR-RO	In Stock	Low	N/A	
SWITCH, 3-POSITION, 22MM	In Stock	Low	N/A	
3-POSITION SWITCH 22MM: GCX3320-22	In Stock	Low	N/A	
ACTUATOR ELECT FOR RO INLET VA	In Stock	Low	N/A	
WATERTECH SERVICES: V561055A	In Stock	Low	N/A	
SWITCH, 2-POSITION, 22MM	In Stock	Low	N/A	
2-POSITION SWITCH 22MM: GCX3300	In Stock	Low	N/A	
COLOR TOUCHSCREEN INTERFACE, 6"	In Stock	Medium	N/A	
PREPROGRAMMED 6" COLOR TOUCHSCREEN OPERATOR INTERFACE	In Stock	Medium	N/A	
PERMEATE PUMP SKID: W5EA9-PERM	In Stock	Medium	N/A	



Critical Spares Status
Holyrood – Combustion Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
PLC, PREPROGRAMMED - PERMATE SKID				
PREPROGRAMMED PLC - PERMEATE PUMP SKID: DO-06DR-D-PERM	In Stock	Medium	N/A	
PLC, PREPROGRAMMED - RAW WATER SKID				
PREPROGRAMMED PLC - RAW WATER PUMP SKID: DO-06DR-RW	In Stock	Medium	N/A	
COLOR TOUCHSCREEN INTERFACE, 6"				
PREPROGRAMMED 6" COLOR TOUCHSCREEN OPERATOR INTERFACE				
RAW WATER PUMP SKID: WSEA9-RW	In Stock	Medium	N/A	
COLOR TOUCHSCREEN INTERFACE, 8"				
PREPROGRAMMED 8" COLOR TOUCHSCREEN OPERATOR INTERFACE				
REVERSE OSMOSIS SKID: WSEA9-8RO	In Stock	Medium	N/A	
COLOR TOUCHSCREEN INTERFACE, 10"				
PREPROGRAMMED 10" COLOR TOUCHSCREEN OPERATOR INTERFACE				
REVERSE OSMOSIS SKID: WSEA9-10 RO	In Stock	Medium	N/A	
ORP PREAMPLIFIER				
WATERTECH SERVICES: 5909-273	In Stock	Low	N/A	
CONDUCTIVITY MODULE FOR MULTIFUNCTION MONITOR - RO: 5908.494	In Stock	Low	N/A	
Exhaust Thermocouples	In Stock	High	N/A	



Critical Spares Status
Happy Valley – Gas Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
PLUG, IGNITER FOR PRATT & WHITNEY FT 8 GAS TURBINE P&W 1081559	In Stock	Medium	N/A	
Pressure Switch Pressure Switch (PDSH-601; Sheet 1 - Left-Centre), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch High (PSH-620; Sheet 3 - Left), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch High (PSH-621; Sheet 3 - Centre-Left), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch High (PSH-623; Sheet 3 - Top-Left), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch High (PSH-624; Sheet 3 - Top-Left), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch Low (PSL-604; Sheet 2 - Left), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch Low (PSL-609; Sheet 2 - Centre), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch Low (PSL-613; Sheet 3 - Top-Centre), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch Low (PSL-617; Sheet 3 - Low-Centre), Lubrication System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch (E42-PS1; AB4), Glycol Cooling System	In Stock	Medium	N/A	
Pressure Switch Pressure Switch (E42-PS2; AB5,6), Glycol Cooling System	In Stock	Medium	N/A	
THERMOCOUPLE,P&W 1081998 THERMOCOUPLE, IMMERSION FOR PRATT & WHITNEY FT8 GAS TURBINE P&W #1081998	In Stock	Medium	N/A	
Fuel Filter Fuel Fwd. Skid Fuel Filter (E31-F1; E6)	In Stock	High	N/A	
Lube oil filter Lube Oil Skid Fuel Filter (E31-F4; EF4)	In Stock	High	N/A	
DC Fuel pump (E31-P1; E7)	In Stock	High	N/A	
AC Fuel Pump (E31-P3; C7)	In Stock	High	N/A	
Pressure Differential Switch (E31-PDS1; F6) Fuel System	In Stock	Medium	N/A	
Pressure Switch (E31-PS1; D7) Fuel system	In Stock	Medium	N/A	
Pressure Switch (E31-PS2; D7) Fuel system	In Stock	Medium	N/A	
Pressure Switch Low (E31-PSL4; F4), Fuel System	In Stock	Medium	N/A	



Critical Spares Status
Happy Valley – Gas Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
Pressure Shutdown Low (E31-PSLL1; F4), Fuel System	In Stock	Medium	N/A	
Solenoid Valve (E31-SV1; E2), Fuel System	In Stock	High	N/A	
Solenoid Valve (E31-SV2; E2), Fuel System	In Stock	High	N/A	
Solenoid Valve (E31-SV3; D2), Fuel System	In Stock			
Solenoid Valve (E31-SV4; E2), Fuel System	In Stock	Low	N/A	
Solenoid Valve (E31-SV6; D8), Fuel System	In Stock	Low	N/A	
Filter (F-601; Sheet 1 - Centre-Left), Lubrication System	In Stock	High	N/A	
AC Motor (M-601; Sheet 2 - Left), Lubrication System	In Stock	High	N/A	
DC Motor (M-602; Sheet 2 - Low-Left), Lubrication System	In Stock	High	N/A	
Pump (MOP-601; Sheet 2 - Left), Lubrication System	In Stock	High	N/A	
Pressure Regulator Valve (PDCV-601; Sheet 2 - Low-Right), Lubrication System P&W No. CT113037	In Stock	Low	N/A	
Pressure Safety Valve (PSV-601; Sheet 1 - Right), Lubrication System P&W No. CT112530	In Stock	Low	N/A	
Temperature Control Valve (TCV-601; Sheet 1 - Right), Lubrication System	In Stock	Medium	N/A	
Level Switch (LSL-601 & LSL-601; Sheet 1 - Centre-Right), Lubrication System P&W No. CT110085	In Stock	Low	N/A	
Temperature RTD (TE-601; Sheet 1 - Centre), Lubrication System P&W No. CT112558	In Stock	Low	N/A	
AC Fan Motor (E42-FM1; C7), Glycol Cooling System	In Stock	Low	N/A	
Pump (E42-P1; B5), Glycol Cooling System	In Stock	High	N/A	
AC Pump Motor (E42-PM1; B5), Glycol Cooling System	In Stock	High	N/A	
Pressure Relief Valve (E42-PRV1; AB3,4), Glycol Cooling System	In Stock	Low	N/A	
Self-Actuating Control Valve (E42-TCV1; B6), Glycol Cooling System	In Stock	High	N/A	
Fan Vibration Switch (E42-VSH1; C7,8), Glycol Cooling System	In Stock	Medium	N/A	
Fan Vibration Switch (E42-VSH2; BC7,8), Glycol Cooling System	In Stock	Medium	N/A	
Pneumatic Actuator (E50-PA 1; Sheet 2 - D6), Air Supply System	In Stock	Medium	N/A	
Solenoid Valve (E50-SV1; Sheet 1 - A6), Air Supply System	In Stock	Low	N/A	
Solenoid Valve (E50-SV2; Sheet 1 - C5,6), Air Supply System	In Stock	Low	N/A	
Solenoid Valve (E50-SV3; Sheet 1 - C5,6), Air Supply System	In Stock	Low	N/A	
Solenoid Valve (E50-SV4; Sheet 1 - C3,4), Air Supply System	In Stock	Low	N/A	

Critical Spares Status
Happy Valley – Gas Turbine
26-Sept-25

Recommended Component	Stock	Risk Score	Expected Delivery	Comments
Solenoid Valves (E50-SV5 through E50-SV 35; Sheet 2 - B8), Air Supply System	In Stock	Low	N/A	
Solenoid Valve (E50-SV 36; Sheet 2 - C5,6), Air Supply System	In Stock	Low	N/A	
Solenoid Valve (E50-SV 37; Sheet 2 - AB5), Air Supply System	In Stock	Low	N/A	
Limit Switch (E50-V 31; Sheet 2 - BC6,7), Air Supply System	In Stock	Low	N/A	
Limit Switch (E50-V 32; Sheet 2 - B6,7), Air Supply System	In Stock	Low	N/A	
Limit Switch (E50-V 33; Sheet 2 - B6,7), Air Supply System	In Stock	Low	N/A	
Limit Switch (E50-V 34; Sheet 2 - B6,7), Air Supply System	In Stock	Low	N/A	

Appendix F

Critical Spares Status Listing for Hydraulic Generation



Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - ACCUMULATOR TANK Level switch	In Stock		N/A	N/A
BDE - ACCUMULATOR TANK Pressure switch	In Stock		N/A	N/A
BDE - ADAPTER, REMOTE I/O	In Stock		N/A	N/A
BDE - ADAPTER, REMOTE I/O	In Stock		N/A	N/A
BDE - ADAPTER, REMOTE I/O	In Stock		N/A	N/A
BDE - ADAPTER, REMOTE I/O	In Stock		N/A	N/A
BDE - BACKPLANE, 10 SLOT MODICON	In Stock		N/A	N/A
BDE - BACKPLANE, 10 SLOT MODICON	In Stock		N/A	N/A
BDE - BACKPLANE, 10 SLOT MODICON	In Stock		N/A	N/A
BDE - BACKPLANE, 10 SLOT MODICON	In Stock		N/A	N/A
BDE - BACKPLANE, 10 SLOT MODICON	In Stock		N/A	N/A
BDE - BDE - PUMP, OIL IMO A3DB-275	In Stock		N/A	N/A
BDE - BEARING KIT, IR 32127474	In Stock		N/A	N/A
BDE - BEARING KIT, IR 32127474	In Stock		N/A	N/A
BDE - BELT, V IR 95100160	In Stock		N/A	N/A
BDE - BELT, V IR 95100160	In Stock		N/A	N/A
BDE - BELT, V IR 95100558	In Stock		N/A	N/A
BDE - BELT, V IR 95100558	In Stock		N/A	N/A
BDE - BOARD ASSY, IRD 24144	In Stock		N/A	N/A
BDE - BOARD ASSY, IRD 24144	In Stock		N/A	N/A
BDE - C/T 50/51	In Stock		N/A	N/A
BDE - CABLE, SERIES 925 RESOLVER	In Stock		N/A	N/A
BDE - CABLE, SERIES 925 RESOLVER	In Stock		N/A	N/A
BDE - CARD, IRD 31649	In Stock		N/A	N/A
BDE - CARD, IRD 31649	In Stock		N/A	N/A
BDE - CARD, PRINTED CIRCUIT	In Stock		N/A	N/A
BDE - CARD, PRINTED CIRCUIT	In Stock		N/A	N/A
BDE - COIL, AB CC236	In Stock		N/A	N/A
BDE - COIL, AB CC236	In Stock		N/A	N/A
BDE - COIL, SULL 250018-971	In Stock		N/A	N/A
BDE - CONTACT, CONTACTOR-TYPE DG-1	In Stock		N/A	N/A
BDE - CONTACT, CONTACTOR-TYPE DG-1	In Stock		N/A	N/A
BDE - CREEP DETECTOR ASSY, 129 VCD	In Stock		N/A	N/A
BDE - CREEP DETECTOR ASSY, 129 VCD	In Stock		N/A	N/A
BDE - DISCONNECT SWITCH 29-1 - Complete Unit	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD, ABB HIEE200130R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD, ABB HIEE205011R0001	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - EXCITATION CONTROLS - CARD,ABB HIEE205012R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE205014R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE300661R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE300686R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE300690R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE300698R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE300766R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE305043R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE305069R0001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE30598R1	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - CARD,ABB HIEE401481RD001	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - COIL,ABB HIER464920P1	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - Field Flashing Resistor	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - Field Flashing Resistor	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - MAINBOARD,ABB HIER465176R22	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - POWER SUPPLY,TRACO HIER46651-	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - POWER SUPPLY,TRACO HIER46651-	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - RESISTOR,FIELD DISCHARGE	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - SHUNT,ABB UXAB269330R909	In Stock		N/A	N/A
BDE - EXCITATION CONTROLS - VARISTOR,ABB 3ACD5245A003	In Stock		N/A	N/A
BDE - Exciter POWER ELECTRONICS - BRIDGE,ABB S00772	In Stock		N/A	N/A
BDE - Exciter POWER ELECTRONICS - FAN ASSY,ABB 500773	In Stock		N/A	N/A
BDE - Exciter POWER ELECTRONICS - FUSE,ABB 6,GURD32TTF0800	In Stock		N/A	N/A
BDE - Exciter POWER ELECTRONICS - Pulse Transformers	In Stock		N/A	N/A
BDE - Exciter POWER ELECTRONICS - THYRISTOR,ABB 5STP27F1200	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - ARC-CHUTE,ABB UXAB269399R012	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - BREAKER,ABB HIER466757P2331 (entire unit)	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - CONTACT,ABB UXAB239299R0003	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - CONTACT,ABB UXAB239260R002	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - CONTACT,ABB UXAB269399R032	In Stock		N/A	N/A
BDE - FIELD BREAKER Q02 - PANEL EE - SHUNT,ABB UXAB269350R909	In Stock		N/A	N/A
BDE - FILTER,AIR (ELEMENT ONLY)	In Stock		N/A	N/A
BDE - FILTER,COOLANT (ELEMENT ONLY)	In Stock		N/A	N/A
BDE - GAS,INERGEN (350F3)	In Stock		N/A	N/A
BDE - GAS,INERGEN (425F3)	In Stock		N/A	N/A
BDE - GASKET KIT,IR X1453T47	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - GASKET SET, IR 30423339	In Stock		N/A	N/A
BDE - GASKET SET, IR 30423339	In Stock		N/A	N/A
BDE - GASKET, FLEXMASTER 250007-559	In Stock		N/A	N/A
BDE - GASKET, SULL 040517	In Stock		N/A	N/A
BDE - GATE HOIST - BAY D'ESPOIR - ST - Remote I/O Adapter	In Stock		N/A	N/A
BDE - GENERATOR - CREEP DETECTOR ASSY, 129 VCD	In Stock		N/A	N/A
BDE - GENERATOR - PLATES, BRAKE (24 PER SET)	In Stock		N/A	N/A
BDE - GENERATOR - SWITCH, WOODWARD 8935-139	In Stock		N/A	N/A
BDE - Generator SLIPRING/BRUSH RIGGING - Brush Holders	In Stock		N/A	N/A
BDE - Generator SLIPRING/BRUSH RIGGING - Carbon Brushes	In Stock		N/A	N/A
BDE - Generator SLIPRING/BRUSH RIGGING - Slip Ring	In Stock		N/A	N/A
BDE - GOVERNOR - BEARING, DASHPOT LINK	In Stock		N/A	N/A
BDE - GOVERNOR - BRACKET, WOODWARD 11002-57	In Stock		N/A	N/A
BDE - GOVERNOR - BRACKET, WOODWARD 91588	In Stock		N/A	N/A
BDE - GOVERNOR - BUSHING, DASHPOT - LARGE	In Stock		N/A	N/A
BDE - GOVERNOR - BUSHING, DASHPOT - SMALL	In Stock		N/A	N/A
BDE - GOVERNOR - BUSHING, PILOT VALVE	In Stock		N/A	N/A
BDE - GOVERNOR - BUSHING, SNAP ACTION	In Stock		N/A	N/A
BDE - GOVERNOR - BUSHING, WW 11002-65	In Stock		N/A	N/A
BDE - GOVERNOR - CABLE, AIRCRAFT 1/4 187083	In Stock		N/A	N/A
BDE - GOVERNOR - CLIP, WW 11002-16	In Stock		N/A	N/A
BDE - GOVERNOR - COIL, DASHPOT	In Stock		N/A	N/A
BDE - GOVERNOR - COIL, PARTIAL SHUTDOWN RESET	In Stock		N/A	N/A
BDE - GOVERNOR - COIL, SHUTDOWN SOLENOID	In Stock		N/A	N/A
BDE - GOVERNOR - COIL, SHUTDOWN SOLENOID 65SD	In Stock		N/A	N/A
BDE - GOVERNOR - COIL, WW 202132	In Stock		N/A	N/A
BDE - GOVERNOR - CONTACT, CONTACTOR-TYPE DG-	In Stock		N/A	N/A
BDE - GOVERNOR - DASHPOT, WW 161314	In Stock		N/A	N/A
BDE - GOVERNOR - DIODE, WW 202891	In Stock		N/A	N/A
BDE - GOVERNOR - DISC, RELIEF VALVE	In Stock		N/A	N/A
BDE - GOVERNOR - DISC, UNLOADER	In Stock		N/A	N/A
BDE - GOVERNOR - FILTER, HYD 932633Q	In Stock		N/A	N/A
BDE - GOVERNOR - GASKET KIT, WOODWARD 8926-137	In Stock		N/A	N/A
BDE - GOVERNOR - GASKET, WOODWARD 1327-816	In Stock		N/A	N/A
BDE - GOVERNOR - GASKET, WOODWARD 206317	In Stock		N/A	N/A
BDE - GOVERNOR - LEVER, CONNECTING LOWER	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - GOVERNOR - LEVER, LOWER FLOATING	In Stock		N/A	N/A
BDE - GOVERNOR - LEVER, UPPER FLOATING	In Stock		N/A	N/A
BDE - GOVERNOR - LINK, WOODWARD 070346	In Stock		N/A	N/A
BDE - GOVERNOR - LOCKWASHER, BEARING	In Stock		N/A	N/A
BDE - GOVERNOR - MOTOR ASSY, C/W SHAFT & GEAR	In Stock		N/A	N/A
BDE - GOVERNOR - MOTOR ASSY, GATE LIMIT	In Stock		N/A	N/A
BDE - GOVERNOR - MOTOR, VIBRATING OIL	In Stock		N/A	N/A
BDE - GOVERNOR - MOTOR, GOVERNOR SPEED 28 VOLT	In Stock		N/A	N/A
BDE - GOVERNOR - MOTOR, SYNCHRONIZING	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, BALLARM	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, DASHPOT	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, LOWER DRIVE	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, PIVOT	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, WOODWARD 11002-71	In Stock		N/A	N/A
BDE - GOVERNOR - PIN, WOODWARD 11002-75	In Stock		N/A	N/A
BDE - GOVERNOR - PLUNGER, SNAP ACTION	In Stock		N/A	N/A
BDE - GOVERNOR - POTENTIOMETER, 12500H 0.24A	In Stock		N/A	N/A
BDE - GOVERNOR - PUMP, OIL IMO A3DB-275	In Stock		N/A	N/A
BDE - GOVERNOR - RETAINER, SWITCH	In Stock		N/A	N/A
BDE - GOVERNOR - RING, SNAP (PILOT SERVO PLUG)	In Stock		N/A	N/A
BDE - GOVERNOR - ROTOR, BALL HEAD MOTOR	In Stock		N/A	N/A
BDE - GOVERNOR - SOLENOID, 125 V DC	In Stock		N/A	N/A
BDE - GOVERNOR - SOLENOID, 125VDC 211E	In Stock		N/A	N/A
BDE - GOVERNOR - SPRING, PILOT VALVE LINK	In Stock		N/A	N/A
BDE - GOVERNOR - SPRING, RELIEF	In Stock		N/A	N/A
BDE - GOVERNOR - SPRING, UNLOADER	In Stock		N/A	N/A
BDE - GOVERNOR - STATOR, BALL HEAD MOTOR	In Stock		N/A	N/A
BDE - GOVERNOR - SWITCH, PRESS OIL ALARM	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BALLARM, SPEED SWITCH	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BEARING, PMG P/N Z995205	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BEARING, SPEED SIGNAL	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BEARING, WW 111006	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BEARING, WW 1800125	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BUSHING, OILITE OVERSPEED SWITCH ASSEMBLY	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BUSHING, URETHANE LOWER D	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - BUSHING, URETHANE UPPER D	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - GOVERNOR SPEED GENERATOR - PIN,BALLARM	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - PIN,DOWEL - SPEED SWITCH	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - PIN,ROCKER ARM	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - PIN,TAPERED	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - PLATE,MOUNTING - MERCURY	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - RING,ROTOR	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - SPRING,SPEED SWITCH	In Stock		N/A	N/A
BDE - GOVERNOR SPEED GENERATOR - STATOR,P.M.G.	In Stock		N/A	N/A
BDE - GUIDE BEARING SEGMENTS - bearing segments,	In Stock		N/A	N/A
BDE - HEADCOVER ASSEMBLY - UNIT 1 - BUSHING,UPPER HEAD COVER P003	In Stock		N/A	N/A
BDE - HEADCOVER ASSEMBLY - UNIT 1 - BUSHING,UPPER WICKET	In Stock		N/A	N/A
BDE - Heat Sink Exciter	In Stock		N/A	N/A
BDE - INTAKE GATE - BACKPLANE,6 SLOT MODICON	In Stock		N/A	N/A
BDE - INTAKE STRUCTURE NO. 1 - TRANSMITTER,PRESS 0-6MH20	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - CT 50/51	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - Surge Capacitor	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - Surge Capacitor	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - XFMR,CT 1000:	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - XFMR,CT 13.8KV	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - XFMR,CT 30332313	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - XFMR,CT 800:5	In Stock		N/A	N/A
BDE - ISOLATED PHASE BUS - XFMR,PT 14400KV	In Stock		N/A	N/A
BDE - METER, TEMP DIGITAL	In Stock		N/A	N/A
BDE - METER, TEMP DIGITAL	In Stock		N/A	N/A
BDE - MODULE,ANALOG QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ANALOG QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ANALOG QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ANALOG QUANTUM	In Stock		N/A	N/A
BDE - MODULE,CPU MODICON	In Stock		N/A	N/A
BDE - MODULE,CPU MODICON	In Stock		N/A	N/A
BDE - MODULE,CPU MODICON	In Stock		N/A	N/A
BDE - MODULE,CPU MODICON	In Stock		N/A	N/A
BDE - MODULE,DISCRETE IN	In Stock		N/A	N/A
BDE - MODULE,DISCRETE IN	In Stock		N/A	N/A
BDE - MODULE,DISCRETE IN	In Stock		N/A	N/A
BDE - MODULE,DISCRETE IN	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - MODULE,DISCRETE OUT	In Stock		N/A	N/A
BDE - MODULE,DISCRETE OUT	In Stock		N/A	N/A
BDE - MODULE,DISCRETE OUT	In Stock		N/A	N/A
BDE - MODULE,DISCRETE OUT	In Stock		N/A	N/A
BDE - MODULE,ETHERNET QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ETHERNET QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ETHERNET QUANTUM	In Stock		N/A	N/A
BDE - MODULE,ETHERNET QUANTUM	In Stock		N/A	N/A
BDE - MODULE,GPS QUANTUM	In Stock		N/A	N/A
BDE - MODULE,GPS QUANTUM	In Stock		N/A	N/A
BDE - MODULE,GPS QUANTUM	In Stock		N/A	N/A
BDE - MODULE,GPS QUANTUM	In Stock		N/A	N/A
BDE - MODULE,HOT STANDBY	In Stock		N/A	N/A
BDE - MODULE,HOT STANDBY	In Stock		N/A	N/A
BDE - MODULE,HOT STANDBY	In Stock		N/A	N/A
BDE - MODULE,HOT STANDBY	In Stock		N/A	N/A
BDE - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - MODULE,RACK FILLER	In Stock		N/A	N/A
BDE - MODULE,RACK FILLER	In Stock		N/A	N/A
BDE - MODULE,RACK FILLER	In Stock		N/A	N/A
BDE - MODULE,RACK FILLER	In Stock		N/A	N/A
BDE - MODULE,RELAY OUT	In Stock		N/A	N/A
BDE - MODULE,RELAY OUT	In Stock		N/A	N/A
BDE - MODULE,RELAY OUT	In Stock		N/A	N/A
BDE - MONITOR,15" TOUCHSCREEN	In Stock		N/A	N/A
BDE - MONITOR,15" TOUCHSCREEN	In Stock		N/A	N/A
BDE - MOTOR,ELECT 15HP 575V	In Stock		N/A	N/A
BDE - MOTOR,ELECT 15HP 575V	In Stock		N/A	N/A
BDE - MOTOR,SYNCHRONIZING	In Stock		N/A	N/A
BDE - MOTOR,SYNCHRONIZING	In Stock		N/A	N/A
BDE - NEUTRAL GROUND TRANSFORMER	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - PACKING,V TYPE 2-EASY	In Stock		N/A	N/A
BDE - PACKING,V TYPE 2-EASY	In Stock		N/A	N/A
BDE - PACKING,V TYPE 2-EASY	In Stock		N/A	N/A
BDE - PACKING,V TYPE 2-EASY	In Stock		N/A	N/A
BDE - PANEL STATION SERVICE - PH #2 - ACB	In Stock		N/A	N/A
BDE - PEN ARM MOVEMENT ASSY,RECORDR	In Stock		N/A	N/A
BDE - PEN ARM MOVEMENT ASSY,RECORDR	In Stock		N/A	N/A
BDE - PENSTOCK NO. 1 - TRANSMITTER,PRESS 0-375	In Stock		N/A	N/A
BDE - PENSTOCK NO. 2 - TRANSMITTER,PRESS 0-375	In Stock		N/A	N/A
BDE - PENSTOCK NO. 3 - TRANSMITTER,PRESS 0-375	In Stock		N/A	N/A
BDE - PENSTOCK NO. 4 - TRANSMITTER,PRESS 0-375	In Stock		N/A	N/A
BDE - PICK-UP, MAGNETIC 5430-929	In Stock		N/A	N/A
BDE - PICK-UP, MAGNETIC 5430-929	In Stock		N/A	N/A
BDE - PICK-UP, NON-CONTACT	In Stock		N/A	N/A
BDE - PICK-UP, NON-CONTACT	In Stock		N/A	N/A
BDE - PICK-UP, SPEED SENSING	In Stock		N/A	N/A
BDE - PICK-UP, SPEED SENSING	In Stock		N/A	N/A
BDE - piston D/S	In Stock		N/A	N/A
BDE - piston U/S	In Stock		N/A	N/A
BDE - PISTON,PIN ASSY PE#32054504	In Stock		N/A	N/A
BDE - PISTON,PIN ASSY PE#32054538	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30215222	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30215222	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30215438	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30215438	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30292460	In Stock		N/A	N/A
BDE - PISTON/PIN ASSY,IR 30292460	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - ADAPTER,REMOTE I/O	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - BACKPLANE,10 SLOT MODICON	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,ANALOG QUANTUM	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,CPU MODICON	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,DISCRETE IN	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,DISCRETE OUT	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,ETHERNET QUANTUM	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,GPS QUANTUM	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,HOT STANDBY	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - PLC,Model Quantum- Modicon - MODULE,INTERFACE PLC	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,RACK FILLER	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - MODULE,RELAY OUT	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - POWER SUPPLY,125 VDC	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - PLC,Model Quantum- Modicon - REMOTE I/O HEAD,MODICON	In Stock		N/A	N/A
BDE - POTENTIOMETER,12500H 0.24A	In Stock		N/A	N/A
BDE - POTENTIOMETER,12500H 0.24A	In Stock		N/A	N/A
BDE - POTENTIOMETER,12500H 0.24A	In Stock		N/A	N/A
BDE - POTENTIOMETER,12500H 0.24A	In Stock		N/A	N/A
BDE - POTENTIOMETER,1K OH .244 A	In Stock		N/A	N/A
BDE - POTENTIOMETER,1K OH .244 A	In Stock		N/A	N/A
BDE - POTENTIOMETER,25W 50 OHMS	In Stock		N/A	N/A
BDE - POTENTIOMETER,25W 50 OHMS	In Stock		N/A	N/A
BDE - POTENTIOMETER,SPEED	In Stock		N/A	N/A
BDE - POTENTIOMETER,SPEED	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY, 125 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,125 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,125 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,125VDC 8A	In Stock		N/A	N/A
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24 VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,24VDC	In Stock		N/A	N/A
BDE - POWER SUPPLY,300W	In Stock		N/A	N/A
BDE - POWER SUPPLY,300W	In Stock		N/A	N/A
BDE - POWER SUPPLY,48VDC 240W	In Stock		N/A	N/A
BDE - POWER SUPPLY,48VDC 240W	In Stock		N/A	N/A
BDE - POWER SUPPLY,IRD PCB 29128	In Stock		N/A	N/A
BDE - POWER SUPPLY,IRD PCB 29128	In Stock		N/A	N/A
BDE - PROBE SYSTEM,CAPACITANCE	In Stock		N/A	N/A
BDE - PROBE SYSTEM,CAPACITANCE	In Stock		N/A	N/A
BDE - PROBE,CAPACITANCE	In Stock		N/A	N/A
BDE - PROBE,CAPACITANCE	In Stock		N/A	N/A
BDE - PROCESSOR,MICRO-CENTRAL	In Stock		N/A	N/A
BDE - PROCESSOR,MICRO-CENTRAL	In Stock		N/A	N/A
BDE - PROCESSOR,PLC	In Stock		N/A	N/A
BDE - PROCESSOR,PLC	In Stock		N/A	N/A
BDE - PROCESSOR,PROG C/W 1772-MJ	In Stock		N/A	N/A
BDE - PROCESSOR,PROG C/W 1772-MJ	In Stock		N/A	N/A
BDE - PROTRACTOR,ANSUL 423958	In Stock		N/A	N/A
BDE - PUMP,OIL IMO A3DB-275	In Stock		N/A	N/A
BDE - RECTIFYING TRANSFORMER - Full Unit	In Stock		N/A	N/A
BDE - RECTIFYING TRANSFORMER - Insulating Fluid	In Stock		N/A	N/A
BDE - REGULATOR KIT,SULL 250019-453	In Stock		N/A	N/A
BDE - RELAY,ADJUSTABLE AC V SENSOR	In Stock		N/A	N/A
BDE - RELAY,ADJUSTABLE AC V SENSOR	In Stock		N/A	N/A
BDE - RELAY,GROUND VOLTAGE	In Stock		N/A	N/A
BDE - RELAY,INSTANTANEOUS CURRENT	In Stock		N/A	N/A
BDE - RELAY,INSTANTANEOUS CURRENT	In Stock		N/A	N/A
BDE - RELAY,INSTANTANEOUS CURRENT	In Stock		N/A	N/A
BDE - RELAY,LEVEL CONTROL #1001	In Stock		N/A	N/A
BDE - RELAY,OVERCURRENT 1600A 3POLE	In Stock		N/A	N/A
BDE - RELAY,UNDERVOLTAGE 125VAC	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - REMOTE I/O HEAD,MODICON	In Stock		N/A	N/A
BDE - REMOTE I/O HEAD,MODICON	In Stock		N/A	N/A
BDE - REMOTE I/O HEAD,MODICON	In Stock		N/A	N/A
BDE - REMOTE I/O HEAD,MODICON	In Stock		N/A	N/A
BDE - RING SET,IR 32194144	In Stock		N/A	N/A
BDE - RING,PISTON SERVO MOTOR 18"OD	In Stock		N/A	N/A
BDE - RING,PISTON SERVO MOTOR 18"OD	In Stock		N/A	N/A
BDE - RING,PISTON SERVO MOTOR 18"OD	In Stock		N/A	N/A
BDE - RING,PISTON SERVO MOTOR 18"OD	In Stock		N/A	N/A
BDE - ROTOR POLES - Pole	In Stock		N/A	N/A
BDE - ROTOR SHAFT - Rotating Ring	In Stock		N/A	N/A
BDE - RUNNER - UNIT 1 - BOLT,SHAFT TO RUNNER	In Stock		N/A	N/A
BDE - seal movable	In Stock		N/A	N/A
BDE - seal stationary	In Stock		N/A	N/A
BDE - seal stationary	In Stock		N/A	N/A
BDE - SENSOR,CABLE REEL LINEAR	In Stock		N/A	N/A
BDE - SHAFT,SERVOMOTOR 4140	In Stock		N/A	N/A
BDE - SHAFT,SERVOMOTOR 4140	In Stock		N/A	N/A
BDE - SHAFT,SERVOMOTOR 4140	In Stock		N/A	N/A
BDE - SHAFT,SERVOMOTOR 4140	In Stock		N/A	N/A
BDE - SPILLWAY #1-SALMON RIVE - Lift gearboxes/nuts	In Stock		N/A	N/A
BDE - STATION SERVICE - BDE PH1 - ACB	In Stock		N/A	N/A
BDE - STATION SERVICE - BDE PH1 - Trip Unit - Breker control device	In Stock		N/A	N/A
BDE - stationary ring	In Stock		N/A	N/A
BDE - STATOR ASSEMBLY - BAR,COPPER 1/2"X2"X10'	In Stock		N/A	N/A
BDE - STATOR ASSEMBLY - BAR,ROTOR CONNECTION	In Stock		N/A	N/A
BDE - STATOR ASSEMBLY - BAR,ROTOR CONNECTION	In Stock		N/A	N/A
BDE - STATOR ASSEMBLY - BAR,STATOR	In Stock		N/A	N/A
BDE - STATOR ASSEMBLY - BAR,STATOR	In Stock		N/A	N/A
BDE - STATOR WINDINGS - UNIT 1 - CONNECTOR,STATOR CU	In Stock		N/A	N/A
BDE - STATOR WINDINGS - UNIT 1 to 4 - Coils	In Stock		N/A	N/A
BDE - SURFACE AIR COOLERS - SAC Unit	In Stock		N/A	N/A
BDE - SURFACE AIR COOLERS - Tubes	In Stock		N/A	N/A
BDE - THRUST BEARING SEGMENTS - bearing segments,	In Stock		N/A	N/A
BDE - THRUST/GUIDE BEARING ASSEMBLY - Oil	In Stock		N/A	N/A
BDE - THRUST/GUIDE BEARING ASSEMBLY - Springs	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - THRUST/GUIDE BEARING ASSEMBLY - TRANSMITTER,DIFF	In Stock		N/A	N/A
BDE - THRUST/GUIDE BEARING COOLERS - Cooler	In Stock		N/A	N/A
BDE - TURBINE - Turbine Carbon Seal (Units 1 to 4)	In Stock		N/A	N/A
BDE - TURBINE - Turbine Carohn Seal (Units 5 & 6)	In Stock		N/A	N/A
BDE - TURBINE GUIDE BEARING - Bearing	In Stock		N/A	N/A
BDE - TURBINE GUIDE BEARING - oil cooler	In Stock		N/A	N/A
BDE - Unit 5/6 Rotor Pole	In Stock		N/A	N/A
BDE - POWER SUPPLY, 480W, 24V DC, MAIN ANNUNCIATOR Part # 1606-XLS480E (Allen-Bradley)	In Stock		N/A	N/A
BDE - POWER SUPPLY, 24VDC, CONTROL LOGIX, MAIN ANNUNCIATOR Part # 1756-PB72 (Rockwell)	In Stock		N/A	N/A
BDE - INTERFACE MODULE, MAIN ANNUNCIATOR Part # 1756-EN2TR (Rockwell)	In Stock		N/A	N/A
BDE - CONTROLLER< CONTROL LOGIX, MAIN ANNUNCIATOR Part # 1756-L71 (Rockwell)	In Stock		N/A	N/A
BDE - MODULE, CONTROL LOGIX, MAIN ANNUNCIATOR Part # 1756-IB32 (Rockwell)	In Stock		N/A	N/A
BDE - Unit 7 Control Board - BOARD,CONTROL	In Stock		N/A	N/A
BDE - Unit 7 DRAFT TUBE-TURBINE - Water Level Probe	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - BOARD,DIGITAL I/O	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - BOARD,I/O ANALOG	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - BOARD,MEASURING ABB	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - BOARD,POWER SYSTEM STABI	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - CAPACITOR,20 MF +-10% 150 V	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - COMPONENT, INTEG CCT	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - CONTACT,ISOLATING	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - INTEG CCT	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - MODULE,ABB DC5500B200361	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - PANEL,CONTROL	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - POWER SUPPLY,ABB 3BHE013940R00	In Stock		N/A	N/A
BDE - UNIT 7 EXCITER - RELAY,GROUND VOLTAGE	In Stock		N/A	N/A
BDE - Unit 7 GENERATOR COOLING WATER SYSTEM - TRANSMITTER,DIFF	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - ARC CHUTE,ABB UXAB289199215	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - BREAKER,ABB EZNE1600MS4-B1	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - Charging Motor	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - COIL,SHUNT CLOSING	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - COIL,SHUNT OPENING	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - Unit 7 Generator Field Breaker - CONTACT,ABB UXAB239Z60R0	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - Main Fixed Contacts	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - Main Moving Contacts	In Stock		N/A	N/A
BDE - Unit 7 Generator Field Breaker - MOTOR,CHARGING	In Stock		N/A	N/A
BDE - Unit 7 GENERATOR GUIDE BEARING - segments	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - FILTER, HYD 932633Q	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,BALLARM	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,DASHPOT	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,LOWER DRIVE	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,PIVOT	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,ROCKER ARM	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,WOODWARD 11002-71	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PIN,WOODWARD 11002-75	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PLUNGER,SNAP ACTION	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - POTENTIOMETER,12500H 0.24A	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - PUMP,OIL IMO A3DB-275	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - RETAINER,SWITCH	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - RING,SNAP (PILOT SERVO PLUG)	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - ROTOR,BALL HEAD MOTOR	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SENSOR,LOAD GOVERNOR	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SOLENOID,125 V DC	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SOLENOID,125VDC 211E	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SPRING,PILOT VALVE LINK	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SPRING,SPEED SWITCH	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - STATOR,BALL HEAD MOTOR	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - STATOR,PERMANENT MAGNET	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - SWITCH,PRESS OIL ALARM	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - Unloader/Relief Valve	In Stock		N/A	N/A
BDE - UNIT 7 GOVERNOR - Unloader/Relief Valve	In Stock		N/A	N/A
BDE - Unit 7 HEADCOVER ASSEMBLY - BOTTOM RING P001 bushing	In Stock		N/A	N/A
BDE - Unit 7 HEADCOVER ASSEMBLY - BUSHING,LOWER HEAD COVER P001	In Stock		N/A	N/A
BDE - Unit 7 HEADCOVER ASSEMBLY - PACKING,V-TYPE 3/8 EASY	In Stock		N/A	N/A
BDE - UNIT 7 HYDRAULIC GENERATOR - coolers	In Stock		N/A	N/A
BDE - UNIT 7 NEUTRAL GROUND RESISTOR	In Stock		N/A	N/A
BDE - Unit 7 NEUTRAL GROUND TRANSFORMER - transformer	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - BUSHING,LINK PIN	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - Unit 7 OPERATING RING - CAP,SHEARPIN	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - LEVER,WICKET GATE	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - Linkage	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - PIN,ECCENTRIC P005	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - PIN,LINK P006	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - PIN,ROD SHEARPIN	In Stock		N/A	N/A
BDE - Unit 7 OPERATING RING - PIN,UPPER DRIVE	In Stock		N/A	N/A
BDE - Unit 7 PMG - BALLARM,SPEED SWITCH	In Stock		N/A	N/A
BDE - Unit 7 PMG - BEARING,PMG P/N Z995205	In Stock		N/A	N/A
BDE - Unit 7 PMG - BEARING,SPEED SIGNAL	In Stock		N/A	N/A
BDE - Unit 7 PMG - BEARING,WW 111006	In Stock		N/A	N/A
BDE - Unit 7 PMG - BEARING,WW 1800125	In Stock		N/A	N/A
BDE - Unit 7 PMG - BUSHING, OILITE OVERSPEED SWITCH ASSEMBLY	In Stock		N/A	N/A
BDE - Unit 7 PMG - BUSHING,URETHANE LOWER D	In Stock		N/A	N/A
BDE - Unit 7 PMG - BUSHING,URETHANE UPPER D	In Stock		N/A	N/A
BDE - Unit 7 PMG - PIN,BALLARM	In Stock		N/A	N/A
BDE - Unit 7 PMG - PIN,DOWEL - SPEED SWITCH	In Stock		N/A	N/A
BDE - Unit 7 PMG - PIN,ROCKER ARM	In Stock		N/A	N/A
BDE - Unit 7 PMG - PIN,TAPERED	In Stock		N/A	N/A
BDE - Unit 7 PMG - PLATE,MOUNTING - MERCURY	In Stock		N/A	N/A
BDE - Unit 7 PMG - RING,ROTOR	In Stock		N/A	N/A
BDE - Unit 7 PMG - SPRING,SPEED SWITCH	In Stock		N/A	N/A
BDE - Unit 7 PMG - STATOR,P. M. G.	In Stock		N/A	N/A
BDE - Unit 7 RECTIFYING TRANSFORMER	In Stock		N/A	N/A
BDE - Unit 7 ROTOR - Pole	In Stock		N/A	N/A
BDE - Unit 7 ROTOR ASSEMBLY - POLE	In Stock		N/A	N/A
BDE - Unit 7 RUNNER - TURBINE - CARBON SEAL	In Stock		N/A	N/A
BDE - Unit 7 SERVOMOTOR # 1 - PACKING,SERVOMOTOR	In Stock		N/A	N/A
BDE - Unit 7 SERVOMOTOR # 1 - PACKING,V TYPE 2-EASY	In Stock		N/A	N/A
BDE - Unit 7 SERVOMOTOR # 1 - PACKING,V-TYPE 9"x8"ID	In Stock		N/A	N/A
BDE - Unit 7 SERVOMOTOR # 1 - Piston Ring	In Stock		N/A	N/A
BDE - UNIT 7 Slip Ring	In Stock		N/A	N/A
BDE - Unit 7 SLIPRING/BRUSH RIGGING - Brushes	In Stock		N/A	N/A
BDE - Unit 7 SLIPRING/BRUSH RIGGING - Collector rings	In Stock		N/A	N/A
BDE - Unit 7 Spare Pole	In Stock		N/A	N/A
BDE - Unit 7 STATOR WINDINGS - Stator Bars	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
BDE - Unit 7 STATOR WINDINGS - Wedges	In Stock		N/A	N/A
BDE - Unit 7 SURFACE AIR COOLERS - Tubes	In Stock		N/A	N/A
BDE - Unit 7 THRUST BEARING - Rotating Ring	In Stock		N/A	N/A
BDE - Unit 7 THRUST BEARING - Thrust Pads	In Stock		N/A	N/A
BDE - Unit 7 THRUST/GUIDE BEARING COOLERS - Coolers	In Stock		N/A	N/A
BDE - UNIT 7 TURBINE - Carbon Seal	In Stock		N/A	N/A
BDE - UNIT 7 TURBINE - turbine bearing	In Stock		N/A	N/A
BDE - UNIT 7 TURBINE - wicket gate	In Stock		N/A	N/A
BDE - Unit 7 TURBINE GUIDE BEARING - bearing	In Stock		N/A	N/A
BDE - Unit 7 VIBRATION MONITORING - PICK-UP, NON-CONTACT	In Stock		N/A	N/A
BDE - Unit 7 VIBRATION MONITORING - PICK-UP, SPEED SENSING	In Stock		N/A	N/A
BDE - Unit 7 VIBRATION MONITORING - POWER SUPPLY, IRD PCB 29128	In Stock		N/A	N/A
BDE - Unit 7 WICKET GATES - GATE, WICKET	In Stock		N/A	N/A
BDE - VALVE, 1" THERMAL TRIP	In Stock		N/A	N/A
BDE - VALVE, CONT. 1/2 4-WAY SS	In Stock		N/A	N/A
BDE - VALVE, CONT. 1/2 4-WAY SS	In Stock		N/A	N/A
BDE - VALVE, CONT. 1/2" 4-WAY SS	In Stock		N/A	N/A
BDE - VALVE, CONT. 1/2" 4-WAY SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 1" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 1" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 2" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 2" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 2" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 2" SS	In Stock		N/A	N/A
BDE - VALVE, CONTROL 2" SS	In Stock		N/A	N/A
BDE - WICKET GATES AND LINKAGES - PACKING, V TYPE 2-EASY	In Stock		N/A	N/A
BDE - WICKET GATES AND LINKAGES - PIN, ECCENTRIC	In Stock		N/A	N/A
BDE - WICKET GATES AND LINKAGES - RING, PISTON SERVO MOTOR 18" OD	In Stock		N/A	N/A
BDE - WICKET GATES AND LINKAGES - Shear Pins	In Stock		N/A	N/A
BDE - Surge Tank 600V Hot Water Heater	In Stock		N/A	N/A
CAT - ACCUMULATOR TANK - Air Admission Valve	In Stock		N/A	N/A
CAT - ACCUMULATOR TANK - COIL AUTO AIR CHARGING SOLID	In Stock		N/A	N/A
CAT - ARC-CHUTE ABB #15DA045697R1	In Stock		N/A	N/A
CAT - ARC-CHUTE STATION SERVICE, 3 PHASE, 600V	In Stock		N/A	N/A
CAT - BEARING KIT, IR 32127516	In Stock		N/A	N/A
CAT - BEARING, GUIDE	In Stock		N/A	N/A
CAT - BEARING, BOWL - INTERMEDIATE	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - BEARING,BOWL - TOP	In Stock		N/A	N/A
CAT - BEARING,BRIER HYD33A66	In Stock		N/A	N/A
CAT - BEARING,LINESHAFT	In Stock		N/A	N/A
CAT - BEARING,STUFFING BOX	In Stock		N/A	N/A
CAT - BEARING,SUCTION CASE	In Stock		N/A	N/A
CAT - BELT, V IR 95100558	In Stock		N/A	N/A
CAT - BOARD, CONTROL	In Stock		N/A	N/A
CAT - BOARD, DIGITAL I/O	In Stock		N/A	N/A
CAT - BOARD, I/O ANALOG	In Stock		N/A	N/A
CAT - BOARD, MEASURING ABB	In Stock		N/A	N/A
CAT - BOARD, POWER SYSTEM STABI	In Stock		N/A	N/A
CAT - BRAKING JET ASSEMBLY - Control Valve	In Stock			
CAT - BREAKER, EXCITER ABB	In Stock		N/A	N/A
CAT - BREAKERS BY BROWN BOVERI, 600V - spare field breaker in used spare exciter	In Stock		N/A	N/A
CAT - Cartridge, Oil Separator	In Stock		N/A	N/A
CAT - COIL, CONTACTOR 130 V 84D418	In Stock		N/A	N/A
CAT - COIL, SHUNT CLOSING	In Stock		N/A	N/A
CAT - COIL, SHUNT OPENING	In Stock		N/A	N/A
CAT - COLLAR,SAND	In Stock		N/A	N/A
CAT - CONTACT, NORMAL LONG 700C	In Stock		N/A	N/A
CAT - CONTACT, NORMAL SHORT 700	In Stock		N/A	N/A
CAT - CONTACT, OVERLAP LONG 700	In Stock		N/A	N/A
CAT - CONTACT, OVERLAP SHORT 70	In Stock		N/A	N/A
CAT - CONTACT,I SOLATING	In Stock		N/A	N/A
CAT - CONTROLLER,PLC DL05	In Stock		N/A	N/A
CAT - Electronic Governor - BUSHING CABLE PROP VLV,	In Stock		N/A	N/A
CAT - Electronic Governor - CONNECTOR,MLDT ROD BALL	In Stock		N/A	N/A
CAT - Electronic Governor - CONVERTER,SERIAL/ETHERNET	In Stock		N/A	N/A
CAT - Electronic Governor - Deflector proportional	In Stock		N/A	N/A
CAT - Electronic Governor - Guide Ball Slide	In Stock		N/A	N/A
CAT - Electronic Governor - HOLDER,CIRCUIT BREAKER	In Stock		N/A	N/A
CAT - Electronic Governor - INTERFACE,ETHERNET VERSA	In Stock		N/A	N/A
CAT - Electronic Governor - LVDT deflector	In Stock		N/A	N/A
CAT - Electronic Governor - MODULE,GE AMPLIFIER	In Stock		N/A	N/A
CAT - Electronic Governor - MODULE,GE PT INTERFACE	In Stock		N/A	N/A
CAT - Electronic Governor - MODULE,PLUG-IN DIODE	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - Electronic Governor - MODULE, VERSAMAX 16 PT	In Stock		N/A	N/A
CAT - Electronic Governor - MODULE, VERSAMAX 32 PT	In Stock		N/A	N/A
CAT - Electronic Governor - MODULE, VERSAMAX 4 AO	In Stock		N/A	N/A
CAT - Electronic Governor - PC, Atlas 2	In Stock		N/A	N/A
CAT - Electronic Governor - PC, ATLAS VX WORKS	In Stock		N/A	N/A
CAT - Electronic Governor - Pos.Xducer	In Stock		N/A	N/A
CAT - Electronic Governor - Pos.Xducer	In Stock		N/A	N/A
CAT - Electronic Governor - PROBE,SPEED ZVPU	In Stock		N/A	N/A
CAT - Electronic Governor - RELAY,14 PIN PLUG 24VDC	In Stock		N/A	N/A
CAT - Electronic Governor - Rod vdeflector	In Stock		N/A	N/A
CAT - Electronic Governor - VERSAMAX powersupply	In Stock		N/A	N/A
CAT - Element, Air Filter	In Stock		N/A	N/A
CAT - ELEMENT,AFTER FILTER	In Stock		N/A	N/A
CAT - ELEMENT,AIR FILTER	In Stock		N/A	N/A
CAT - ELEMENT,PRE FILTER	In Stock		N/A	N/A
CAT - EXCITATION TRF	In Stock		N/A	N/A
CAT - Exciter # 1 - BOARD POWER SYSTEM STABI,	In Stock		N/A	N/A
CAT - Exciter # 1 - DIGITAL I/O BOARD,	In Stock		N/A	N/A
CAT - Exciter # 1 - Arc Chute	In Stock		N/A	N/A
CAT - Exciter # 1 - BOARD MEASURING,	In Stock		N/A	N/A
CAT - Exciter # 1 - Breaker	In Stock		N/A	N/A
CAT - Exciter # 1 - COIL,SHUNT CLOSING	In Stock		N/A	N/A
CAT - Exciter # 1 - COIL,SHUNT OPENING	In Stock		N/A	N/A
CAT - Exciter # 1 - CONTACT,ISOLATING	In Stock		N/A	N/A
CAT - Exciter # 1 - Control Board	In Stock		N/A	N/A
CAT - Exciter # 1 - I/O ANALOG BOARD CONTROL,	In Stock		N/A	N/A
CAT - Exciter # 1 - MODULE,THYRISTOR BRIDGE	In Stock		N/A	N/A
CAT - Exciter # 1 - MOTOR,CHARGING	In Stock		N/A	N/A
CAT - Exciter # 1 - PANEL,CONTROL	In Stock		N/A	N/A
CAT - Exciter # 1 - SUPPLY,110-220 VOLT	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Analog Input Transducer	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB 1WX 174-2,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB HIER319619R2,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB IXX9170A V1,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN 2010B-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0016A-P,	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - EXCITER NO. 2 - CARD ABB UN0025A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0026A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0027A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0031A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN004A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0079A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0083A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0089A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0091A-P, CARD ABB UN0093A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0503A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0510C-9,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0516A,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0900B-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN0901B-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN1001C-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN1004A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UN1024C-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UNC001D-E,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD ABB UNS0026A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD BBC UN0077AP,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD BBC UN2001F-P	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD\ ABB UN0014B-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CARD\ ABB UN1004A-P,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - COIL,125 VOLT 60HZ	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - COIL,SHUNT CLOSING	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - CONTROL BOARD,	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Field Voltage Transducer	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Fuse 600Amp	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Shunt Voltage Transducer	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Thyristor	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Transformer	In Stock		N/A	N/A
CAT - EXCITER NO. 2 - Unitrol Card	In Stock		N/A	N/A
CAT - Filter, Mat	In Stock		N/A	N/A
CAT - Filter, Oil	In Stock		N/A	N/A
CAT - FILTER,AIR INTAKE - 101T	In Stock		N/A	N/A
CAT - FILTER,ELEMENT 10 MICRON	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - FLOAT - 2315	In Stock		N/A	N/A
CAT - GASKET SET, IR 30423339	In Stock	Item #68001594	N/A	N/A
CAT - GENERATOR - Brake ring	In Stock	Item #58608396	N/A	N/A
CAT - GENERATOR - Brake Solenoid	In Stock	Item #65300060	N/A	N/A
CAT - GENERATOR - Brake valve	In Stock	Item #68001592	N/A	N/A
CAT - GENERATOR - INSLTR,SLIP RING	In Stock	Item #68001591	N/A	N/A
CAT - GENERATOR - MODULE,TYP 1CD 108 M 2-02 vibro-meter	In Stock	Item #60101058	N/A	N/A
CAT - GENERATOR - OVERCURRENT relay	In Stock		N/A	N/A
CAT - GENERATOR - RELAY,TIME DELAY .6 - 1.0	In Stock	Item #58800486	N/A	N/A
CAT - GENERATOR - rotating ring	In Stock	Item #68001626	N/A	N/A
CAT - Generator Bearing - Cooler	In Stock		N/A	N/A
CAT - Governor - JOINT, UNIVERSAL SSG #1787058	In Stock		N/A	N/A
CAT - Governor Control System - CABLE DEFLECTOR FDBK AMP	In Stock		N/A	N/A
CAT - Governor Control System - CABLE FEEDBACK 20'	In Stock		N/A	N/A
CAT - Governor Control System - CABLE FEEDBACK 200'	In Stock		N/A	N/A
CAT - Governor Control System - CABLE FEEDBACK 50'	In Stock		N/A	N/A
CAT - Governor Control System - CABLE PROPORTIONAL VLV	In Stock		N/A	N/A
CAT - Governor Control System - CABLE,NEEDLE FDBK AMP,	In Stock		N/A	N/A
CAT - Governor Control System - CABLE90 DEG.5' ZVPU,	In Stock		N/A	N/A
CAT - Governor Control System - Power Supply	In Stock		N/A	N/A
CAT - Governor Control System - Power Supply 24V	In Stock		N/A	N/A
CAT - Governor Hydraulics - Cooler	In Stock		N/A	N/A
CAT - Governor Hydraulics - Deflector valve	In Stock		N/A	N/A
CAT - Governor Hydraulics - DEFLECTOR,SERVOMOTOR	In Stock		N/A	N/A
CAT - Governor Hydraulics - ELEMENT,FILTER SM 10	In Stock		N/A	N/A
CAT - Governor Hydraulics - ELEMENT,FILTER SM 25	In Stock		N/A	N/A
CAT - Governor Hydraulics - OIL,TURBINE 46 (205L)	In Stock		N/A	N/A
CAT - Governor Hydraulics - Piston seal 725X8 X3/8	In Stock		N/A	N/A
CAT - Governor Hydraulics - Piston seal 9X8X1/2	In Stock		N/A	N/A
CAT - Governor Hydraulics - PLUG,C/V 010168-390-163	In Stock		N/A	N/A
CAT - Governor Hydraulics - PLUG,C/V 021002-281-208	In Stock		N/A	N/A
CAT - Governor Hydraulics - PLUG,ESCHER WYSS	In Stock		N/A	N/A
CAT - Governor Hydraulics - Pressure Switch	In Stock		N/A	N/A
CAT - Governor Hydraulics - Seal	In Stock		N/A	N/A
CAT - Governor Pumps - INSERT,CURVED JAW SPIDER	In Stock		N/A	N/A
CAT - Governor Pumps - Pump	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - Guide Bearing Segments - Bearing	In Stock		N/A	N/A
CAT - Isolated Phase Bus - PT fuse	In Stock		N/A	N/A
CAT - Lightning Arrestor - Surge Suppressor	In Stock		N/A	N/A
CAT - MODULE, THYRISTOR BRIDGE	In Stock		N/A	N/A
CAT - MODULE, THYRISTOR BRIDGE	In Stock		N/A	N/A
CAT - MOTOR, CHARGING	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Amplifier/proportional	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - BUSHING NOZZLE 374527007/P001	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CABLE AIRCRAFT 20,	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CABLE AIRCRAFT,	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Casing guide D/S	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Casing guide U/S	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CHAIN,DBS FCS-A1-15	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CONNECTOR, MINIATURE CHAIN	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CONNECTOR, MINIATURE CHAIN	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - CONTROL DEVICE, NEEDLE	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Needle seat	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Seal	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - seal piston ring	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Shuttle Valve	In Stock		N/A	N/A
CAT - NEEDLE VALVE ASS (6) - Tip	In Stock		N/A	N/A
CAT - Oil, Cooling Compressor	In Stock		N/A	N/A
CAT - OIL, TURBINE 46 (205L)	In Stock		N/A	N/A
CAT - OPERATOR, WORM GEAR 8"	In Stock		N/A	N/A
CAT - O-RING, NOZZLE M868 X 4	In Stock		N/A	N/A
CAT - PANEL, CONTROL	In Stock		N/A	N/A
CAT - PISTON/PIN ASSY, IR 30215222	In Stock		N/A	N/A
CAT - PISTON/PIN ASSY, IR 30215438	In Stock		N/A	N/A
CAT - PISTON/PIN ASSY, IR 30292460	In Stock		N/A	N/A
CAT - POTENTIAL TRANSFORMER	In Stock		N/A	N/A
CAT - POWER SUPPLY, 110-220 VOLT	In Stock		N/A	N/A
CAT - POWER TUNNEL (ROCKCUT) - Seal, Adit Door	In Stock		N/A	N/A
CAT - RECTIFIER, BRIDGE 250JB6L-8338	In Stock		N/A	N/A
CAT - RECTIFIER, BRIDGE 35MB60A-8419	In Stock		N/A	N/A
CAT - RECTIFIER, BRIDGE 35MB60A-8421	In Stock		N/A	N/A
CAT - RELAY, ASEA RX5F1, RK271 0	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - RING SET, IR 32194144	In Stock		N/A	N/A
CAT - RING SET, IR 32194276	In Stock		N/A	N/A
CAT - RING SET, IR 37138146	In Stock		N/A	N/A
CAT - RING/GASKET KIT, IR 32133969	In Stock		N/A	N/A
CAT - Rotating Ring	In Stock		N/A	N/A
CAT - Rotating Ring	In Stock		N/A	N/A
CAT - Rotating Ring	In Stock		N/A	N/A
CAT - ROTOR - GENERATOR - Pole	In Stock		N/A	N/A
CAT - Rotor Poles - Entire Pole	In Stock		N/A	N/A
CAT - SEAL, OIL IR 32204562	In Stock		N/A	N/A
CAT - SEAL, SPHERICAL VALVE	In Stock		N/A	N/A
CAT - SEAL, SPHERICAL VALVE	In Stock		N/A	N/A
CAT - SEAL, SPHERICAL VALVE	In Stock		N/A	N/A
CAT - Slipring/brush Rigging Assembly - Brush Holder	In Stock		N/A	N/A
CAT - Slipring/brush Rigging Assembly - Brushes	In Stock		N/A	N/A
CAT - Slipring/brush Rigging Assembly - Insulator	In Stock		N/A	N/A
CAT - Slipring/brush Rigging Assembly - Ring, Collector Assembly	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Arc Chute	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - COIL,CLOSING 129 V DC	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Contact 1600Amp	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Contact Moving Arc	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Contact Stationary Arc	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - CT 400-800	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - CT 800-1600	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Main Drawout Contact	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Trip Coil	In Stock		N/A	N/A
CAT - STATION SERVICE SYSTEM - Undervoltage Coil	In Stock		N/A	N/A
CAT - Stator Assembly - BAR STATOR BOTTOM,	In Stock		N/A	N/A
CAT - Stator Assembly - BAR STATOR TOP,	In Stock		N/A	N/A
CAT - Stator Assembly - CAP STATOR WINDING END,	In Stock		N/A	N/A
CAT - Stator Assembly - Connector	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR ASM 105	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR ASM 107	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR ASM 108	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR ASM 109	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR WINDING	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - Stator Assembly - JUMPER,STATOR WINDING	In Stock		N/A	N/A
CAT - Stator Assembly - JUMPER,STATOR WINDING	In Stock		N/A	N/A
CAT - Stator Assembly - Slider	In Stock		N/A	N/A
CAT - Stator Assembly - Slider	In Stock		N/A	N/A
CAT - Stator Assembly - Slider	In Stock		N/A	N/A
CAT - Stator Assembly - Wedge	In Stock		N/A	N/A
CAT - Stator Assembly - Wedge	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR ASM 105	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR ASM 107	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR ASM 108	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR ASM 109	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR WINDING	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR WINDING	In Stock		N/A	N/A
CAT - Stator Windings - JUMPER,STATOR WINDING	In Stock		N/A	N/A
CAT - SURFACE AIR COOLERS - Surface Air Cooler	In Stock		N/A	N/A
CAT - SWITCH,DIFFERENTIAL PRES	In Stock		N/A	N/A
CAT - TEXT DISPLAY,AIR DRYER	In Stock		N/A	N/A
CAT - THRUST BEARING - thrust pads	In Stock		N/A	N/A
CAT - Thrust Bearing Segements - Segments	In Stock		N/A	N/A
CAT - Thrust Pads	In Stock		N/A	N/A
CAT - THYRISTOR, ABB CS411-20	In Stock		N/A	N/A
CAT - Turbine - Runner	In Stock		N/A	N/A
CAT - Turbine Guide Bearing - Bearing	In Stock		N/A	N/A
CAT - VALVE ASSEMBLY 35 GA	In Stock		N/A	N/A
CAT - VALVE ASSEMBLY 55 GA	In Stock		N/A	N/A
CAT - VALVE/GASKET KIT, IR 32133951	In Stock		N/A	N/A
Cat-minimal pressure Valve	In Stock		N/A	N/A
Cat-Turbine Bearing Cooler	In Stock		N/A	N/A
CAT - POWER SUPPLY, 240 W, SSL COMMUNICATION LINK Part # 1606-XLS240E (Allen-Bradley)	In Stock		N/A	N/A
CAT - POWER SUPPLY, 24V DC, CONTROL LOGIX, SSL COMMUNICATION LINK Part # 1756-PB72 (Rockwell)	In Stock		N/A	N/A
CAT - INTERFACE MODULE, SSL COMMUNICATION LINK Part # 1756-EN2TR (Rockwell)	In Stock		N/A	N/A
CAT - PORT SWITCH, SSL COMMUNICATION LINK Part # 1783-US4T1H (Rockwell)	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
CAT - ETHERNET MODULE, CONTROL LOGIX, SSL COMMUNICATION LINK	In Stock		N/A	N/A
Part# MV156E-DNPNET (Prosoft)	In Stock		N/A	N/A
EBBE - GEAR,HANDWHEEL	In Stock		N/A	N/A
EBBE - GEAR,HELICAL SET	In Stock		N/A	N/A
EBBE - GEAR,WORM 16:1 RATIO	In Stock		N/A	N/A
EBBE - LINK,DECLUTCH	In Stock		N/A	N/A
EBBE - PIN,FORK PIVOT	In Stock		N/A	N/A
GCL - Bar, Stator Bottom	In Stock		N/A	N/A
GCL - Bar, Stator Top	In Stock		N/A	N/A
GCL - Base, Smoke Detector	In Stock		N/A	N/A
GCL - Bearing, Guide GE	In Stock		N/A	N/A
GCL - Bearing, Pivoted Guide	In Stock		N/A	N/A
GCL - Bearing, Pivoted Guide GE	In Stock		N/A	N/A
GCL - Bearing, Thrust	In Stock		N/A	N/A
GCL - Bearing, Thrust	In Stock		N/A	N/A
GCL - Bell, Fire Alarm 10"	In Stock		N/A	N/A
GCL - BELT SET, V (4 PC)	In Stock		N/A	N/A
GCL - BELT SET, V (4 PC)	In Stock		N/A	N/A
GCL - BELT SET, V (4 PC)	In Stock		N/A	N/A
GCL - Breaker, Volt Autom	In Stock		N/A	N/A
GCL - Breaker, Volt Automatic	In Stock		N/A	N/A
GCL - Brush, Carb Metric	In Stock		N/A	N/A
GCL - Bushing, Bottom Shaft	In Stock		N/A	N/A
GCL - Bushing, HV ABB TO25W0412AT	In Stock		N/A	N/A
GCL - Bushing, Packing Gland	In Stock		N/A	N/A
GCL - Card Measuring SDCS-Ph51	In Stock		N/A	N/A
GCL - Card, Analog I/O	In Stock		N/A	N/A
GCL - Card, Digital I/O ABB	In Stock		N/A	N/A
GCL - Card, EXT I/O ABB	In Stock		N/A	N/A
GCL - CMU	In Stock		N/A	N/A
GCL - Contactor, AE LINE 125VDC	In Stock		N/A	N/A
GCL - Control Board, SDCS-CON-2	In Stock		N/A	N/A
GCL - Detector, heat 135F	In Stock		N/A	N/A
GCL - Detector, Heat 281B-PL	In Stock		N/A	N/A
GCL - Detector, Smoke EC30DU-3	In Stock		N/A	N/A
GCL - Device, Surge Suppression	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - ETH Card	In Stock		N/A	N/A
GCL - Excitation Transformer	In Stock		N/A	N/A
GCL - Fan, Cooling 27" ABB	In Stock		N/A	N/A
GCL - FILTER, AIR CARTRIDGE	In Stock		N/A	N/A
GCL - FILTER, AIR CARTRIDGE	In Stock		N/A	N/A
GCL - FILTER, AIR CARTRIDGE	In Stock		N/A	N/A
GCL - FILTER, ELEMENT	In Stock		N/A	N/A
GCL - FILTER, ELEMENT	In Stock		N/A	N/A
GCL - FILTER, ELEMENT	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, INLINE	In Stock		N/A	N/A
GCL - FILTER, MAT	In Stock		N/A	N/A
GCL - FILTER, MAT	In Stock		N/A	N/A
GCL - FILTER, MAT	In Stock		N/A	N/A
GCL - FILTER, OIL KAESER	In Stock		N/A	N/A
GCL - FILTER, OIL KAESER	In Stock		N/A	N/A
GCL - FILTER, OIL KAESER	In Stock		N/A	N/A
GCL - Fuse, 1250A 690V 170M6166	In Stock		N/A	N/A
GCL - Gas, Inergen (350F3)	In Stock		N/A	N/A
GCL - Gas, Inergen (425F3)	In Stock		N/A	N/A
GCL - Generator - Bottom Stator Bars (18)	In Stock		N/A	N/A
GCL - Generator - Converter, RTD Temperature	In Stock		N/A	N/A
GCL - Generator - Converter, RTD Universal	In Stock		N/A	N/A
GCL - Generator - Creep Detector ASSY, 129 V	In Stock		N/A	N/A
GCL - Generator - Device, Surge Suppression	In Stock		N/A	N/A
GCL - Generator - Fuse, TEMP Limiter	In Stock		N/A	N/A
GCL - Generator - Fuse, Voltage XFMR	In Stock		N/A	N/A
GCL - Generator - Guide Bearing, GE	In Stock		N/A	N/A
GCL - Generator - Jumper Pole ASM #2	In Stock		N/A	N/A
GCL - Generator - Jumper Pole ASM #3	In Stock		N/A	N/A
GCL - Generator - Jumper Pole ASM #4	In Stock		N/A	N/A
GCL - Generator - Jumper, Pole ASM #1	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - Generator - Level, Indicator Magnetic	In Stock		N/A	N/A
GCL - Generator - Oil, Turbine 46 (205L)	In Stock		N/A	N/A
GCL - Generator - Packing, V-Type GE	In Stock		N/A	N/A
GCL - Generator - Pin, Taper 25MM x 90MM	In Stock		N/A	N/A
GCL - Generator - Plate, Brake GE	In Stock		N/A	N/A
GCL - Generator - Plate, Locating Pivoted	In Stock		N/A	N/A
GCL - Generator - Pole, Wound GE	In Stock		N/A	N/A
GCL - Generator - Probe, 741 GE	In Stock		N/A	N/A
GCL - Generator - RTD, 12.5" -50-550 DEG	In Stock		N/A	N/A
GCL - Generator - RTD, 17" -50-550 DEG C	In Stock		N/A	N/A
GCL - Generator - Top Stator Bars (36)	In Stock		N/A	N/A
GCL - Governor Control System - POWER SUPPLY,18-32VDC	In Stock		N/A	N/A
GCL - Governor Control System - Pressure Switch	In Stock		N/A	N/A
GCL - Governor Control System - TRANSMITTER,PRESS 0-2000	In Stock		N/A	N/A
GCL - Governor Control System - TRANSMITTER,TEMP 4-20 MA	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Filter, Element NS-7	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Joint, Shaft Parker	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Pump, Vane Vick	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Seal, Polypak "U" Cup	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Valve, Check 1 6000 psi	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Valve, Proportional	In Stock		N/A	N/A
GCL - Governor Hydraulic System - Valve, Relief	In Stock		N/A	N/A
GCL - Holder, Brush Metric	In Stock		N/A	N/A
GCL - Inflatable Seal	In Stock		N/A	N/A
GCL - Jumper, Pole ASM #1	In Stock		N/A	N/A
GCL - Jumper, Pole ASM #2	In Stock		N/A	N/A
GCL - Jumper, Pole ASM #3	In Stock		N/A	N/A
GCL - Jumper, Pole ASM #4	In Stock		N/A	N/A
GCL - Key, Pole Driven	In Stock		N/A	N/A
GCL - Key, Pole Stationary	In Stock		N/A	N/A
GCL - Locating Plate, Pivoted	In Stock		N/A	N/A
GCL - LVDT	In Stock		N/A	N/A
GCL - Measuring Board ABB	In Stock		N/A	N/A
GCL - Media converter	In Stock		N/A	N/A
GCL - MLDT	In Stock		N/A	N/A
GCL - Module, Control Relay	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - Module, Serial processor	In Stock		N/A	N/A
GCL - Nut, Hex M30X3.5-6H	In Stock		N/A	N/A
GCL - Oil, Turbine 46 (205L)	In Stock		N/A	N/A
GCL - Operating Ring - BUSHING,GE 226043126X015	In Stock		N/A	N/A
GCL - Operating Ring - Washer, Ring Seal	In Stock		N/A	N/A
GCL - Panel, Service UNS 0874A-P	In Stock		N/A	N/A
GCL - PIN,TAPER 25MM X 90MM	In Stock		N/A	N/A
GCL - Pole, Wound GE	In Stock		N/A	N/A
GCL - POTENTIAL TRANSFORMER	In Stock		N/A	N/A
GCL - Power Supply	In Stock		N/A	N/A
GCL - Power Supply, SDCS-POWL	In Stock		N/A	N/A
GCL - PowerSupply, UNS0868A-P	In Stock		N/A	N/A
GCL - Probe, 741 GE	In Stock		N/A	N/A
GCL - Pump, Vane Vick	In Stock		N/A	N/A
GCL - Relay, Low Voltage	In Stock		N/A	N/A
GCL - Relay, Overload	In Stock		N/A	N/A
GCL - Relay, Overload 0.32-1.0A	In Stock		N/A	N/A
GCL - Relay, Overload 1.6-5.0A	In Stock		N/A	N/A
GCL - Relay, Overload 3.7-12A	In Stock		N/A	N/A
GCL - RELAY,11 PIN 24V	In Stock		N/A	N/A
GCL - RELAY,110-125V	In Stock		N/A	N/A
GCL - RELAY,110-125V ABB	In Stock		N/A	N/A
GCL - RELAY,110-125VDC	In Stock		N/A	N/A
GCL - RELAY,120V 10A DPDT	In Stock		N/A	N/A
GCL - RELAY,14 PIN 110/120 VAC	In Stock		N/A	N/A
GCL - RELAY,8 PIN 110/120VAC(s)	In Stock		N/A	N/A
GCL - RELAY,8 PIN 120V AC/DC	In Stock		N/A	N/A
GCL - RELAY,8 PIN DPDT	In Stock		N/A	N/A
GCL - RELAY,ANTI-PUMP	In Stock		N/A	N/A
GCL - RELAY,AUX 48VDC	In Stock		N/A	N/A
GCL - RELAY,BREAKER FAIL	In Stock		N/A	N/A
GCL - RELAY,BUSHHOLZ 250V 2AMP	In Stock		N/A	N/A
GCL - RELAY,CONTROL 120V 60HZ	In Stock		N/A	N/A
GCL - RELAY,CONTROL 120V 60HZ	In Stock		N/A	N/A
GCL - RELAY,CONTROL 120V 60HZ	In Stock		N/A	N/A
GCL - RELAY,CONTROL 125VDC	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - RELAY, CONTROL 24VDC	In Stock		N/A	N/A
GCL - RELAY, FAST TRIPPING 125V	In Stock		N/A	N/A
GCL - RELAY, INTERPOSING	In Stock		N/A	N/A
GCL - RELAY, LOCKOUT 125V	In Stock		N/A	N/A
GCL - RELAY, LOCKOUT 125V	In Stock		N/A	N/A
GCL - RELAY, OVERCURRENT	In Stock		N/A	N/A
GCL - RELAY, OVERLOAD	In Stock		N/A	N/A
GCL - RELAY, OVERLOAD CH C306DN3B	In Stock		N/A	N/A
GCL - RELAY, PLUG-IN 14 PIN	In Stock		N/A	N/A
GCL - RELAY, PLUG-IN 14 PIN DC	In Stock		N/A	N/A
GCL - RELAY, PUSHBUTTON 110V	In Stock		N/A	N/A
GCL - RELAY, PUSHBUTTON 125V	In Stock		N/A	N/A
GCL - RELAY, RESIDUAL	In Stock		N/A	N/A
GCL - RELAY, THERMISTOR 110V	In Stock		N/A	N/A
GCL - RELAY, TIME 24-230V AC/DC	In Stock		N/A	N/A
GCL - RELAY, TIME TYPE SGDM-1	In Stock		N/A	N/A
GCL - RELAY, TRIP CIRCUIT	In Stock		N/A	N/A
GCL - RELAY, VOLTAGE UNBALANCE	In Stock		N/A	N/A
GCL - Ring Assembly, Collector	In Stock		N/A	N/A
GCL - Ring Assy, Collector	In Stock		N/A	N/A
GCL - Ring, Rotating GE	In Stock		N/A	N/A
GCL - Ring, Sealing C/W Spring	In Stock		N/A	N/A
GCL - RTD, 12.5" -50-550 Deg	In Stock		N/A	N/A
GCL - RTD, 12.5" -50-550 Deg	In Stock		N/A	N/A
GCL - RTD, 17" -50-550 Deg C	In Stock		N/A	N/A
GCL - RTD, 17" -50-550 Deg C	In Stock		N/A	N/A
GCL - Runner - Seal, 770mm x 730mm x 25mm	In Stock		N/A	N/A
GCL - SCREW, CAP M30X3.5-6GX130MM	In Stock		N/A	N/A
GCL - Seal, Top Guide Bearing	In Stock		N/A	N/A
GCL - Servomotor - Rod, Seal H092-730	In Stock		N/A	N/A
GCL - Servomotor - Rod, Seal H254-918	In Stock		N/A	N/A
GCL - Servomotor Assembly - Ring, Piston GE	In Stock		N/A	N/A
GCL - Shim, GE 007	In Stock		N/A	N/A
GCL - Shim, GE 008	In Stock		N/A	N/A
GCL - Shoe, brake GE 6201B6815L005	In Stock		N/A	N/A
GCL - Sleeve, Shaft	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - SOCKET, RELAY 14 PIN 5A	In Stock		N/A	N/A
GCL - SOCKET, RELAY 8 PIN 7A	In Stock		N/A	N/A
GCL - Speed Signal Generator - Pickup, Zero Velocity	In Stock		N/A	N/A
GCL - Spring Assy, Thrust	In Stock		N/A	N/A
GCL - Spring, GE	In Stock		N/A	N/A
GCL - Spring, GE	In Stock		N/A	N/A
GCL - Stick, Joint Horz	In Stock		N/A	N/A
GCL - Stick, Joint Vert	In Stock		N/A	N/A
GCL - Surface Air Coolers - Cooler, Surface Air	In Stock		N/A	N/A
GCL - Switch, 20-160 ABB 104-324-46	In Stock		N/A	N/A
GCL - Switch, Press 200 PSI 15A	In Stock		N/A	N/A
GCL - Switch, Press Actuated	In Stock		N/A	N/A
GCL - Switch, Press Gran 20W	In Stock		N/A	N/A
GCL - Synchronizer	In Stock		N/A	N/A
GCL - Thermometer, ADJ 0-55	In Stock		N/A	N/A
GCL - THRISTOR, 5STP18F1800 V11	In Stock		N/A	N/A
GCL - Thrust/Guide Bearing Coolers - Coil, Cooling GE	In Stock		N/A	N/A
GCL - Transducer, Balluff Track	In Stock		N/A	N/A
GCL - TRANSMITTER, FRAZIL ICE	In Stock		N/A	N/A
GCL - Transmitter, PFM	In Stock		N/A	N/A
GCL - Transmitter, Temp 4-20 MA	In Stock		N/A	N/A
GCL - TRANSMITTER, WATER LEVEL	In Stock		N/A	N/A
GCL - Turbine Assembly - Packing Ring, Segment	In Stock		N/A	N/A
GCL - Turbine Assembly - Pad, Stop GE	In Stock		N/A	N/A
GCL - Turbine Assembly - Ring, Rotating GE	In Stock		N/A	N/A
GCL - Turbine Assembly - Ring, Sealing C/W Spring	In Stock		N/A	N/A
GCL - Turbine Assembly - Ring, Wear	In Stock		N/A	N/A
GCL - Turbine Assembly - Seal, Inflatable	In Stock		N/A	N/A
GCL - Turbine Assembly - Transmitter, Diff Pressure	In Stock		N/A	N/A
GCL - Turbine Assembly - Transmitter, Pressure 0-90 PSIG	In Stock		N/A	N/A
GCL - Turbine Assembly - Transmitter, Pressure -5TO55	In Stock		N/A	N/A
GCL - Turbine Assembly - Transmitter, Pressure GE	In Stock		N/A	N/A
GCL - Turbine Assembly - Valve, Check Wafer 12"D	In Stock		N/A	N/A
GCL - VALVE, CHECK PRESSURE	In Stock		N/A	N/A
GCL - VALVE, CHECK PRESSURE	In Stock		N/A	N/A
GCL - VALVE, CHECK PRESSURE	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
GCL - Valve, Purge GE	In Stock		N/A	N/A
GCL - VALVE,INLET MAIN KIT	In Stock		N/A	N/A
GCL - VALVE,INLET MAIN KIT	In Stock		N/A	N/A
GCL - VALVE,INLET MAIN KIT	In Stock		N/A	N/A
GCL - VALVE,PURGE GE	In Stock		N/A	N/A
GCL - Washer, Brake Plate	In Stock		N/A	N/A
GCL - Washer, GE 105000100	In Stock		N/A	N/A
GCL - Wicket Gates - Bushing, GE 226043126X015	In Stock		N/A	N/A
GCL - Wicket Gates - Gate, Wicket GE	In Stock		N/A	N/A
GCL - Wicket Gates - Level, Gate GE	In Stock		N/A	N/A
GCL - Wicket Gates - Lever, Shear GE	In Stock		N/A	N/A
GCL - Wicket Gates - Liner, Gate Operating	In Stock		N/A	N/A
GCL - Wicket Gates - Link, GE	In Stock		N/A	N/A
GCL - Wicket Gates - Pin, Eccentric	In Stock		N/A	N/A
GCL - Wicket Gates - Pin, Shear GE	In Stock		N/A	N/A
GCL - Wicket Gates - Pin, Taper GE	In Stock		N/A	N/A
GCL - Wicket Gates - Plate, Retaining GE	In Stock		N/A	N/A
GCL - Wicket Gates - Plate, Top GE	In Stock		N/A	N/A
GCL - Wicket Gates - Shim, Laminum	In Stock		N/A	N/A
GCL - Wicket Gates - Sleeve, BRS 210mm	In Stock		N/A	N/A
GCL - Wicket Gates - Spacer	In Stock		N/A	N/A
GCL - XFMR, CT 15 kV	In Stock		N/A	N/A
HLK - Accumulator tank Solinoid Valve	In Stock		N/A	N/A
HLK - ADAPTER,REMOTE I/O	In Stock		N/A	N/A
HLK - Ampmeter	In Stock		N/A	N/A
HLK - AUTO AIR CHARGING SOLND.	In Stock		N/A	N/A
HLK - BACKPLANE,10 SLOT MODICON	In Stock		N/A	N/A
HLK - BEARING KIT,	In Stock		N/A	N/A
HLK - BOARD,FIRING ES	In Stock		N/A	N/A
HLK - BREAKER,100 AMP 600 VOLT	In Stock		N/A	N/A
HLK - BREAKER,150A 600V	In Stock		N/A	N/A
HLK - BREAKER,225A 600V 3P	In Stock		N/A	N/A
HLK - BREAKER,600 VOLT 3 PHASE	In Stock		N/A	N/A
HLK - BRIDGE,THYRISTOR EG	In Stock		N/A	N/A
HLK - Card battery charger	In Stock		N/A	N/A
HLK - Card battery charger	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
HLK - Card battery charger	In Stock		N/A	N/A
HLK - Card battery charger	In Stock		N/A	N/A
HLK - Card gate pulse	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Anti-pump relay	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Charging motor	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Motor brush kit	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Primary disconnect	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Shunt trip coil	In Stock		N/A	N/A
HLK - CIRCUIT BREAKER - Spring release coil	In Stock		N/A	N/A
HLK - COIL,AUTO AIR CHARGING SOLND.	In Stock		N/A	N/A
HLK - CONTACT,AUX GE	In Stock		N/A	N/A
HLK - CONTACTOR,FURNAS	In Stock		N/A	N/A
HLK - Creep detector	In Stock		N/A	N/A
HLK - EXCITATION - Bridge (entire module)	In Stock		N/A	N/A
HLK - EXCITER FIELD BREAKER - Entire unit	In Stock		N/A	N/A
HLK - GASKET KIT, COMPAIR 45244	In Stock		N/A	N/A
HLK - GASKET KIT, COMPAIR 79452	In Stock		N/A	N/A
HLK - GENERATOR - brake shoes	In Stock		N/A	N/A
HLK - GENERATOR - Generator air valve	In Stock		N/A	N/A
HLK - GENERATOR - SOLENOID,GENERATOR AIR VALVE,	In Stock		N/A	N/A
HLK - GENERATOR CIRCUIT BREAKER	In Stock		N/A	N/A
HLK - GOVERNOR ACCUMULATOR TANK - Air admission solenoid	In Stock		N/A	N/A
HLK - GOVERNOR ACCUMULATOR TANK - Solenoid valve	In Stock		N/A	N/A
HLK - GOVERNOR ACCUMULATOR TANK - SWITCH PRESS OIL ALARM,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - COIL RESET SOLENOID ,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - COIL OIL PUMP UNLOADER SOLND. ,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - COIL PARTIAL SHUTDOWN RESET ,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - COIL SHUTDOWN SOLENOID 65SD ,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - COILDASHPOT,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - filter	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - GATE LIMIT,ROD,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - PUMP UNLOADER,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - UNLOADER PISTON,	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - WOODWARD 1447- 634,motor	In Stock		N/A	N/A
HLK - GOVERNOR HYDRAULIC SYSTEM - WOODWARD 1447-640,MOTOR	In Stock		N/A	N/A
HLK - GOVERNOR SPEED GENERATOR - gear drive	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
HLK - GOVERNOR SPEED GENERATOR - GEAR, WOODWARD 1447-640	In Stock		N/A	N/A
HLK - GOVERNOR SPEED GENERATOR - Speed switch bracket	In Stock		N/A	N/A
HLK - GUIDE BEARING SEGMENTS (SET) - BEARING, SEGMENT	In Stock		N/A	N/A
HLK - HD-1N - HINDS LAKE INTAKE - TRANSMITTER, PRESS 0-375	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - BUSHING 60X75 MM,	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - BUSHING GATE STEM - UPPER,	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - BUSHING GATE STEM - LOWER,	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - Bushing upper	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - SEAL TURBINE,	In Stock		N/A	N/A
HLK - HEADCOVER ASSEMBLY - SEALWICKET GATE,	In Stock		N/A	N/A
HLK - IMPELLER, DEWATERING PUMP	In Stock		N/A	N/A
HLK - IN FRAZIL ICE SYS - INTAKE - TRANSMITTER, TEMPERATURE	In Stock		N/A	N/A
HLK - INSERT, COMPAIR 38275	In Stock		N/A	N/A
HLK - INTAKE HEADGATE AND HOIST EQUIP - Pressure druk	In Stock		N/A	N/A
HLK - ISOLATED PHASE BUS - PT fuse	In Stock		N/A	N/A
HLK - MECHANICAL GOVERNOR CONTROLS - Motor limit	In Stock		N/A	N/A
HLK - MECHANICAL GOVERNOR CONTROLS - Motor speeder	In Stock		N/A	N/A
HLK - MECHANICAL GOVERNOR CONTROLS - Unloader timing valve	In Stock		N/A	N/A
HLK - METER, FLOW BARTON	In Stock		N/A	N/A
HLK - MODULE, ANALOG QUANTUM	In Stock		N/A	N/A
HLK - MODULE, CPU MODICON	In Stock		N/A	N/A
HLK - MODULE, DISCRETE IN	In Stock		N/A	N/A
HLK - MODULE, DISCRETE OUT	In Stock		N/A	N/A
HLK - MODULE, ETHERNET QUANTUM	In Stock		N/A	N/A
HLK - MODULE, GPS QUANTUM	In Stock		N/A	N/A
HLK - MODULE, HOT STANDBY	In Stock		N/A	N/A
HLK - MODULE, INTERFACE PLC	In Stock		N/A	N/A
HLK - MODULE, RACK FILLER	In Stock		N/A	N/A
HLK - MODULE, RELAY OUT	In Stock		N/A	N/A
HLK - OPERATING RING - Bearing pads	In Stock		N/A	N/A
HLK - PANEL, CONTROL SCP/CCP	In Stock		N/A	N/A
HLK - PANEL, VOLTAGE ADJUSTER	In Stock		N/A	N/A
HLK - PLATE, TERMINAL 3 POLE	In Stock		N/A	N/A
HLK - PLATE, TERMINAL 6 POLE	In Stock		N/A	N/A
HLK - PMG Speed Switch Bracket	In Stock		N/A	N/A
HLK - POWER DISTRIBUTOR, ASSY	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
HLK - POWER SUPPLY, 125-24 VDC	In Stock		N/A	N/A
HLK - POWER SUPPLY, 125 VDC	In Stock		N/A	N/A
HLK - POWER SUPPLY, 125VDC 8A	In Stock		N/A	N/A
HLK - POWER SUPPLY, 24 VDC	In Stock		N/A	N/A
HLK - POWER SUPPLY, CP-C-24/10.	In Stock		N/A	N/A
HLK - RECTIFYING TRANSFORMER	In Stock		N/A	N/A
HLK - RELAY, CONTROL 120V 60HZ	In Stock		N/A	N/A
HLK - RELAY, CONTROL 48V	In Stock		N/A	N/A
HLK - RELAY, CONTROL AB 500F-A0D92	In Stock		N/A	N/A
HLK - REMOTE I/O HEAD, MODICON	In Stock		N/A	N/A
HLK - RING SET ASSY, COMPAIR 48	In Stock		N/A	N/A
HLK - RING SET, COMPAIR 45237	In Stock		N/A	N/A
HLK - RING SET, WORTH P04643-10	In Stock		N/A	N/A
HLK - RING/GASKET KIT, IR 32133944	In Stock		N/A	N/A
HLK - Rotor - Pole	In Stock		N/A	N/A
HLK - Rotor Assembly - HLK Generator - Rotor pole	In Stock		N/A	N/A
HLK - SEAL, COMPAIR 13254	In Stock		N/A	N/A
HLK - SEAT/SEAL KIT, VALVE 1-1/	In Stock		N/A	N/A
HLK - SERVOMOTOR #1 - servomotor repair kit	In Stock		N/A	N/A
HLK - SERVOMOTOR ASSEMBLY - shear pins	In Stock		N/A	N/A
HLK - Slip ring	In Stock		N/A	N/A
HLK - Slipring /Brush Rigging - Brush holder	In Stock		N/A	N/A
HLK - Slipring /Brush Rigging - Carbon brush	In Stock		N/A	N/A
HLK - SOLENOID, GENERATOR AIR VALVE	In Stock		N/A	N/A
HLK - STATION SERVICE SWITCHGEAR - Breaker (EATON)	In Stock		N/A	N/A
HLK - STATOR ASSEMBLY - Stator bars	In Stock		N/A	N/A
HLK - STATOR ASSEMBLY - Stator connection caps	In Stock		N/A	N/A
HLK - STATOR WINDINGS - UNIT 1 - robel bars	In Stock		N/A	N/A
HLK - STN SERVICE TRANSFORMER (SST-1)	In Stock		N/A	N/A
HLK - SURFACE AIR COOLERS	In Stock		N/A	N/A
HLK - SWITCH, LIMIT AB 802T-ATP	In Stock		N/A	N/A
HLK - SWITCH, LIMIT AB 802T-DTP	In Stock		N/A	N/A
HLK - SWITCH, MERCROID TYPE C-4	In Stock		N/A	N/A
HLK - SWITCH, PRESS OIL ALARM	In Stock		N/A	N/A
HLK - THRUST BEARING SEGMENTS (SET) - Thrust Bearing Segments	In Stock		N/A	N/A
HLK - THRUST PIN ASSY, IR 32218406	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
HLK - Thrust/Guide Bearing Coolers	In Stock		N/A	N/A
HLK - Thrust/Guide Bearing Coolers - Hi pressure lift pump	In Stock		N/A	N/A
HLK - TURBINE - BEARING SEGMENT TURBINE,	In Stock		N/A	N/A
HLK - TURBINE - Carbon seal,	In Stock		N/A	N/A
HLK - TURBINE - Dowel	In Stock		N/A	N/A
HLK - TURBINE - Eccentric pin	In Stock		N/A	N/A
HLK - TURBINE - Friction hub	In Stock		N/A	N/A
HLK - TURBINE - Friction hub	In Stock		N/A	N/A
HLK - TURBINE - Link pin	In Stock		N/A	N/A
HLK - TURBINE - link thick	In Stock		N/A	N/A
HLK - TURBINE - link thin	In Stock		N/A	N/A
HLK - TURBINE - Packing box	In Stock		N/A	N/A
HLK - TURBINE - PLATE BEARING,	In Stock		N/A	N/A
HLK - TURBINE - SEAL TURBINE,	In Stock		N/A	N/A
HLK - TURBINE - Wicket gate lever	In Stock		N/A	N/A
HLK - TURBINE - wicket gate seal	In Stock		N/A	N/A
HLK - TURBINE GUIDE BEARING - BEARING, Segment TURBINE	In Stock		N/A	N/A
HLK - UPPER GUIDE BEARING COOLER	In Stock		N/A	N/A
HLK - UPPER GUIDE BEARING SEGMENTS - Upper Guide Bearing Segments	In Stock		N/A	N/A
HLK - VALVE & SPRING SET,45245	In Stock		N/A	N/A
HLK - VALVE ASSEMBLY 55 GA	In Stock		N/A	N/A
HLK - VALVE ASSY, COMPAIR 47935	In Stock		N/A	N/A
HLK - VALVE ASSY, COMPAIR 47936	In Stock		N/A	N/A
HLK - VALVE ASSY, COMPAIR 48141	In Stock		N/A	N/A
HLK - VALVE ASSY, COMPAIR 50681	In Stock		N/A	N/A
HLK - VALVE,SOL 4-WAY SKINNER	In Stock		N/A	N/A
HLK - VALVE/GASKET KIT,IR 32133936	In Stock		N/A	N/A
HLK - VOLTAGE ADJUSTER	In Stock		N/A	N/A
HLK - WICKET GATES - wicket gate	In Stock		N/A	N/A
HLK - XFMR, PT 600 VOLT 3 PHASE	In Stock		N/A	N/A
HLK- Turbine Bearing Cooler	In Stock		N/A	N/A
PRV - Bearing, Lower Guide	In Stock		N/A	N/A
PRV - Bearing, Upper Guide	In Stock		N/A	N/A
PRV - Bearing, Upper Thrust	In Stock		N/A	N/A
PRV - BLOCK POWERTRAC,115VAC/1	In Stock		N/A	N/A
PRV - Circuit Breaker	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
PRV - COIL,GE 22-115-045-01	In Stock		N/A	N/A
PRV - CONTACTOR,FIELD FLASHING	In Stock		N/A	N/A
PRV - DIODE,GE 4001A1158JA	In Stock		N/A	N/A
PRV - DIODE,GE 4001A1158JB	In Stock		N/A	N/A
PRV - DIODE,GE 6RT44UV698-8841	In Stock		N/A	N/A
PRV - MAGNETROL,D-B10-1GBA-ABM	In Stock		N/A	N/A
PRV - METER,FLOW OMEGA FL-6318B	In Stock		N/A	N/A
PRV - METER,FLOW WATER 1000#	In Stock		N/A	N/A
PRV - MOTOR,GOVERNOR PUMP	In Stock		N/A	N/A
PRV - Pad, Guide Bearing	In Stock		N/A	N/A
PRV - PLC CPU Module	In Stock		N/A	N/A
PRV - PLC Ethernet Module	In Stock		N/A	N/A
PRV - PLC Power Supply	In Stock		N/A	N/A
PRV - PUMP,PH PVP1630-R212	In Stock		N/A	N/A
PRV - TACHOMETER,TAK PAK 3	In Stock		N/A	N/A
PRV - TURBINE BEARING COOLER TURBINE	In Stock		N/A	N/A
USL - BEARING, BOWL - Drainage	In Stock		N/A	N/A
USL - BEARING, BOWL - Unwatering	In Stock		N/A	N/A
USL - BEARING,BIG END COMP #E02128	In Stock		N/A	N/A
USL - BEARING,BIG END COMP #E02128	In Stock		N/A	N/A
USL - BEARING,COMPAIR E05519	In Stock		N/A	N/A
USL - BEARING,COMPAIR E05519	In Stock		N/A	N/A
USL - BEARING,MAIN D/E	In Stock		N/A	N/A
USL - BEARING,MAIN D/E	In Stock		N/A	N/A
USL - BEARING,MAIN O/E	In Stock		N/A	N/A
USL - BEARING,MAIN O/E	In Stock		N/A	N/A
USL - BEARING,PACKING CONTAINER	In Stock		N/A	N/A
USL - BELT,DRIVE COMPAIR 3VX850	In Stock		N/A	N/A
USL - BELT,DRIVE COMPAIR 3VX850	In Stock		N/A	N/A
USL - BELT,V 3V950	In Stock		N/A	N/A
USL - BELT,V 3V950	In Stock		N/A	N/A
USL - BRIDGE,THYRISTOR EG	In Stock		N/A	N/A
USL - BUSHING,IMPELLER TAPERLOCK	In Stock		N/A	N/A
USL - BUSHING,IMPELLER TAPERLOCK	In Stock		N/A	N/A
USL - BUSHING,SIDE ROLLER	In Stock		N/A	N/A
USL - BUSHING,SMALL END COM#LE02130	In Stock		N/A	N/A

Critical Spares Stock Status
Hydraulic Generation
25-Sept-25



Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
USL - BUSHING, SMALL END COM#LE02130	In Stock		N/A	N/A
USL - BUSHING, WHEEL	In Stock		N/A	N/A
USL - COIL, SULL 250018-971	In Stock		N/A	N/A
USL - CROWBAR, ES	In Stock		N/A	N/A
USL - FILTER, COOLANT (ELEMENT ONLY)	In Stock		N/A	N/A
USL - GASKET KIT, IR X1453T47	In Stock		N/A	N/A
USL - GASKET, COMP AIR E05516	In Stock		N/A	N/A
USL - GASKET, COMP AIR E05516	In Stock		N/A	N/A
USL - GASKET, COMP AIR J201671	In Stock		N/A	N/A
USL - GASKET, COMP AIR J201671	In Stock		N/A	N/A
USL - GASKET, FLEXMASTER 250007-559	In Stock		N/A	N/A
USL - GASKET, SULL 040517	In Stock		N/A	N/A
USL - GOVERNOR PUMP	In Stock		N/A	N/A
USL - GOVERNOR PUMP	In Stock		N/A	N/A
USL - HEATER, GAIN 3.2 KW 575 V	In Stock		N/A	N/A
USL - HEATER, GATE (DUCT BLOWE	In Stock		N/A	N/A
USL - HEATER, SHEAVE BLOCK 1366 W	In Stock		N/A	N/A
USL - JOINT KIT, COMP AIR 98504/1172	In Stock		N/A	N/A
USL - JOINT KIT, COMP AIR 98504/1172	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202284	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202284	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202285	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202285	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202285-100	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202285-100	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202286	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202286	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202287	In Stock		N/A	N/A
USL - JOINT, COMP AIR C202287	In Stock		N/A	N/A
USL - POWER DISTRIBUTOR, ASSY	In Stock		N/A	N/A
USL - REGULATOR KIT, SULL 250019-453	In Stock		N/A	N/A
USL - RING KIT, COMP AIR 98477/1131	In Stock		N/A	N/A
USL - RING KIT, COMP AIR 98477/1131	In Stock		N/A	N/A
USL - RING, PISTON 1ST STAGE	In Stock		N/A	N/A
USL - RING, PISTON 1ST STAGE	In Stock		N/A	N/A
USL - ROTOR RIM DRIVE KEYS	In Stock		N/A	N/A

Critical Spare Component	Stock Status	Comments	Status Update September 2025	Expected Delivery Date
USL - SEAL, FLAT 22' LENGTH	In Stock		N/A	N/A
USL - SEAL, J 22' LENGTH	In Stock		N/A	N/A
USL - SEAL, J C/W 2 CORNERS	In Stock		N/A	N/A
USL - SEAL, J C/W 4 CORNERS	In Stock		N/A	N/A
USL - SWITCH, OIL LEVEL	In Stock		N/A	N/A
USL - SWITCH, OIL LEVEL	In Stock		N/A	N/A
USL - TRANSMITTER, PRESS 0-2.5MH20	In Stock		N/A	N/A
USL - VALVE, REED 1ST STAGE	In Stock		N/A	N/A
USL - VALVE, REED 1ST STAGE	In Stock		N/A	N/A
USL - VALVE, REED 2ND STAGE	In Stock		N/A	N/A
USL - VALVE, REED 2ND STAGE	In Stock		N/A	N/A
USL - VARISTOR, EXCITER	In Stock		N/A	N/A
USL - Transformer T2	Procurement Ongoing	Unit was shipped to Turkey in 2022 to be repaired and tested. The anticipated return date to USL was Q2 2023 however the transformer remained at the factory in Turkey due to unsuccessful Factory Acceptance Testing (FAT). The transformer was shipped to site in Q4 2025 but failed testing. Additional testing and troubleshooting was completed in May 2025 with progress made on identifying issues. Plans were developed and materials ordered to make repairs with lead times on materials estimated 6-10 weeks. Repairs and testing planned for completion in Q4.	N/A	Oct-25

Appendix G

Status of Winter Readiness Testing of Plant and Equipment for Hydraulic Generation





Bay d'Espoir Hydraulic Generating Facility
22-Sept-25

Status of Test							
Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6	Unit 7	Balance of Plant Powerhouse 1
							Balance of Plant Powerhouse 2

Following Annual Outages, Unit is Run Up, Synchronized and all Systems Verified Before Operating Status Determined, as per Energy Control Centre, Prior to Coming Winter Operating Season to Ensure Preparedness. A Unit Load Test is Performed at this Time.	30-Nov	✓	✓	14-Nov	14-Nov	31-Oct	N/A
All Alternate Sources of Station Service Tested and Available	N/A	N/A	N/A	N/A	N/A	N/A	✓

Spherical Valves							
Turbine Main Stop Valve Annual PM Complete	30-Nov	✓	✓	14-Nov	14-Nov	N/A	N/A
Turbine Main Stop Valve Operational	30-Nov	✓	✓	14-Nov	14-Nov	N/A	N/A

Service Air and Instrument Air Systems Compressors							
All Stationary Air Compressors Available	N/A	N/A	N/A	N/A	N/A	N/A	✓
Air Compressor Operational Checks Performed (e.g., Oil Levels, Cooling Water, etc.)	N/A	N/A	N/A	N/A	N/A	N/A	✓
Air Compressor Sequencing Capability Available	N/A	N/A	N/A	N/A	N/A	N/A	✓
High Pressure Compressors Available	N/A	N/A	N/A	N/A	N/A	N/A	✓
Low Pressure Compressor Available	N/A	N/A	N/A	N/A	N/A	N/A	✓
Instrumentation Control and Alarms Operational	N/A	N/A	N/A	N/A	N/A	N/A	✓

Turbine/Generator ("TG") Cooling Water Systems							
Cooling Water Pumps Available	✓	✓	✓	✓	✓	N/A	N/A
Emergency Cooling Water Available Penstock Supply	✓	✓	✓	✓	✓	N/A	N/A
Cooling Water System Available	✓	✓	✓	✓	✓	✓	N/A
Shaft Seal System Available	✓	✓	✓	✓	✓	✓	N/A
Cooling Water Strainers Inspected and Available	✓	✓	✓	✓	✓	✓	N/A

TG Governor System							
Hydraulic System Accumulators Operational	✓	✓	✓	✓	✓	✓	N/A
Governor System Annual PM Complete	30-Nov	✓	✓	14-Nov	14-Nov	31-Oct	N/A
Governor System Available	✓	✓	✓	✓	✓	✓	N/A
Hydraulic Pump(s) Available	✓	✓	✓	✓	✓	✓	N/A

Generator							
Generator Exciter Operation Checked Offline and Online	30-Nov	✓	✓	14-Nov	14-Nov	31-Oct	N/A
Generator Exciter Available	✓	✓	✓	✓	✓	✓	N/A
Brush Condition Verified	30-Nov	30-Nov	30-Nov	14-Nov	14-Nov	31-Oct	N/A

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
✓ - Test completed
N/A - Not Applicable

**Bay d'Espoir Hydraulic Generating Facility
22-Sept-25**

Status of Test									
Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6	Unit 7	Balance of Plant Powerhouse 1	Balance of Plant Powerhouse 2	
Lubricating System									
Portable Oil Pump (Jacking)	✓	✓	✓	✓	✓	N/A	N/A	N/A	N/A
Oil Level System Generator Metering Available	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Oil Level System Turbine Metering Available	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Alternating Current High Pressure Jacking Oil Pump Available Automatic	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A
Switchyard/Terminal Station									
Breakers and Disconnects Operational	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Operate Breaker PM Complete (TRO)	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Intake									
Water Elevation	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Trashrack System	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Gate Operation	✓	✓	✓	✓	✓	✓	N/A	N/A	N/A
Surge Tank									
Heating System	30-Nov	30-Nov	30-Nov	30-Nov	30-Nov	N/A	N/A	N/A	N/A
Alarm Systems	30-Nov	30-Nov	30-Nov	30-Nov	30-Nov	N/A	N/A	N/A	N/A
Spillway									
Water Elevation	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Gate Heating/Ice Away Unit	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Gate Operation	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Emergency (Backup) Diesel Generator	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Emergency Lift Operation and Tested	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Battery Banks And Battery Chargers									
Plant 129 V System									
129 V Battery Banks Checked	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
129 V Battery Chargers	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
129 V Battery Banks Available	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	✓
Plant Uninterrupted Power Supplies ("UPS")									
UPS Power Supplies (Inverter NWS)	N/A	N/A	N/A	N/A	N/A	N/A	✓	✓	N/A

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
 ✓ - Test completed
 N/A - Not Applicable

Bay d'Espoir Hydraulic Generating Facility
22-Sept-25

Status of Test									
Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6	Unit 7	Balance of Plant Powerhouse 1	Balance of Plant Powerhouse 2	
Emergency Diesel Generators									
Emergency Diesel Generators Tested for Emergency Stop	N/A	N/A	N/A	N/A	N/A	N/A	✓		N/A
Emergency Diesel Generators Tested for Manual and Auto-Start Operation along with Auto Breaker Closure as well as Emergency Manual Closing of Breakers	N/A	N/A	N/A	N/A	N/A	N/A	✓		✓
Alternate Alternating Current Sources Available	N/A	N/A	N/A	N/A	N/A	N/A	✓		✓
Station Services Available	N/A	N/A	N/A	N/A	N/A	N/A	✓		✓
Transfer Alternate Source	N/A	N/A	N/A	N/A	N/A	N/A	✓		✓
Plant Air Conditioning System									
Control Rooms	N/A	N/A	N/A	N/A	N/A	N/A	✓		N/A
Communications Rooms	N/A	N/A	N/A	N/A	N/A	N/A	✓		N/A
Plant Heating Steam									
All Systems Operational for when Required	N/A	N/A	N/A	N/A	N/A	N/A	✓		✓

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
 ✓ - Test completed
 N/A - Not Applicable



Hydraulic Generating Stations (Remote Units)
22-Sept-25

		Status of Test									
		Cat Arm		Hinds Lake		Upper Salmon		Granite Canal		Paradise River	
		Unit 1	Unit 2	Balance of Plant Powerhouse	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1
Following Annual Outages, Unit is Run Up, Synchronized and all Systems Verified Before Operating Status Determined, as per Energy Control Centre, Prior to Coming Winter Operating Season to Ensure Preparedness. A Unit Load Test is Performed at this Time.	✓		✓	N/A	21-Nov	N/A	✓	N/A	30-Nov	N/A	✓
	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A
	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
Spherical Valves											
Turbine Main Stop Valve Annual PM Complete	✓		✓	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Turbine Main Stop Valve Operational	✓		✓	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Service Air and Instrument Air Systems Compressors											
All Stationary Air Compressors Available	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
Air Compressor Operational Checks Performed (e.g., Oil Levels, Cooling Water, etc.)	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
Air Compressor Sequencing Capability Available	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
High Pressure Compressors Available	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
Low Pressure Compressor Available	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Instrumentation Control and Alarms Operational	N/A		N/A	✓	N/A	✓	N/A	✓	N/A	✓	✓
Turbine/Generator ("TG") Cooling Water Systems											
Cooling Water Pumps Available	✓		✓	N/A	✓	N/A	N/A	N/A	N/A	N/A	N/A
Emergency Cooling Water Available Penstock Supply	✓		✓	N/A	N/A	N/A	✓	✓	N/A	✓	✓
Cooling Water System Available	✓		✓	N/A	✓	N/A	✓	✓	N/A	✓	N/A
TG Pumps Available and Tested for Auto/Manual Start	N/A		N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A	N/A
Shaft Seal System Available	N/A		N/A	N/A	✓	N/A	✓	N/A	✓	N/A	N/A
Rotary Strainer Inspected and Available	✓		✓	N/A	✓	N/A	✓	✓	N/A	✓	N/A
TG Governor System											
Hydraulic System Accumulators Operational	✓		✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Governor System Annual PM Complete	✓		✓	N/A	21-Nov	N/A	✓	N/A	✓	N/A	N/A
Governor System Available	✓		✓	N/A	✓	N/A	✓	N/A	✓	N/A	N/A
Hydraulic Pump(s) Available	✓		✓	N/A	✓	N/A	✓	N/A	✓	N/A	N/A

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
✓ - Test completed
N/A - Not Applicable

Hydraulic Generating Stations (Remote Units) 22-Sept-25

Status of Test										
Cat Arm			Hinds Lake		Upper Salmon		Granite Canal		Paradise River	
Unit 1	Unit 2	Balance of Plant Powerhouse	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1	Balance of Plant
Generator										
Generator Exciter Operation Checked Offline and Online	✓	✓	21-Nov	N/A	✓	N/A	✓	N/A	✓	N/A
Generator Exciter Available	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Brush Condition Verified	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Lubricating System										
Oil Level System Generator Metering Available	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Oil Level System Turbine Metering Available	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Alternating Current High Pressure Jacking Oil Pump Available Automatic	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Miscellaneous										
Breakers and Disconnects Operational	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Operate Breaker PM Complete (TRO)	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Control Structure										
Water Elevation	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A	N/A
Gate Operation	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A	N/A
Intake										
Water Elevation	N/A	N/A	✓	✓	N/A	✓	N/A	✓	N/A	✓
Trashrack System	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Gate Operation	✓	✓	✓	N/A	✓	N/A	✓	N/A	✓	N/A
Spillway/Bypass										
Water Elevation	N/A	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Gate Heating/Ice Away Unit	N/A	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Gate Operation	N/A	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Emergency (Backup) Diesel Generator	N/A	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Emergency Lift Operation and Tested	N/A	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
 ✓ - Test completed
 N/A - Not Applicable

Hydraulic Generating Stations (Remote Units) 22-Sept-25

Status of Test											
Cat Arm				Hinds Lake		Upper Salmon		Granite Canal		Paradise River	
Unit 1	Unit 2	Balance of Plant Powerhouse	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1	Balance of Plant	Unit 1
Battery Banks And Battery Chargers											
Plant 129 V System											
	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
129 V Battery Banks Checked	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
129 V Battery Chargers	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
129 V Battery Banks Available	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Plant 48 V System (Network Services)											
	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
48 V Battery Banks Checked	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Emergency Diesel Generators											
Emergency Diesel Generators Tested for Emergency Stop	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Emergency Diesel Generators Tested for Manual and Auto-Start Operation along with Auto Breaker Closure as well as Emergency Manual Closing of Breakers	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Alternate Alternating Current Sources Available	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Station Services Available	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Transfer Alternate Source	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Plant Air Conditioning System											
Control Rooms	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓
Communications Rooms	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	N/A
Plant Heating Steam											
All Systems Operational for when Required	N/A	N/A	✓	N/A	✓	N/A	✓	N/A	✓	N/A	✓

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
✓ - Test completed
N/A - Not Applicable

Appendix H

Critical Spares Status Listing for Muskrat Falls Generation





Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
JOINT HEAD, SAL40-TXE-2LS, LHT	In Stock
COIL SPRING, ST14100	Procurement Ongoing
SPRING, COIL ST14110	Procurement Ongoing
SHOE, SIDE GUIDE 60X16... 140	Procurement Ongoing
SHOE, SIDE GUIDE 60X16... 280	Procurement Ongoing
SHOE, SIDE GUIDE 140X49.150460	Procurement Ongoing
NUT, CLAMPING SR-50112S	In Stock
SCREW, LOCKING 145-400X30	Procurement Ongoing
PROFILE, EDGE PROTECTION	Procurement Ongoing
PROFILE, EDGE PROTECTION 3D	Procurement Ongoing
ASSEMBLY, SWING BOLT	In Stock
COMP , WASHER	In Stock
CSCR,HEX HD	In Stock
PIN, DRIVE	In Stock
DOWEL PIN,LINKS LEVERS ASSY	In Stock
PLATE,ORIFICE 3MM SERVOMOTOR	In Stock
PLATE,LEAF SPRING,POS 4	In Stock
PLATE,LEAF SPRING,POS 5	In Stock
KIT, SEAL HPGH CERAMIC	In Stock
BUMPER,HYDRAULIC	Procurement Ongoing
BEARING,SPHERICAL ROLLER Ø160	Procurement Ongoing
BEARING,SPHERICAL ROLLER Ø260	Procurement Ongoing
SEAL,RADIAL SHAFT 480X520X20	Procurement Ongoing
SEAL,RADIAL SHAFT 300X340X18	Procurement Ongoing
SEAL,RADIAL SHAFT 290X330X18	Procurement Ongoing
SEAL,RADIAL SHAFT 160X190X15	Procurement Ongoing
BEARING,CYLINDRICAL ROLLER	Procurement Ongoing
BEARING,THRUST ROLLER Ø240	Procurement Ongoing
REDUCER,RATIO: 312	Procurement Ongoing
LOAD CELL,25000LB	Procurement Ongoing
BEARING,CYLINDRICAL ROLLER Ø80	Procurement Ongoing
BEARING,SPHERICAL ROLLER Ø110	Procurement Ongoing
MOTOR 60HP,1750RPM,NEMA 365T	In Stock
BEARING,SPHERICAL ROLLER Ø140	In Stock
BEARING,SEALED SPHERICAL	In Stock
LOAD CELL,6806KG W/CONNECTOR	In Stock
BEARING,THRUST BALL Ø90	In Stock
BEARING,SINGLE ROW DEEP GROOVE	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
MOTOR,DRE100L4 M1B-TBO-CEK	Procurement Ongoing
MOTOR,DRE100L4 M1A-TB180-CEX	Procurement Ongoing
BEARING,SEALED SPHERICAL	Procurement Ongoing
BUFFER,CELLULAR BUFFER 160Ø	Procurement Ongoing
COUPLING,ROTARY SWITCH	Procurement Ongoing
BUMPER,HYDRAULIC TYPE 21-150	Procurement Ongoing
BEARING,AXIAL CYLINDRICAL	Procurement Ongoing
DRIVE,VARIABLE FREQUENCY 60HP	Procurement Ongoing
DRIVE,VARIABLE FREQUENCY 15HP	In Stock
DRIVE,VARIABLE FREQUENCY 100HP	In Stock
DRIVE,VARIABLE FREQUENCY 7.5HP	In Stock
POWER SUPPLY,24V-5A,REGULATED	In Stock
POWER SUPPLY,15VDC,SINGLE	Procurement Ongoing
ETHERNET, STANDARD NETWORK	In Stock
KIT,STAND. DISTRIBUTION STB	In Stock
KIT,BASIC DIGITAL INPUT STB	In Stock
KIT,STAND. ANALOG INPUT STB	In Stock
SHOES,COLLECTOR	Procurement Ongoing
BEARING,HOIST DRIVEN SPHERICAL	In Stock
BEARING, HOIST FREE SPERHICAL	In Stock
BEARING, HOIST SHEAVE	In Stock
SHEAVE,Ø630 FOR LIFTING BEAM	In Stock
BEARING,RADIAL,SPHERICAL	Procurement Ongoing
BEARING,ROLLER,110MM ID	Procurement Ongoing
BEARING,ROLLER,20MM ID	Procurement Ongoing
BEARING,SPHERICAL ROLLER,50MM	Procurement Ongoing
BEARING, CONICAL ROLLER	In Stock
CASTER, HEAVY DUTY SWIVEL	In Stock
FLANGE,FASTENING	In Stock
CLAMPING BAND,SWIVEL BOLTS	In Stock
HOSE, SILICON RUBBER	In Stock
LOCKING PLATE,LINK LEVER ASSY	In Stock
BELT,FAN A42,WRAPPED	In Stock
BUSHING,SERVOMOTOR PIN	In Stock
BUSHING,SERVOMOTOR	In Stock
SPRING,COMPRESSION SHAFT SEAL	In Stock
SPRING,GARTER SHAFT SEAL	In Stock
SEAL,V-RING GUIDE BEARING ASSY	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
CLAMP,V-RING SEAL	In Stock
SEAL RING,OIL HEAD PIPES	In Stock
COUPLING,MAIN HOIST DRUM	Procurement Ongoing
COUPLING,AUXILIARY HOIST DRUM	Procurement Ongoing
DISC, BRAKE K 145-400X30	Procurement Ongoing
SHOE, BRAKE ASSEMBLY	In Stock
SOLENOID, BRAKE, 13 MBE 300M	In Stock
COUPLING, BRAKE FLEX WHEEL	In Stock
SHEAVE,914.4MM PITCH DIA.	In Stock
SHEAVE,1004.4MM PITCH DIA.	In Stock
ASSY,SHEAR PIN MFAGS TURBINE	In Stock
MOTOR, AXIAL PISTON	Procurement Ongoing
MOTOR, AXIAL PISTON	Procurement Ongoing
MOTOR, AXIAL PISTON	Procurement Ongoing
CYLINDER, HYDRAULIC	Procurement Ongoing
CYLINDER, HYDRAULIC	Procurement Ongoing
BUSHING, 85mm/70mm... 80mm	In Stock
BUSHING, 170mm/150mm... 50mm	In Stock
BUSHING, 185mm/165mm... 75mm	In Stock
BUSHING, 185mm/165mm... 50mm	In Stock
BUSHING, SHAFT	In Stock
BUSHING, NEEDLE NK 35/20	In Stock
BEARING,ANTI FRICTION	In Stock
BEARING, BALL - LMF NR. 6205	Procurement Ongoing
BEARING, ROLLER - LMF NU 311B	Procurement Ongoing
BEARING, CON. ROD LMF	Procurement Ongoing
BEARING, ROLLER - LMF NR20 314	Procurement Ongoing
BEARING, OUTBOARD SHAFT	Procurement Ongoing
BEARING, INBOARD SHAFT	Procurement Ongoing
BEARING, FAN P2B 1-7/16 RB-E	In Stock
BEARING, FAN P2B 1-15/16 RB-E	In Stock
BEARING, FAN P2B 1-11/16 RB-E	In Stock
BEARING, FAN P2B 2-3/16 RB-E	In Stock
BEARING, LOWER GUIDE	In Stock
SHOE,THRUST BEARING	In Stock
BEARING,RADIAL	In Stock
TUBE, 12 X 2..... 6000	Procurement Ongoing
ADAPTER, FLANGE	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
COUPLING,4",RIGID,GROOVED	In Stock
COUPLING,6",RIGID,GROOVED	In Stock
FITTING, ELBOW SR-50612S	In Stock
FITTING, STRAIGHT SR-50512S	In Stock
FITTING, ELBOW SR-56412S	In Stock
FITTING, STRAIGHT SR-51012S38	In Stock
FITTING, PLUG SR-59912S	In Stock
FITTING, BULKHEAD SR-52612S	In Stock
PLUG, CLOSING SR-58912LS	In Stock
FITTING, MAVE 12S R1/4"	In Stock
ELBOW,PIPE 1" NPT MX1" BSP F90	In Stock
STRAINER, Y 3/4" Y600 SERIES	Procurement Ongoing
STRAINER, Y 1" Y600 SERIES	Procurement Ongoing
DRAIN TRAP	In Stock
VALVE,CHECK 14 INCH BRAY	Procurement Ongoing
VALVE,CHECK 20 INCH BRAY	Procurement Ongoing
VALVE,CHECK 10 INCH 105MDT	Procurement Ongoing
VALVE,CHECK 12 INCH 105MDT	Procurement Ongoing
VALVE, CHECK 1" SERIES CH	In Stock
VALVE,FLOW CONTROL,6"	In Stock
VALVE,PRESSURE RELIEF	Procurement Ongoing
VALVE, IN-LINE FLOW CONTROL	Procurement Ongoing
VALVE,PRESSURE RELIEF,2800PSI	Procurement Ongoing
VALVE,SFTY RLF F85-F 1.5X2	Procurement Ongoing
VALVE,SFTY RLF F85-6 0.5X1	Procurement Ongoing
VALVE,FIRE PUMP CASING RELIEF	Procurement Ongoing
VALVE,PRESS RELIEF 3L SERIES	Procurement Ongoing
VALVE,PRESS RELIEF LF530C	Procurement Ongoing
VALVE, SOLENOID	In Stock
VALVE,SOLENOID,3/4",24VDC N.C.	In Stock
VALVE,DIRECTIONAL CONTROL	Procurement Ongoing
VALVE, SOLENOID 7/16 IN	Procurement Ongoing
VALVE,DIRECTIONAL	In Stock
SOLENOID VALVE	Procurement Ongoing
BALL VALVE	In Stock
BALL VALVE	In Stock
VALVE, PROP. DIRECTIONAL	Procurement Ongoing
VALVE, PROP. DIRECTIONAL	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
VALVE, PROP. DIRECTIONAL	Procurement Ongoing
VALVE, PROP. DIRECTIONAL	Procurement Ongoing
VALVE, PROP. DIRECTIONAL	Procurement Ongoing
VALVE,BALL 0.5 INCH V-CONTROL	Procurement Ongoing
VALVE,BALL 0.75 INCH V-CONTROL	Procurement Ongoing
VALVE,BALL 1 INCH V-CONTROL	Procurement Ongoing
VALVE,BALL 1.25 INCH V-CONTROL	Procurement Ongoing
VALVE,BALL 1.5 INCH V-CONTROL	Procurement Ongoing
VALVE,BALL 2 INCH V-CONTROL	Procurement Ongoing
VALVE,MOTOR ISOLATION	Procurement Ongoing
KIT, VALVE DIAPHRAGM	Procurement Ongoing
VALVE,4",BUTTERFLY	In Stock
VALVE,6",BUTTERFLY	In Stock
VALVE,BUTTERFLY 8 INCH	Procurement Ongoing
VALVE,BUTTERFLY 10 INCH	Procurement Ongoing
VALVE,BUTTERFLY 12 INCH	Procurement Ongoing
VALVE,BUTTERFLY 14 INCH	Procurement Ongoing
VALVE,BUTTERFLY 16 INCH	Procurement Ongoing
VALVE,BUTTERFLY 20 INCH	Procurement Ongoing
VALVE,BUTTERFLY 10 INCH	Procurement Ongoing
VALVE,1",AUTOMATIC,VENT	In Stock
VALVE,4",BALANCING,GRVD END	In Stock
VALVE,PRESS REDUCING 1.5INCH	Procurement Ongoing
VALVE,PRESS REDUCING 2 INCH	Procurement Ongoing
VALVE,THERMOSTATIC ETV200	Procurement Ongoing
VALVE,AIR RELEASE	In Stock
GASKET, ORS469B70	In Stock
GASKET, 2142517394	In Stock
GASKET, SY1060564	In Stock
GASKET, K10.020	Procurement Ongoing
GASKET, 60X3 - GUMMI/RUBBER	Procurement Ongoing
GASKET, A27X32 - DIN7603-CU	Procurement Ongoing
GASKET, K8.007-3	Procurement Ongoing
GASKET, AU.050	Procurement Ongoing
GASKET, A18X24, DIN7603-AL	Procurement Ongoing
GASKET, A12X18, DIN7603-AL	Procurement Ongoing
GASKET, A22X27, DIN7603-CU	Procurement Ongoing
GASKET, DIM.1 TYPE A, OILIT	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
GASKET, VG01.007	Procurement Ongoing
GASKET, K17.004-3	Procurement Ongoing
GASKET, DICHTRING 21X27X1,5	Procurement Ongoing
GASKET, ND2.011	Procurement Ongoing
GASKET, KD.027 (DIA 185)	Procurement Ongoing
GASKET, VG01.391 (DIA 185)	Procurement Ongoing
GASKET, 105X110X2, DIN7603-CU	Procurement Ongoing
GASKET, KD.027 (DIA 150)	Procurement Ongoing
GASKET, VG01.391 (DIA 150)	Procurement Ongoing
GASKET, 94X100X1, DIN7603-CU	Procurement Ongoing
GASKET, KM.027	Procurement Ongoing
GASKET, VG01.393	Procurement Ongoing
GASKET, 57/62X1, DIN7603-CU	Procurement Ongoing
GASKET, ND1.046	Procurement Ongoing
GASKET, 55X61X1, DIN7603-CU	Procurement Ongoing
KIT, WATER PUMP GASKET	In Stock
GASKET, CASE	In Stock
GASKET, PROBE	In Stock
GASKET, TANK COVER	In Stock
GASKET, MANHOLE 18" X 14"	In Stock
GASKET, FLANGE 4" X 1/16"	Procurement Ongoing
GASKET, FLANGE 2 1/2" X 1/16"	Procurement Ongoing
GASKET, ENCLOSURE COVER SEAL	Procurement Ongoing
KIT, GASKET MAKER	In Stock
GASKET	Procurement Ongoing
O-RING, 380mm x 8mm, 1447933	Procurement Ongoing
O-RING, 70mm x 2mm, 49007084	Procurement Ongoing
O-RING, 60mm x 2mm, 444785	Procurement Ongoing
O-RING, 30mm x 2mm, 445653	Procurement Ongoing
O-RING, 99mm x 3mm, 445758	Procurement Ongoing
O-RING, 50mm x 2mm, 444509	Procurement Ongoing
O-RING, COVER	In Stock
O-RING, PRP 264-VITON	Procurement Ongoing
O-RING,PRP 345-VITON (DIA 185)	Procurement Ongoing
O-RING, PRP 264-VITON	Procurement Ongoing
O-RING,PRP 345-VITON (DIA 150)	Procurement Ongoing
O-RING, PRP 254-VITON (DIA 85)	Procurement Ongoing
O-RING, PRP 228-VITON	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
O-RING, PRP 254-VITON (DIA 48)	Procurement Ongoing
O-RING, PRP 238-VITON	Procurement Ongoing
O-RING, PRP 330-VITON	Procurement Ongoing
KIT, O-RING	In Stock
O-RING,BUNA-N .210INX2.85IN	In Stock
O-RING CORD	In Stock
O-RING,BUNA N SERVOMOTOR	In Stock
SEAL RING, R09 SONDER	In Stock
V-RING, VL-220	In Stock
RING, SEAL T20 280/260.... 14.6	Procurement Ongoing
J-SEAL, CORNER 200X206.5...250	In Stock
J-SEAL, R-01-S, 100X45X15...6510	In Stock
J-SEAL, R-01S 100X45X15... 3760	In Stock
J-SEAL, R-01S 100X45X15... 6700	In Stock
J-SEAL, R-01S 100X45X15... 3530	In Stock
J-SEAL, R-01S 100X45X15... 2820	In Stock
J-SEAL, R-01S 100X45X15... 6400	In Stock
SEAL, SHAFT	In Stock
SEAL, OIL BASL 39-52-10	Procurement Ongoing
SEAL, OIL BA 52-80-10, VITON	Procurement Ongoing
SEAL, OIL BA 70-100-10, VITON	Procurement Ongoing
KIT, WATER PUMP SEAL	In Stock
KIT, MECHANICAL SEAL	In Stock
SEAL, MECHANICAL C/W GASKET	In Stock
SEAL, MECHANICAL C/W GASKET	In Stock
SEALS, MECHANICAL	Procurement Ongoing
SEAL, CABLE	Procurement Ongoing
KIT, SEAL (NG50)	In Stock
KIT, SEAL (NG63)	In Stock
KIT, SEAL (NG25)	In Stock
KIT, SEAL (NG80)	In Stock
KIT, SEAL (NG100)	In Stock
KIT, SEAL (NG10 POPPET VALVE)	In Stock
KIT, SEAL (NG6 POPPET VALVE)	In Stock
KIT, SEAL NG6 DIRECTIONAL VLV	In Stock
KIT, SEAL NG10 DIRECTIONAL VLV	In Stock
SEAL,SHAFT WATER	Procurement Ongoing
SEAL,AXIAL SHAFT 560ID 15H 25W	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
SEAL, CENTER BULB	In Stock
SEALING RING CW	In Stock
INFLATABLE SEAL ASSEMBLY	In Stock
SEALING RING CCW	In Stock
WASHER,SEAL 2-1/2 BUNA N	In Stock
CYLINDER SPACER,SERVOMOTOR	In Stock
SEAL,FLAT 90X15... 6920	In Stock
J-SEAL,100X45X15 3900	In Stock
J-SEAL,100X45X15 3400	Procurement Ongoing
J-SEAL,100X45X15 3240	In Stock
J-SEAL,100X45X15 2540	In Stock
J-SEAL,100X45X15 2510	In Stock
ASSEMBLY, S1 GUIDE HEATER	Procurement Ongoing
ASSEMBLY, S4 GUIDE HEATER	In Stock
COOLER, OIL (HEAT EXCHANGER)	Procurement Ongoing
KIT, SUBMERSIBLE PUMP REPAIR	In Stock
PUMP, 2GPM SUPPLY	Procurement Ongoing
PUMP HEAD, 7GPM REVERSE	Procurement Ongoing
PUMP, MAIN OIL (ASSEMBLED)	In Stock
PUMP, JOCKEY (ASSEMBLED)	In Stock
MOTOR, GOV. OIL PUMP	Procurement Ongoing
PUMP, GOV OIL KIDNEY	Procurement Ongoing
PUMP,MOTOR A/C D/C	Procurement Ongoing
MOTOR,WEG W22	In Stock
MOTOR,MAIN OIL PUMP HPU	In Stock
PUMP, SUBMERSIBLE SEWAGE	In Stock
PUMP,DIGITAL DOSING	Procurement Ongoing
PUMP, GEAR	In Stock
PUMP,DOM WATER 90GPM	Procurement Ongoing
PUMP, GEAR	In Stock
BLOWER/HEATER ASSY	In Stock
HEATER,GUIDE,SRG ASSY	In Stock
HEATER,GUIDE,SRG ASSY,LATERAL	In Stock
VALVE, DISCHARGE LMF (DIA 185)	Procurement Ongoing
VALVE, SUCTION LMF (DIA 185)	Procurement Ongoing
VALVE, DISCHARGE LMF (DIA 150)	Procurement Ongoing
VALVE, SUCTION LMF (DIA 150)	Procurement Ongoing
VALVE, DISCHARGE LMF (DIA 85)	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
VALVE, SUCTION LMF (DIA 85)	Procurement Ongoing
VALVE, DISCHARGE LMF (DIA 48)	Procurement Ongoing
VALVE, SUCTION LMF (DIA 48)	Procurement Ongoing
PLATE, SPRING-SUCTION VLV 98R1	Procurement Ongoing
PLATE, DAMPER - VALVES 98R1	Procurement Ongoing
PLATE, VALVE - VALVES 98R1	Procurement Ongoing
NUT, MHT - LMF VLVS 60-07H410	Procurement Ongoing
PLATE, SPRING-SUCTION VLV 88R1	Procurement Ongoing
PLATE, DAMPER - VALVES 88R1	Procurement Ongoing
PLATE, VALVE - VALVES 88R1	Procurement Ongoing
PLATE, SPRING-DISCHAR VLV 88R1	Procurement Ongoing
PLATE, SPRING - VALVES 52R2	Procurement Ongoing
PLATE, VALVE - VALVES 52R2	Procurement Ongoing
NUT, MHT - LMF VLVS 60-05H410	Procurement Ongoing
NUT, MHT - LMF VLVS 60-06H410	Procurement Ongoing
PLATE, VALVE - SUC VLV 41CD10	Procurement Ongoing
PLATE, SPRING - SUC VLV 41CD10	Procurement Ongoing
RING, VALVE - DIS VLV 48CDD	Procurement Ongoing
SPRING, DAMPER - DIS VLV 48CDD	Procurement Ongoing
PLATE, DAMPER - DIS VLV 48CDD	Procurement Ongoing
RING, OIL SCRAPER (185)	In Stock
RING, NOSE (185)	In Stock
RING, OIL SCRAPER (150)	In Stock
RING, PISTON (150)	In Stock
RING, OIL SCRAPER (85)	In Stock
RING, PISTON (85)	In Stock
RING, PISTON (48)	In Stock
V-BELT, SPA X 900MM LW	In Stock
V-BELT, SPB X 3550MM LW	In Stock
SPRING, CUP-"K" DIA 65.5/99X1	In Stock
RING, COVER - LMF K8 104-4	In Stock
RING, SPACER - LMF K8.109-4	In Stock
KIT,REPAIR-VENT VALVE AB16.001	In Stock
SEAT, VALVE - AB16.001	In Stock
KIT,REPAIR-SOL VALVE 322 H7506	In Stock
KIT, REPAIR - NON-RETURN VLV	In Stock
COMPRESSOR,ZB95K5E-TFE-260	In Stock
KIT, COMPRESSOR MOUNTING	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
COMPRESSOR,ZB76K5E-TFE-260	In Stock
ACCUMULATOR, SUCTION	In Stock
BLADDER,800L DOM WATER TK	In Stock
MODULE REDUNDANCY 24VDC	In Stock
SEPARATOR, FUEL WATER	Procurement Ongoing
ELEMENT, 1/32" PERF STRAINER	In Stock
MESH, BASKET 20	In Stock
MESH, SCREEN 40	In Stock
MESH, SCREEN 40 (400 MICRON)	In Stock
SCREEN, 50 MICRON (325 MESH)	In Stock
ELEMENT, AIR CLEANER PRIMARY	Procurement Ongoing
ELEMENT, AIR CLEANER SECONDARY	Procurement Ongoing
CARTRIDGE, OIL SEPARATOR	Procurement Ongoing
TUBE,OIL SKIMMER 35FT	In Stock
TUBE,OIL SKIMMER 66FT	In Stock
ASSEMBLY, FHP065 NON-BYPASS	Procurement Ongoing
SEAL KIT, FHP065	In Stock
GLASS,SIGHT,RUNNING	In Stock
GLASS,SIGHT,FILLING	In Stock
HEATER, SPACE 150W 120V	In Stock
HEATER, COMPART. MAGNUM DS	Procurement Ongoing
HEATER, SPACE - HEATREX	Procurement Ongoing
FAN, COOLING A10AXFN	In Stock
KIT, FAN (205 CFM, 6" ROUND)	Procurement Ongoing
CONDENSER, #HPM-15AZ	In Stock
BELTS - SUPPLY FAN	In Stock
BELTS - RETURN FAN	In Stock
BELTS - SUPPLY FAN	In Stock
BELTS - RETURN FAN	In Stock
SHAFT, FAN 1-11/16X27-1/4	In Stock
PROPELLER, WHEEL - SUPPLY FAN	In Stock
BELTS - SUPPLY FAN	In Stock
BELTS - SUPPLY FAN	In Stock
HEATER, 15W 120VAC	In Stock
HEATER, 30W 120VAC	In Stock
PUMP,SEAL WATER	In Stock
ELEMENT,HUMIDIFIER	In Stock
FILL VALVE,HUMIDIFIER	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
COOLER,SURFACE AIR MFAGS	In Stock
SWITCH,MICRO HONEY	In Stock
POWER SUPPLY,CP-C-24/10.0	In Stock
BUSHING, GUIDE VANE, BOTTOM	In Stock
BUSHING, GUIDE VANE, UPPER	In Stock
BUSHING, GUIDE VANE, INTER	In Stock
PACKING, VEE TYPE	In Stock
BEARING STRIP, INTERMEDIATE	In Stock
SEAL, U-CUP HO1	In Stock
SEAL KIT, BLADE TRUNNION	In Stock
PISTON RING	In Stock
BUSHING, OUTER, BLADE TRUNNION	In Stock
THRUST WASHER, BLADE	In Stock
BUSHING, INNER, BLADE TRUNNION	In Stock
BUSHING, LEVEL AND CROSSHEAD	In Stock
BUSHING, RUNNER CONE	In Stock
BEARING PAD, ANTI-ROTATION KEY	In Stock
PAD, BEARING, TURBINE GUIDE	Procurement Ongoing
SHAFT SEAL KIT, TURBINE	In Stock
SHAFT SEAL SLEEVE, TURBINE	In Stock
V-RING SEAL- GUIDE BEARING PAD	In Stock
V-RING SEAL CLAMP-GUIDE	In Stock
BUSHING, SERVOMETER PIN,	In Stock
BUSHING, GATE OPERATING RING	In Stock
ECCENTRIC PIN ASSEMBLY	In Stock
SHEAR LEVER, GUIDE VANE	In Stock
LEVER,GATE TURBINE	In Stock
LINK PIN, GUIDE VANE, TURBINE	In Stock
LINK, W/THREADED HOLE	In Stock
LINK, GUIDE VANE, TURBINE	In Stock
THRUST WASHER	In Stock
BUSHING, LINKS/LEVERS	In Stock
WASHER, SERVOMOTOR BEARING PIN	In Stock
WASHER, SERVOMOTOR CLEVIS	In Stock
BUSHING, SERVOMOTOR REAR CAP	In Stock
BUSHING FOR OIL HEAD	In Stock
BUSHING FOR OIL HEAD UPPER	In Stock
O-RING CHORD, SEMI SPIRAL	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
O-RING CHORD, SEMI SPIRAL	In Stock
KIT REPAIR, SERVOMOTOR	Procurement Ongoing
POLE,WOUND,ASSEMBLY TYPE A	In Stock
POLE,WOUND,ASSEMBLY TYPE B	In Stock
COLLECTOR ASSEMBLY	In Stock
KEYS,POLE, ROTOR,GENERATOR	In Stock
COIL, COOLING, THRUST & GUIDE	In Stock
KIT,WINDING INSULAT. MATERIAL	In Stock
STATOR BAR, TOP, GENERATOR	In Stock
STATOR BAR,BOTTOM,GENERATOR	In Stock
POWER SUPPLY,REDUNDANT,DC	In Stock
HOLDER,BRUSH,METRIC,POS 21	Procurement Ongoing
BRUSH,TURBINE GENERATOR	In Stock
BRUSH,TURBINE GENERATOR	In Stock
WEDGE,6.4X35.0X111.8,G11	In Stock
WEDGE,6.4X35.0X74.5,G11	In Stock
KIT, PM A041D139	In Stock
KIT, PM A041D143	In Stock
HEATER, WATER 0333-0677-02	In Stock
WINDOW, SPLICE	In Stock
DEVICE, AUTO SYNCHRONIZING	Procurement Ongoing
PLATE, BRAKE	In Stock
ASSY,AIR BRAKE MFAGS	In Stock
SPRING	In Stock
JOINT STICK (HORZ.)	In Stock
JOINT STICK (VERT.)	In Stock
GUIDE BEARING, TOP SEAL	In Stock
CSCR, HEX M6 X 1	In Stock
O-RING, 2 PC	In Stock
O-RING, LOOSE	In Stock
G-11 MACHINED BLOCK	In Stock
BLOCK, STEEL	In Stock
SCREW, HEX CAP M12	In Stock
WASHER, M12	In Stock
SHIM, (0.01)"	In Stock
SHIM, (0.02)"	In Stock
ASSEMBLY, COTTER PIN	In Stock
NUTS, M12	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
BREATHER VENT	In Stock
CYLINDER	In Stock
STUD	In Stock
BRAKE SHOE	In Stock
SHOE RETAINER	In Stock
BUSHING	In Stock
PISTON	In Stock
RING-SEAL WASHER	In Stock
O-RING	In Stock
PLUG, PRESSURE	In Stock
SEAL, POLYPAK "U" CUP	In Stock
SPRING	In Stock
SHOE BLOCK	In Stock
TOP PLATE	In Stock
BOTTOM PLATE	In Stock
SPRING WASHER	In Stock
WEDGE	In Stock
WARNING PLATE	In Stock
WARNING PLATE	In Stock
STUD	In Stock
GASKET DACRON	In Stock
CSCR, SOC. HD	In Stock
CSCR, SOC. HD	In Stock
CSCR, HEX. HD	In Stock
CSCR, HEX. HD	In Stock
NUT. MSCR, HX	In Stock
WING-NUT	In Stock
WASHER	In Stock
SEAL, PISTON ROD	In Stock
SHORT C CHANNEL	In Stock
LONG C CHANNEL	In Stock
WASHER, 25D1065KJP012	In Stock
WASHERS, 25D1065KJP013	In Stock
CSCR, HEX HEAD	In Stock
LIFTING EYE BOLT	In Stock
BOTTOM FILLER	In Stock
CENTER FILLER	In Stock
TOP FILLER	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
TOP FILLER	In Stock
TOP FILLER	In Stock
TOP FILLER	In Stock
TOP RIPPLE SPRINGS	In Stock
PISTON RING	Procurement Ongoing
LAMP, UV REPLACEMENT	Procurement Ongoing
TERMINAL, OPERATOR, TOUCH SCREEN	In Stock
ISOLATOR, VIB.KORFUND 2400	In Stock
ISOLATOR, VIBRATION	Procurement Ongoing
HOUSING, PROBE (NYLON)	In Stock
UNIT, CONDENSATE DRAIN	Procurement Ongoing
ELEMENT, SRG GUIDE HEATING	In Stock
WHEEL ASSEMBLY	In Stock
GUIDE ROLLER ASSEMBLY	In Stock
WHEEL ASSEMBLY	Procurement Ongoing
POWER SUPPLY, 24V DC INPUT	In Stock
SWITCH, AIR PRESSURE (LF32-11)	Procurement Ongoing
CONVERTER, DC/DC, 2320034	In Stock
CONVERTER, DC/DC, 2320018	In Stock
SOCKET, AUX RELAY, 2833563	In Stock
COIL, AUX RELAY 120VAC 2834135	In Stock
RELAY, TIMER 2866161	In Stock
COIL, AUX RELAY 120VAC 2901912	Procurement Ongoing
MODULE, REDUNDANCY, 2902879	In Stock
CARD, MODBUS COM. MODULE	Procurement Ongoing
SERVER, SERIAL DEVICE	In Stock
RELAY, AUX 125VDC, 2834313	In Stock
RELAY, AUX 24VDC, 2834096	In Stock
THERMOSTAT, HOFFMAN ATEMHUM	In Stock
HUMIDISTAT, HOFFMAN AMHUM	In Stock
POWER SUPPLY, PS/1AC/24VDC/10A	In Stock
HYGROSTAT, MECHANICAL	In Stock
THERMOSTAT, DUAL HOFFMAN	In Stock
RELAY, TIMER 2866187	In Stock
VALVE, CHECK 2" FLANGED CS	In Stock
THERMOSTAT, CUMMINS	In Stock
SWITCH, BASIN	In Stock
CONTROL, FAN U_PWM_MAX12V	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
VALVE, BACK PRESSURE 1/2"	In Stock
VALVE, RELIEF 1/2"	In Stock
CONTROLLER, UVMAXPRO10	In Stock
VALVE, BALL 1/2" PVC	In Stock
VALVE, BALL 3/4" PVC TYPE 21	In Stock
TIMER, NXT2-24V	In Stock
VALVE, BALL 1" PVC TYPE 21	In Stock
VALVE, BALL 1/2" PVC	In Stock
THERMOSTAT, HIGH LIMIT	In Stock
SWITCH, DIFFERENTIAL PRESSURE	In Stock
VALVE, CHECK B34236 1 1/8"	In Stock
CONTROL, DUAL PRESSURE	In Stock
CONTROL, DUAL PRESSURE	In Stock
COIL, SOLENOID MKC-2	In Stock
VALVE, SOLENOID B14S2	In Stock
VALVE, SOLENOID B19S2	In Stock
SWITCH, #HBL11	In Stock
VALVE, BYPASS #ADRHE-6	In Stock
DEPRESSOR, #200-2026-14	In Stock
VALVE, MAGNI-CHECK	In Stock
VALVE, BYPASS #ADRPE-3	In Stock
VALVE, THERMOSTATIC EXPANSION	In Stock
VALVE, THERMOSTATIC EXPANSION	In Stock
SWITCH, DIFF. PRES.	In Stock
RELAY, CNTRL DPDT 24VAC COIL	In Stock
RELAY, CNTRL DPDT 12VDC COIL	In Stock
CONTROLLER, THERMOSTAT	In Stock
VALVE, BALL FLOWTEK 2" FNPT	In Stock
VALVE, BALL FLOWTEK 1" FNPT	In Stock
VALVE, BUTTERFLY BRAY 4" ELEC	In Stock
VALVE, BUTTERFLY BRAY 4" WHEEL	In Stock
VALVE,BUTTERFLY BRAY 2.5" ELEC	In Stock
VALVE,BUTTERFLY BRAY 2.5" WHL	In Stock
VALVE, AIR RELEASE 801AS	In Stock
SNUBBER, .25PO MNPT	In Stock
VALVE, PROPORTIONAL-RB CONTROL	In Stock
VALVE, PROPORTIONAL-GV CONTROL	Procurement Ongoing
VALVE, KIDNEY LOOP CONTROL	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
VALVE, SHUT-DOWN & STOP	In Stock
VALVE, UNLOADING	In Stock
VALVE, RUNNER STOP	In Stock
VALVE, WATER ADMISSION	In Stock
SWITCH, ELECTRIC CLOGGING IND	In Stock
SWITCH, ELECTRIC WATER SENSOR	In Stock
SWITCH, PRESSURE	In Stock
SWITCH, LEVEL FLOAT	Procurement Ongoing
TRANSMITTER, PRESSURE	Procurement Ongoing
CONTROLLER, ELEC TEMP HUMIDITY	In Stock
MODULE, DIGITAL OUTPUT	In Stock
CONTROL, HYDRAULIC DRIVE	In Stock
FLOAT SWITCH, HEAD COVER SUMP	Procurement Ongoing
SWITCH, PRESSURE	In Stock
SENSOR, PRESSURE SWITCH	In Stock
LIMIT SWITCH 802T-DTPD	In Stock
FLOAT SWITCH LFL2-BK-U-PVC10	Procurement Ongoing
MODULE, CONTROLLER, 48V	In Stock
INVERTER, INEX, 48V, 1.5KVA/1200W	In Stock
MODULE, OUTPUT EXPANSION, ROM	In Stock
CONTROLLER, PROGRAMMABLE, 8CH	In Stock
MODULE I/O, 32PT DC SINK/SOURCE	In Stock
CONTROLLER, L3, 2MB MEMORY	In Stock
MODULE, DIN RAIL DIODE, 48VDC	In Stock
MOTOR, 60HP, 1200RPM, 575V, 60HZ	In Stock
CARD, I/O, 8 CHANNEL, ANALOG	In Stock
CARD, I/O, 4 CHANNEL, ANALOG	In Stock
CARD, I/O, 8 VOLTAGE OR CURRENT	In Stock
CARD, I/O, 24VDC, 32 DIGIT INPUTS	In Stock
RELAY, DC CTRL 1SNA645012R2500	In Stock
RELAY, DC CTRL 1SNA645041R0200	In Stock
PROTECTION, MOTOR CONTROL	In Stock
RELAY, 24VDC CONTROL CAD32BD	In Stock
RELAY, 24VDC CONTROL CAD50BD	In Stock
CONTACTOR, 600V, 3 POLE, 80A	In Stock
RELAY, ZELIO TIMING	In Stock
RELAY, ZELIO TIMING	In Stock
CONTACTOR, TESYS, LC1 D40G7	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
CONTACTOR, TESYS D, LC1 D09BD	In Stock
RELAY, SMART LOGIC SR3B261BD	In Stock
24Vdc Redundant Power Supply	In Stock
2-PORT CLX Hi-Cap ENET/P	In Stock
CONTROLLOGIX 8PT RTD/THRMCP In	In Stock
POWER SUPPLY, 125 VDC	In Stock
RELAY, OVERCURRENT FOR HORN	In Stock
RELAY, AC UNDERCURRENT	In Stock
GATEWAY, SUBSTATION	Procurement Ongoing
CONTACTOR, 600V, 3 POLE, 50A	In Stock
RELAY, EMERG STOP XPSAXE5120P	In Stock
RELAY, EMERG STOP XPSAR311144	Procurement Ongoing
RELAY, SMART ANALOG SR3XT43BD	In Stock
CONVERTER, ANALOG RMCL55BD	In Stock
METER, POWER, SEL	In Stock
RELAY, LOAD MONITORING	In Stock
SWITCH, HIGH TEMP CUT-OFF	In Stock
MOTOR, 5HP ELECTRIC TECHTOP	In Stock
CLOCK, SUBSTATION TCG 01-G	In Stock
CLOCK, PTP CONVERTER	In Stock
SWITCH, TEMP 1/16DIN, 24VDC	In Stock
CONTROLLER, TEMP 1/8DIN, 24VDC	In Stock
SWITCH, SLACK ROPE	In Stock
RELAY, STYLE# 7805D	In Stock
RELAY, RELIR4/LDP125DC/4X21AU	In Stock
RELAY, TMK PWR MON. 85-120VAC	In Stock
RELAY, ELECTRICALLY HELD 120V	In Stock
RELAY, LATCHING 12 POLE 10A	In Stock
RELAY, LATCHING 4 POLE 10A	In Stock
RECTIFIER, SILICON	In Stock
RELAY, GROUND FAULT	In Stock
RELAY, CONTROL (24VDC)	In Stock
SUPPLY, POWER 110/230 SE	In Stock
CONTACTOR, G-E 35A	In Stock
WIRE, WITH PROBE BLACK PLUG	In Stock
KIT, 3/4" DRAIN REPLACEMENT	In Stock
RELAY, CSR 113 RA6050-D16	In Stock
RELAY, CSR 120 RA6050-D16	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
RELAY, RA6050-D16	In Stock
RELAY, AUX STRUTHERS-DUNN	Procurement Ongoing
RELAY, AUX STRUTHERS-DUNN	Procurement Ongoing
RELAY, AUX STRUTHERS-DUNN	Procurement Ongoing
RELAY,AUX EATON	Procurement Ongoing
RELAY,AUX EATON	Procurement Ongoing
RELAY,LATCHING EATON	Procurement Ongoing
RELAY,TIME DELAY AGASTAT	Procurement Ongoing
CONTROLLER, INPUT MODULE	In Stock
RELAY, MODULAR SMART	In Stock
MODULE, DISCRETE I/O EXTENSION	In Stock
RELAY, EMERGENCY STOP	In Stock
MODULE, DIGITAL OUTPUT	In Stock
HMI, ADVANTECH TPC-1840WP	Procurement Ongoing
SOCKET, RELAY BASE P2CF-08	In Stock
RELAY, 4PDT 125 VDC	In Stock
MODULE, RELAY 2967086	In Stock
ASSEMBLY, CONTROL (CHARGER)	In Stock
KIT, CONTROL (ANN WITH ENCL)	In Stock
KIT, CONTROL (NTWK COMM)	In Stock
KIT, HARNESS	Procurement Ongoing
FAN, 24 VDC	In Stock
MODULE, COMMCENTER	In Stock
CUT-OUT, THERMO	In Stock
ACTUATOR,ELECTRIC SERIES 70	In Stock
HMI, MULTI TOUCH PANEL COMP.	Procurement Ongoing
CARD,MODBUS TCP COMM	In Stock
ACTUATOR, DAMPER	In Stock
MODULE RTD SEL 2600	In Stock
RTD,OIL TEMP,W/CONNECTION HEAD	In Stock
RTD,SAC AIR OUTLET	In Stock
RTD,COLLECTOR HOUSING	In Stock
INDICATOR,FLOW,6",FLANGED	In Stock
RTD,STATOR WINDING,100 OHM	In Stock
RTD, SRG GUIDE HEATER CONTROL	In Stock
TRANSMITTER, ISOLATED TEMP-RTD	In Stock
TRANSMITTER, ISOLATED TEMP-T/C	Procurement Ongoing
RTD, SRG BODY/BLOWER ASSEMBLY	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
TRANSMITTER, ROTARY / ENCODER	Procurement Ongoing
SENSOR, 0-90 OHM LEVEL	In Stock
TRANSMITTER/PROBE, TANK LEVEL	In Stock
KIT, LOW COOLANT LEVEL SENSOR	Procurement Ongoing
SENDER, PRESSURE	In Stock
VALVE, FILL SST .125 COMPLETE	In Stock
SENSOR, TANK TEMPERATURE	In Stock
SENSOR, AIRFLOW HC-201	In Stock
SIGHT GLASS, #SA-17S	In Stock
TRANSMITTER, DIFF. PRES.	In Stock
TRANSMITTER, FLOW	In Stock
TRANSMITTER, HUMIDITY	In Stock
TRANSMITTER, CURRENT	In Stock
THERMOCOUPLE, TYPE K	In Stock
THERMOMETER, QUALITROL 118 ITM	In Stock
INDICATOR, DIFF PRESS ASHCROFT	Procurement Ongoing
GAUGE, PRESSURE WINTERS	In Stock
INDICATOR, DIFF PRESS D464B	Procurement Ongoing
GAUGE, DIFF PRES ASHCROFT	Procurement Ongoing
SENSOR, ELECTRONIC TEMPERATURE	In Stock
METER, ELECTRONIC FLOW	In Stock
SENSOR, ELECTRONIC LEVEL	In Stock
SWITCH, ELECTRONIC LEVEL	In Stock
SWITCH, ELECTRONIC PRESSURE	In Stock
THERMOMETER,OIL GSU XFMR	In Stock
THERMOMETER,WINDING GSU XFMR	In Stock
THERMOMETER,OIL SIDEMOUNT	In Stock
SENSOR,TEMP MAGNETIC MOUNT	Procurement Ongoing
TRANSMITTER,PRESSURE 1XTX	In Stock
TRANSMITTER,PRESSURE 1XTX	In Stock
TRANSMITTER,TEMP STT830	In Stock
TRANSMITTER,PRESSURE STG74L	In Stock
TRANSMITTER,LEVEL LGC	Procurement Ongoing
TRANSMITTER,PRESSURE PMP51	In Stock
TRANSMITTER, LEVEL	Procurement Ongoing
TRANSMITTER, 4 CHANNEL LIQUILI	In Stock
SENSOR, ULTRASONICS FLOW RATE	Procurement Ongoing
FLOWMETER, 2"	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
FLOWMETER, 1 1/2"	Procurement Ongoing
RTD - DRYWELL DYNATHERM	Procurement Ongoing
METER, ELECTRONIC HOUR	Procurement Ongoing
COUNTER, TIME 24VDC	In Stock
FLOAT SWITCH TK1-001N-BSK	In Stock
LEVEL SWITCH MLS-4EX	Procurement Ongoing
SENSOR, CURRENT 4-20mA OUTPUT	In Stock
SENSOR, CURRENT (RANGE: 10)	In Stock
SENSOR, CURRENT	In Stock
SENSOR, STD 3 PL CURRENT 800A	In Stock
SENSOR, CURRENT (RANGE 0 -10A)	Procurement Ongoing
PICK-UP, MAGNETIC	In Stock
SWITCH, ULTRASONIC LEVEL	Procurement Ongoing
CYLINDER, CALIBRATION 1/2" NPT	In Stock
AMALGAM LAMP, UVMAX PRO	In Stock
PROBE, INTENSITY UV REACTOR	In Stock
KIT, UVMAX PRO30 (LAMP)	In Stock
SENSOR, PH	In Stock
SENSOR, CHLORINE	In Stock
SENSOR, TURBIDITY	In Stock
INDICATOR, DENSITY ABB	Procurement Ongoing
MONITOR, DENSITY ABB	Procurement Ongoing
DEVICE, SF6 FILLING ABB	Procurement Ongoing
DETECTOR, SF6 GAS LEAK ABB	Procurement Ongoing
MONITOR, THREE PHASE ABB	Procurement Ongoing
MONITOR,TRIP COIL E-MAX	Procurement Ongoing
SWITCH, FLOW M3S7HB15	In Stock
SERVO LVDT RP-S-650M-D60-1-A01	Procurement Ongoing
LVDT RP-S-250M-D60-1-A01	Procurement Ongoing
METER, POWER QUALITY SEL 735	In Stock
RECORDER DIGITAL FAULT	Procurement Ongoing
MOTOR, ELECTRIC A285000000	In Stock
MOTOR, 7GPM REVERSE PUMP	Procurement Ongoing
MOTOR, 7.5HP TECO-WEST.	In Stock
MOTOR, 3HP TECO-WEST.	In Stock
MOTOR, 15HP TECO-WEST.	In Stock
MOTOR, 2HP TECO-WEST.	In Stock
MOTOR, 3HP TECO-WEST.	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
MOTOR, 1HP TECO-WEST.	In Stock
MOTOR, 10HP TECO-WEST.	In Stock
MOTOR, 10HP TECO-WEST.	In Stock
MOTOR, 2HP/1800RPM/575V	In Stock
MOTOR, 3HP/1800RPM/575V	In Stock
MOTOR, 0.5HP/1800RPM/575V	In Stock
MOTOR, 1HP TECO-WEST.	Procurement Ongoing
MOTOR,SEAL WATER	In Stock
MOTOR,OIL SKIMMER	In Stock
MOTOR,KIDNEY PUMP	In Stock
MOTOR,ELECTRIC TEF 3PH 60HP	Procurement Ongoing
MOTOR,1.5HP,3465RPM,600V,60HZ	Procurement Ongoing
MOTOR,75HP,1185RPM,575V,60HZ	In Stock
PUMP,MOTOR D/C	In Stock
MOTOR, ASYNCHRON 3 PHASE	Procurement Ongoing
MOTOR, 20HP BROOK CROMPTON	Procurement Ongoing
MOTOR, 3-PHASE INDUCTION	Procurement Ongoing
STARTER, MOTOR	Procurement Ongoing
RELAY,ELECTROMECHANICAL,24VDC	In Stock
BREATHER,DESSICANT,HYDRAULIC	In Stock
BUSHING,HV,GOE1425-1050 1	Procurement Ongoing
BUSHING,LV,ALAMO 25 KV	Procurement Ongoing
BUSHING,NEUTRAL,ALAMO 25 KV	Procurement Ongoing
DESSICANT,XFMR BREATHER	In Stock
TRANSFORMER, CONTROL	In Stock
DEVICE,PRESSURE RELIEF	Procurement Ongoing
XFMR, 3KVA 600V - 480V	In Stock
XFMR,NEUTRAL GND 110KV BIL	Procurement Ongoing
TRANSFORMER, CONTROL 750VA	In Stock
CT, GROUND FAULT FOR D64 RELAY	In Stock
TRANSFORMER, VOLTAGE MODEL 450	In Stock
TRANSFORMER, CURRENT 800:5	In Stock
TRANSFORMER, CURRENT 1200:5	In Stock
TRANSFORMER, CURRENT 3200:5	In Stock
TRANSFORMER, CNTRL C0100E5EFB	In Stock
TRANSFORMER, CONTROL 500VA	In Stock
TRANSFORMER, CONTROL 100VA	In Stock
TRANSFORMER, CONTROL 200VA	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
TRANSFORMER, CONTROL 200VA	In Stock
TRANSFORMER, CONTROL 350VA	In Stock
TRANSFORMER, CONTROL 150VA	In Stock
TRANSFORMER, CONTROL 250VA	In Stock
TRANSFORMER, CONTROL 100VA	In Stock
TRANSFORMER, 600V/24V	In Stock
TRANSFORMER, THERMOLEC	In Stock
TRANSFORMER, #PH250AJ	In Stock
TRANSFORMER, CURRENT 15KV	In Stock
TRANSFORMER, CURRENT 10KV	In Stock
TRANSFORMER, CURRENT 12000:5	In Stock
TRANSFORMER, CURRENT 12000:5	In Stock
TRANSFORMER, VOLTAGE 15000:120	In Stock
TRANSFORMER, VOLTAGE 15000:120	In Stock
TRANSFORMER, VOLTAGE 15000:120	In Stock
TRANSFORMER,CONTROL 150VA	In Stock
XFMR,CONTROL EATON 150VA	In Stock
XFMR,CONTROL 300VA	In Stock
TRANSFORMER,CURRENT 600:5	In Stock
TRANSFORMER,POTENTIAL 600:120V	In Stock
TRANSFORMER,CT NEUTRAL TC-1093	Procurement Ongoing
TRANSFORMER,CT NEUTRAL TC-1094	Procurement Ongoing
TRANSFORMER,CT SPLIT-PHASE	Procurement Ongoing
REGULATOR, AUTO VOLT (24V)	In Stock
RESISTOR,BRAKING 800W 15.4OHMS	In Stock
RESISTOR,BRAKING 2.8KW 19OHMS	In Stock
RESISTOR,BRAKING 55KW 19OHMS	In Stock
RESISTOR,BRAKING 111KW 7OHMS	In Stock
RESISTOR,BRAKING 9.4KW 9.2OHMS	In Stock
REACTOR,LINE 8A 5MH	Procurement Ongoing
REACTOR,LINE 8A 7.5MH	Procurement Ongoing
REACTOR,LINE 18A 1.5MH	Procurement Ongoing
REACTOR,LINE 18A 2.5MH	Procurement Ongoing
REACTOR,LINE 80A 0.4MH	Procurement Ongoing
REACTOR,LINE 80A 0.7MH	Procurement Ongoing
REACTOR,LINE 100A 0.3MH	Procurement Ongoing
REACTOR,LINE 100A 0.45MH	Procurement Ongoing
RESISTOR,NEUTRAL GROUNDING	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
XFMR/SENSOR,CURRENT,1600A	In Stock
XFMR/SENSOR,CURRENT,3200A	In Stock
XFMR/SENSOR,CURRENT,800A	In Stock
FAN,MFA GSU XFMR 208V 1140RPM	In Stock
MOTOR,OFF LOAD TAP CHANGER	Procurement Ongoing
XFMR, 600/120 200VA MCI	Procurement Ongoing
XFMR, 600/120 100VA HAMMOND	Procurement Ongoing
XFMR, 600/120 300VA MCI	Procurement Ongoing
XFMR, 600/120 100VA MCI	Procurement Ongoing
BUSHING, LV	Procurement Ongoing
BUSHING, HV	Procurement Ongoing
BUSHING, LV	Procurement Ongoing
BUSHING, HV	Procurement Ongoing
XFMR, 600/120 150VA MCI	Procurement Ongoing
BREAKER,CIRCUIT,20A,1POLE	In Stock
BREAKER,CIRCUIT,15A,SERIES L9	In Stock
ARRESTOR,SURGE, 025W0412BL I	Procurement Ongoing
SET, 5KVA CPT PRIMARY FUSE	In Stock
SPRING RELEASE 110-127 VAC/VDC	In Stock
SET, METERING PT PRIMARY FUSE	In Stock
MOTOR, COMPOUND DRIVE ABB	Procurement Ongoing
BRUSHES, CARBON ABB	Procurement Ongoing
GEAR, STRAIGHT TOOTH BEVEL ABB	Procurement Ongoing
VALVE, PILOT 110-125VDC ABB	Procurement Ongoing
COILS, OPEN & CLOSE ABB	Procurement Ongoing
MOTOR, DISCONNECT DRIVE ABB	Procurement Ongoing
MOTOR, DISCONNECT GND SW ABB	Procurement Ongoing
MOTOR, GND SW GCB SIDE ABB	Procurement Ongoing
MOTOR, STATIC START SWITCH ABB	Procurement Ongoing
CONTACT, STATIONARY MAIN	Procurement Ongoing
CONTACT, MOVING MAIN	Procurement Ongoing
CONTACTOR,MINI,FVNR 9A	In Stock
SWITCH,1-POLE 15KV NEUTRAL GND	Procurement Ongoing
SENSOR,2V BATTERY,Z BRACKET	In Stock
SENSOR/RATING PLUG,1200A	In Stock
CONTACTOR, SIZE 1	In Stock
CONTACTOR, SIZE 2	In Stock
CONTACTOR, SIZE 3	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
CONTACTOR, SIZE 4	In Stock
O/L, C441 (TRIP RANGE .3-9A)	In Stock
O/L, C441 (TRIP RANGE 1-9A)	In Stock
O/L, C441 (TRIP RANGE 5-90A)	In Stock
BREAKER, CIRCUIT (MDS-608)	Procurement Ongoing
CONTACTOR, SIZE 0	In Stock
O/L, C440 (RANGE .33-1.65A)	In Stock
O/L, C440 (RANGE 1 - 5A)	In Stock
O/L, C440 (RANGE 4 - 20A)	In Stock
BREAKER, EATON HMCP003A0C	In Stock
BREAKER, EATON HMCP007C0C	In Stock
BREAKER, EATON HMCP015E0C	In Stock
CONTACT, AUXILIARY 2NO/2NC	In Stock
ATTACHMENT, CONTACT 595-AB	In Stock
BREAKER, ABB SU201M-C1	In Stock
CONTACTORS, OPERATING	In Stock
CONTACTOR, 30A 3 240V	In Stock
BREAKER, EATON HFD3015S	In Stock
BREAKER, EATON HFD1015S	In Stock
BREAKER, EATON HFD2015S	In Stock
BREAKER, EATON HFD3020S	In Stock
BREAKER, EATON HFD2030S	In Stock
BREAKER, EATON HFD2060S	In Stock
BREAKER, EATON HFD3090S	In Stock
BREAKER, EATON HFD3100S	In Stock
BREAKER, EATON HFD3125S	In Stock
BREAKER, EATON FDC3015S	In Stock
BREAKER, EATON FDC2030S	In Stock
BREAKER, EATON BAB1015	In Stock
BREAKER, EATON BAB1020	In Stock
BREAKER, EATON BAB1030	In Stock
BREAKER, EATON BAB2015	In Stock
BREAKER, EATON BAB2020	In Stock
BREAKER, EATON BAB2030	In Stock
BREAKER, EATON BAB2040	In Stock
BREAKER, EATON BAB3015H	In Stock
BREAKER, EATON BAB3030H	In Stock
BREAKER, EATON EHD3070S	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
BREAKER, EATON EHD3100S	In Stock
BREAKER, EATON HJD2250FS	In Stock
BREAKER, EATON JT2100T	In Stock
BREAKER, EATON KES3125LSIG	In Stock
TRIP UNIT, ELECTRONIC 3P 400A	In Stock
TRIP UNIT,RMS 310 3P 250A	In Stock
BREAKER, ABB S202UDC-K10	In Stock
BREAKER, ABB SU201M-C10	In Stock
BREAKER, ABB SU201M-C8	In Stock
BREAKER, ABB SU201M-C5	In Stock
BREAKER, ABB SU201M-C2	In Stock
CONTACTOR, SCHNEIDER ELECTRIC	Procurement Ongoing
ASSEMBLY, REVERSE CONTACTOR	Procurement Ongoing
RELAY,OVERLOAD	Procurement Ongoing
ASSEMBLY,MAN MOTOR START EATON	Procurement Ongoing
CONTACTOR,ABB	In Stock
BREAKER, EATON HMCPS015E0S	Procurement Ongoing
KIT,CONTROL MODULE 3 WIRE	In Stock
COIL, ALLEN BRADLEY 500LG	In Stock
DISPLAY, C441 OVERLOAD RELAY	In Stock
TRIP UNIT,RMS 310 3P 250A	Procurement Ongoing
COVER,BREAKER TERMINAL END	In Stock
ARC CHAMBER	Procurement Ongoing
OVERLOAD RELAY, ZEB 32-5-GF	In Stock
OVERLOAD RELAY, ZEB 150	In Stock
RESET BAR, OVERLOAD RELAY	In Stock
COIL, REPLACEMENT 110-120 VAC	In Stock
CONTACT,MOTOR STARTER DILM25	In Stock
KIT, KEY INTERLOCK EATON	In Stock
CONTACTOR, REVERSING 24VDC	In Stock
KIT, REMOTE RACKING 86-5958	In Stock
DIGITRIP 520MC LSIG	In Stock
BREAKER, EATON HFD3040S	In Stock
SWITCH,STATIC TRANSFER,INEX	Procurement Ongoing
SWITCH,NETWORK,UNMANAGED	In Stock
SWITCH, AUX K FRAME	In Stock
ASSEMBLY, 60A ROTARY/STAB	In Stock
ASSEMBLY, 150A ROTARY/STAB	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
ASSEMBLY, 225A ROTARY/STAB	In Stock
ASSEMBLY, 320A ROTARY/STAB	In Stock
SELECTOR, 3 POS 800T-J2KC1ANAX	Procurement Ongoing
SWITCH, 2 POSITION KEYED	Procurement Ongoing
SWITCH, 3 POS. 800HC-JR2KD7B	Procurement Ongoing
SWITCH, 3 POS. 800FP-KM34PX11	Procurement Ongoing
SWITCH, 2 POS. 800FP-KM22PX01	Procurement Ongoing
SELECTOR, 3 POS. 800H-JR2KC1B	Procurement Ongoing
SELECTOR, 3 POS 800T-J2KC1B	Procurement Ongoing
PUSH-BUTTON, RED 800TC-A6B	Procurement Ongoing
SWITCH, DISCONNECT THERMOLEC	In Stock
SWITCH, AIRFLOW SCHNEIDER	In Stock
SWITCH, DISCONNECT THERMOLEC	In Stock
DISCONNECT, 400A NON-FUSED	In Stock
DISCONNECT, 30A NON-FUSED	In Stock
DISCONNECT, 60A NON-FUSED	In Stock
DISCONNECT, 100A NON-FUSED	In Stock
DISCONNECT, 200A NON-FUSED	In Stock
DISCONNECT, 400A NON-FUSED	In Stock
SWITCH, SELECTOR 2 POS 800T-H2	In Stock
DISCONNECT, 200A NON-FUSED	In Stock
MONITOR, VALVE STATUS BRAY	In Stock
SWITCH, VALVE SUPERVISORY	In Stock
SWITCH, DIFF PRESS TYPE 400	In Stock
SWITCH, PUSHBUTTON ES ABB	In Stock
SWITCH, OVERTRAVEL LIMIT	Procurement Ongoing
PUSHBUTTON, BLACK HARMONY 22MM	In Stock
PUSHBUTTON, GREEN HARMONY 22MM	In Stock
PUSHBUTTON, YELLOW HARMONY 22MM	In Stock
PUSHBUTTON, EMERGENCY 40MM RED	In Stock
CONTACT, AUX NO NC SIZE 5	In Stock
SWITCH, KNIFE	In Stock
SWITCH, PUSHBUTTON RED	In Stock
SWITCH, PUSHBUTTON GREEN	In Stock
INTERLOCK, MECHANICAL	In Stock
PUSHBUTTON, BLACK	In Stock
LAMP, INDICATING 120V BLUE	In Stock
SWITCH, PUSHBUTTON ESTOP	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
SWITCH,PUSHBUTTON BLACK	In Stock
SWITCH, LIMIT OILTIGHT	In Stock
RELAY,VOLTAGE MONITOR 3 PHASE	Procurement Ongoing
RELAY AUXILIARY 600VAC 10AC	In Stock
RELAY,REMOVABLE,24VDC,3 FORM C	In Stock
BASE, RELAY,11 PIN	In Stock
RELAY,TIMED,24VDC	In Stock
BASE, RELAY,8 PIN	In Stock
BASE, RELAY 3369184:AA	In Stock
RELAY, 10A	In Stock
BASE, RELAY 3715027:AA	In Stock
RELAY,24VDC,12A	In Stock
RELAY,24VDC,ECM	In Stock
RELAY,AUXILIARY,125 VDC	In Stock
RELAY,CONTROL,24VDC COIL	In Stock
RELAY,CONTROL,125VDC COIL	In Stock
RELAY,PROTECTION, "A"	In Stock
CONTROLLER,AUTOMATION	In Stock
RELAY,PROTECTION, "A"LINE	In Stock
CONTROLLER,AUTOMATION	In Stock
RELAY,PROTECT,SPLIT-PHASE,"A"	In Stock
RELAY,TRANSFORMER,PROTECT,"A"	In Stock
RELAY,BREAKER FAILURE,PROTECT	In Stock
RELAY,FEEDER PROTECT,SEL-751A	In Stock
CONTROLLER,AUTOMATION	In Stock
RELAY,SWITCHYARD LINE,"A"	In Stock
RELAY,BISTABLE,RXMVB2,2 MAKE	In Stock
RELAY,BISTABLE,RXMVB2,4 MAKE	In Stock
RELAY,BISTABLE,RXMVB4,9 MAKE	In Stock
RELAY,BISTABLE,RXMVB4,5NO9NC	In Stock
RELAY,AUXILIARY,125 VDC,RXMH2	In Stock
RELAY,AUXILIARY,125VDC,RXMS1	In Stock
COIL,TRIP,LOCKOUT RELAY	In Stock
RELAY,AUXILIARY,24VDC COIL	In Stock
RELAY,POWER,4PDT,24VDC/250VAC	In Stock
RELAY,AUX, 24VDC COIL,HIGH	In Stock
RELAY,POWER,DPDT,24VDC/250VAC	In Stock
RELAY,CONTROL,100-250VDC/AC	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
RELAY,CONTROL,125VDC COIL,2"C"	In Stock
RELAY,CONTROL,24VDC COIL,3"C"	In Stock
RELAY,CONTROL,24VDC COIL,3"C"	In Stock
RELAY,CONTROL,24VDC COIL,2"C"	In Stock
RELAY,TIMER,24VDC COIL	In Stock
RELAY,TIMER,24-240VAC/DC COIL	In Stock
RELAY,LATCHING,24VDC, 8 "C"	In Stock
RELAY, GAS, MODEL 12	Procurement Ongoing
RELAY,8ZONE,MODEL 4007-9801	In Stock
RELAY, TIMER 2905813	In Stock
RELAY, 4PDT 5A 120VAC 2903305	In Stock
RELAY, DPDT 120VAC 2961228	In Stock
BASE, RELAY - D7DT 2967031	In Stock
RELAY, SPDT 120VAC 2961134	In Stock
BASE, RELAY - SPDT 2966032	In Stock
RELAY, TIMING/POWER OFF DELAY	Procurement Ongoing
RELAY, DPDT 120VAC 2967138	In Stock
RELAY, TIME ETD-1T-ON-300S	In Stock
BASE, RELAY - 700-HN103	Procurement Ongoing
RELAY, TIME DELAY UNDERVOLTAGE	In Stock
CONTACT, AUX DPDT 500LG-142C	Procurement Ongoing
RELAY, TIME DELAY ON 11 PIN	Procurement Ongoing
RELAY, TIME DELAY UNDERVOLTAGE	Procurement Ongoing
CONTACT, PIN	Procurement Ongoing
CONTACT, SOCKET	Procurement Ongoing
RELAY, TIMING/PULSE OUTPUT	In Stock
CONTACT, AUXILIARY SPDT	In Stock
RELAY, SPDT COIL 24VDC	In Stock
RELAY, DPDT COIL 120VAC	In Stock
RELAY, DPDT COIL 24VDC	In Stock
RELAY, 4PDT COIL 24VDC	In Stock
RELAY, 4PDT COIL 125VDC	In Stock
TIMER, MULTIMODE DPDT	In Stock
TIMER, POWER OFF-DELAY SPDT	In Stock
RELAY, DPDT COIL 24VAC	In Stock
RELAY,SYNCHROCHECK ABB	In Stock
RELAY,SYNCHROCHECK DUAL ABB	In Stock
RELAY, MINI 120 VAC	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
RELAY,AUXILIARY	In Stock
RELAY,MONITORING 3 PHASE	In Stock
RELAY,ELEC OVERLOAD 3 POLES	In Stock
RELAY,TIMING 0.5SEC-999HRS	In Stock
RELAY, AUXILIARY - 2903695	In Stock
RELAY, OVERVOLTAGE RXEDA 1	In Stock
RELAY, ELECT.MEASURE & MONITOR	In Stock
RELAY, BREAKER TRIP COIL	In Stock
RELAY, GENERATOR MECH PROT	In Stock
RELAY, GENERATOR SPLIT PROT	In Stock
RELAY, TRANSFORMER PROT	In Stock
RELAY,OVERVOLTAGE	In Stock
RELAY, TRANSFER TRIP PROT	In Stock
RELAY, LINE PROT	In Stock
RELAY, TRANSFER TRIP PROT	In Stock
RELAY, LINE PROT	In Stock
RELAY.SYNCHROCHECK ABB	Procurement Ongoing
RELAY, GENERATOR ELECT PROT	In Stock
METER RELAY,ANALOG CROMPTON	In Stock
RELAY,CONTROL,120VAC COIL,3"C"	In Stock
RELAY,CONTROL,125VDC COIL,3"C"	In Stock
CLIP, RELAY HOLDER	In Stock
RELAY,CONTROL TESYS K 2NO-2NC	In Stock
RELAY,MULTI PHASE MONITOR SPDT	In Stock
OVERLOAD RELAY, 90 TO 150A	In Stock
RELAY,OVERLOAD 5.5-8A TESYS	In Stock
RELAY,OVERLOAD 30-40A TESYS	In Stock
RELAY,OVERLOAD 63-80A TESYS	In Stock
RELAY,TIMER DELAY-ON .05-300S	In Stock
RELAY,SAFETY XPS AC 120VAC	In Stock
RELAY, 120VAC COIL 8 PIN	In Stock
RELAY, AUXILIARY	In Stock
CONTACTS,EATON DILM150	In Stock
CONTACTS,EATON DILM95	In Stock
COIL,CONTACT EATON 110-250V	In Stock
CONTACT,SET EATON DILM250	In Stock
CONTACT,AUX EATON DILM32	In Stock
MODULE,AUX CONTACT DILM1000	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
MODULE,AUX CONTACT DILM820	In Stock
CONTACT,AUX EATON C320KGS1	In Stock
CONTACT,AUX EATON C320KGS2	In Stock
RELAY,OVERLOAD EATON 24-32A	In Stock
RELAY,OVERLOAD EATON 5A	In Stock
RELAY,VOLTAGE BENDER	In Stock
RELAY, TERMINAL BLOCK	In Stock
RELAY, 24VDC COIL	In Stock
CCT BKR, MINIATURE S201M-K10UC	In Stock
CCT BKR, MINIATURE S201M-K6UC	In Stock
CCT BKR, THERMOMAGNETIC 10A	In Stock
CCT BKR, THERMOMAGNETIC 15A	In Stock
CCT BKR, THERMOMAGNETIC 3A	In Stock
CCT BKR, THERMOMAGNETIC 5A	In Stock
CCT BKR, MINIATURE S202M-K10UC	In Stock
CCT BKR, MINIATURE S202M-K6AUC	In Stock
CCT BKR, EATON FDC3040S	In Stock
BREAKER, EATON FDC3020S	In Stock
BREAKER, EATON FDC3025S	In Stock
BREAKER, EATON FDC3030S	In Stock
BREAKER, EATON FDC3050S	In Stock
BREAKER, EATON FDC3060S	In Stock
BREAKER, EATON FDC3070S	In Stock
BREAKER, EATON FDC3080S	In Stock
BREAKER, EATON FDC3090S	In Stock
BREAKER, EATON FDC3100S	In Stock
BREAKER, EATON FDC3150S	In Stock
BREAKER, EATON HMCP003A0S	In Stock
BREAKER, EATON HMCP007C0S	In Stock
BREAKER, EATON HMCP015E0S	In Stock
BREAKER, EATON HMCP030H1S	In Stock
BREAKER, EATON HMCP050K2S	In Stock
BREAKER, EATON HMCP100R3S	In Stock
BREAKER, EATON HMCP150U4S	In Stock
BREAKER, EATON HKD3400FS	In Stock
FUSE, BUSSMAN FNQ-8	In Stock
FUSE, BUSSMAN FNQ-2	In Stock
FUSE, BUSSMAN FRS-R-20	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
FUSE, BUSSMAN FNQ-R-3	In Stock
FUSE, FAST ACTING - GGM1/2	In Stock
FUSE, TIME DELAY/CLASS CC 5A	In Stock
FUSE, TIME DELAY/CLASS CC 3.5A	In Stock
FUSE, TIME DELAY/CLASS CC .5A	In Stock
FUSE, TIME DELAY/CLASS CC 2A	In Stock
FUSE, TIME DELAY/CLASS CC 1A	In Stock
FUSE, TIME DELAY/CLASS CC 10A	In Stock
FUSE, TIME DELAY/CLASS CC 2.5A	In Stock
FUSE, TIME DELAY/CLASS CC 1.5A	In Stock
FUSE, TIME DELAY/CLASS CC 3A	In Stock
FUSE, 12A / 1000V / TYPE UK	In Stock
FUSE, 2A / 1000V / TYPE UK	In Stock
FUSE, 8A / 1000V / TYPE UK	In Stock
FUSE, TIME DELAY .5A LP-CC-1/2	Procurement Ongoing
FUSE, CARTRIDGE 10AT 600V	In Stock
FUSE-LINK, NH-GR.2 630AAR 690V	In Stock
FUSE, LOAD CFU 045 A4J15	In Stock
FUSE, LOAD CFU 045 A4J25	In Stock
FUSE, LOAD CFU 043 A4J10	In Stock
FUSE, LOAD A4J50	In Stock
FUSES, POWER	In Stock
FUSE, 1 A TIME DELAY S506-1-R	In Stock
FUSE, 2 A TIME DELAY S506-2-R	In Stock
FUSE,3.15A TIME D S506-3.15-R	In Stock
FUSE, 1A TIME DELAY S505H-1-R	In Stock
FUSE,3.15A TIME D S505H-3.15-R	In Stock
FUSE,15A/600V BUSSMANN	In Stock
FUSE, 6A/600V ABB 652-336-04	Procurement Ongoing
FUSE,3A 250V FRN-R-3	In Stock
FUSE, FAST ACTING 80 A	In Stock
ARRESTER, SURGE MWD	Procurement Ongoing
ARRESTER,SURGE HV EXLIM-P	In Stock
FUSE HOLDER, MODULAR E92/30	In Stock
FUSE HOLDER, MODULAR E92/32	In Stock
FUSE HOLDER, MODULAR E92/60J	In Stock
FUSE HOLDER, MODULAR E93N/30	In Stock
SHUNT TRIP 110-127 VAC/VDC	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
CUT-OUT, AUTO RESET THERMOLEC	In Stock
CUT-OUT, MAN RESET THERMOLEC	In Stock
CABLE,SENSOR CIRC PLUG 15FT	In Stock
LVDT CABLE DJ-200-P0	Procurement Ongoing
CONNECTOR,DUAL-RATED ALUM	In Stock
INSULATOR, STAND OFF - 11"	In Stock
CAPACITOR,0.25 MICROFARAD-24KV	Procurement Ongoing
INSULATOR, PORCELAIN MR1	Procurement Ongoing
BUSHING, SILICONE RUBBER CX572	Procurement Ongoing
STRIP, STEEL NAX 30	Procurement Ongoing
STRIP, STEEL NAX 30	Procurement Ongoing
JOINT,FLEXIBLE - CX 541A	Procurement Ongoing
BAND, IRON + CLIPS SS	Procurement Ongoing
TUBE, RED SILCONE - WURTH	Procurement Ongoing
PLAIT, FLEXIBLE COPPER	Procurement Ongoing
PLAIT, FLEXIBLE COPPER	Procurement Ongoing
SENSOR, RTD TIR 409	Procurement Ongoing
SHEET, ALUMINUM SP/THK=3MM	Procurement Ongoing
SHEET, ALUMINUM SP/THK=3MM	Procurement Ongoing
GASKET, ADHESIVE ATAG 50X5	Procurement Ongoing
GASKET,SILICONE RUBBER CX 423A	Procurement Ongoing
BAR, THREADED SS M10X200	Procurement Ongoing
WASHER, PLAIN SS M10	Procurement Ongoing
NUT, SS M10	Procurement Ongoing
BOLT, EXPANSION SS TL6X65	Procurement Ongoing
SCREW, TAPPING SS 4,2X16	Procurement Ongoing
PROTECTION, ALUM SP/THK=3MM	Procurement Ongoing
SEAL, BLACK SILICONE	Procurement Ongoing
BOLT, SS TL6X65 M6X20	Procurement Ongoing
NUT, SS M6	Procurement Ongoing
WASHER, PLAIN SS M6	Procurement Ongoing
WASHER, GROWER SS M6	Procurement Ongoing
PANEL, CLASS REI60	Procurement Ongoing
PUTTY, ANTIFIRE SEALING	Procurement Ongoing
SHEET, ALUMINUM SP/THK=3MM	Procurement Ongoing
SHEET, ALUMINUM SP/THK=3MM	Procurement Ongoing
SPRING, STEEL	Procurement Ongoing
GASKET, NEOPRENE SPONGE 30X5	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
GASKET, NEOPRENE SPONGE 50X5	Procurement Ongoing
GASKET, SILICONE RUBBER 10X12	Procurement Ongoing
GASKET, SILICONE RUBBER CX423	Procurement Ongoing
GASKET, SILICONE RUBBER 1100X6	Procurement Ongoing
GASKET, SILICONE RUBBER CX540	Procurement Ongoing
GASKET, SILICONE RUBBER CX539	Procurement Ongoing
ADAPTER SLEEVE 401603	Procurement Ongoing
COIL, FREEDOM STARTER SIZE 1&2	In Stock
KIT, FREEDOM ST CONTACT-SIZE 1	In Stock
COIL, FREEDOM STARTER SIZE 4	In Stock
KIT, FREEDOM ST CONTACT-SIZE 4	In Stock
COIL, FREEDOM STARTER SIZE 3	In Stock
KIT, FREEDOM ST CONTACT-SIZE 3	In Stock
KIT, FREEDOM ST CONTACT-SIZE 5	In Stock
STARTER, FREEDOM / GND FAULT	In Stock
DETECTOR, GROUND FAULT	Procurement Ongoing
CABLE, MEMOSENS 3 METER	In Stock
TRANSDUCER,AC CURRENT SENSOR	In Stock
PUSHBUTTON, RELEASE	Procurement Ongoing
STV, 10 POINT FINGER SAFE	In Stock
SOCKET, TERMINAL	Procurement Ongoing
KIT,VOLTAGE STEP DOWN	Procurement Ongoing
SWITCH,PB ILLUMINATED RED	Procurement Ongoing
VOLTAGE DETECTOR	In Stock
INTERLOCK,KEY	Procurement Ongoing
PUSHBUTTON, RED	Procurement Ongoing
PUSHBUTTON, GREEN	Procurement Ongoing
PUSHBUTTON, BLACK	Procurement Ongoing
PUSHBUTTON, BLUE	Procurement Ongoing
PUSHBUTTON, GREEN	Procurement Ongoing
PANEL, HUBBELL FSPST8	In Stock
LAMP, AMBER LED 6V/12V AC/DC	In Stock
POTENTIOMETER, 5000 OHM	In Stock
DISPLAY, DIGITAL K3MA-J	In Stock
PANEL, TOUCH-SCREEN HMISTO501	Procurement Ongoing
HMI, 12" PANELVIEW PLUS 7	In Stock
POWER SUPPLY,120W	In Stock
POWER SUPPLY,60W	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
DIGITAL OP'S, 24VDC 1756-OB32	In Stock
SWITCH, ETAP FOR NETWORK RING	In Stock
SWITCH,STRATIX 8000	In Stock
ADAPTER, HIRSCHMAN	Procurement Ongoing
SWITCH, ETHERNET	Procurement Ongoing
CARD, EXPANSION 8X10/10BASET	Procurement Ongoing
CONTROLLER, CONTROLLOGIX 3MB	In Stock
MODULE, PLC-RSC-24DC/21AU	In Stock
CHASIS, 13 SLOT CONTROLLOGIX	Procurement Ongoing
CONTROLLER, CONTROLLOGIX 1MB	Procurement Ongoing
MODULE, DIGITAL INPUT 16 POINT	Procurement Ongoing
MODULE, RELAY OUTPUT 8 POINT	Procurement Ongoing
MODULE, ANALOG INPUT 4 POINT	Procurement Ongoing
MODULE, ANALOG OUTPUT 4 POINT	Procurement Ongoing
POWER SUPPLY, 24VDC INPUT	Procurement Ongoing
MODULE, PLC-RSC-24DC/21AU 2PDT	In Stock
CONTROLLER, MICRO 850	Procurement Ongoing
MODULE, ANALOG INPUT 4-CH	Procurement Ongoing
MODULE, MICRO800 4CH INPUT	Procurement Ongoing
CONTROLLER, CLOCK CCLK-1004	In Stock
ASSEMBLY, SWITCH PANEL PCB	In Stock
ASSEMBLY, BAR GRAPH PCB	In Stock
ASSEMBLY, GENSET BASE PCB	In Stock
UNIT, INVERTRONIC DISPLAY	In Stock
BOARD, INPUT/OUTPUT ENERTRONIC	In Stock
BOARD, CONT. ENERTRONIC 40MHZ	In Stock
KIT, MOUNTING - IO EXT BOARD	In Stock
BOARD, MEASURING 480VAC UL	In Stock
BOARD, MEAS. 110/220/380 VDC	In Stock
BOARD, MEASURING BACKFEED2	In Stock
BOARD, RECTIFIER 1PH NETZTEIL	In Stock
BOARD, ADAPTER I-PARALLEL	In Stock
BOARD, BYPASS AMP GATE ENER	In Stock
BOARD, ADAPTER EXT MEAS 690VAC	In Stock
CONTROLLER, MICRO 850	In Stock
MODULE, ANALOG INPUT 2-CH	In Stock
MODULE, ANALOG OUTPUT 2-CH	In Stock
BOARD, VL6 MAIN	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
K-PAD, VL6	In Stock
CONTROLLER, THERMOLEC D21-PSSR	In Stock
BOARD, TERMINAL	In Stock
POWER SUPPLY, PLC ECY-PS24	In Stock
MODULES, I/O ECY-8UI6UO	In Stock
CONVERTER, MEDIA	In Stock
TRANSCIEVER, SFP	In Stock
MODULE, 32 DIGITAL INPUT	In Stock
MODULE, 8 DIGITAL OUTPUT	In Stock
SWITCH, ETHERNET 8 PORTS	In Stock
POWER SUPPLY, 120VAC/24VDC-5A	In Stock
SWITCH, ETHERNET	Procurement Ongoing
CHASSIS, ALLEN BRADLEY 4 SLOTS	In Stock
CHASSIS,ALLEN BRADLEY 17 SLOTS	In Stock
HAND PROGRAMMERS 253124	Procurement Ongoing
FILTER, DV/DT 60A	In Stock
COATING, ADPT BRD PARALLEL BRD	In Stock
FILTER, OUTPUT 1PH 220V 40KA	In Stock
FILTER, RFI UKH95 1PH 300V	In Stock
FILTER, RFI A101/601 480/690V	In Stock
FILTER, RFI UKH50 1PH 300V	In Stock
FILTER, RFI UKH50 3PH 690V	In Stock
FILTER, OUTPUT 3PH 600V 80KA	In Stock
MODULE,SUPPRESSOR TESYS K	In Stock
MODULE,SUPPRESSOR TESYS DECA	In Stock
SNUBBER	Procurement Ongoing
PIGTAIL, SINGLE FIBER 3M	In Stock
JACK, MODULAR CAT6+	In Stock
CABLE AIR GAP,BENTLEY NEVADA	In Stock
SENSOR AIR GAP,BENTLEY NEVADA	In Stock
CABLE EXT 10M,BENTLEY NEVADA	In Stock
MODULE REDUNDANT QUINT-ORING	In Stock
MODULE ETHERNET DNP3	In Stock
MODULE, ETHERNET COMMUN	In Stock
BOARD, ENCODER FOR ATV71	In Stock
MULTIPLEXER,DEMULTIPLEXER 44CH	In Stock
TRAY, FUSION SPLICE-12 FIBERS	In Stock
MODULE, 1G MMF SFP	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
SWITCH,ETHERNET HIRSCHMANN	Procurement Ongoing
CARD,HIRSCHMANN 8x10/SFP	In Stock
GATEWAY,SUBSTATION	Procurement Ongoing
CLOCK,PTP CONVERTER	Procurement Ongoing
SWITCH,ETHERNET ALSTOM	Procurement Ongoing
MODULE, STRATIX CONNECTIVITY	Procurement Ongoing
CISCO C9300 ADMIN SWITCH	In Stock
CLOCK,PTP CONVERTER	Procurement Ongoing
FAN, TELECOM PANEL	In Stock
DEVICE, CHARGE 110/220/380VDC	In Stock
MODULE, SWITCHED RECTIFIER	In Stock
PERIPHERAL, L-ADIO I/O	In Stock
MODULE, RECTIFIER POWER	In Stock
PLUG, HEATER VENT	In Stock
ACTUATOR, LOCAL MANUAL LEVER	In Stock
ACTUATOR, HF ELECTRIC	In Stock
ACTUATOR, BOOSTER	In Stock
SWITCH, DISCONNECT MAINTENANCE	In Stock
SWITCH, ABORT	In Stock
MODULE, 2 AMP COIL SUPERVISORY	In Stock
PULL STATION S/A B LOCK SPST	In Stock
REFLECTOR, PRISM	In Stock
MODULE, SUPERVISED IAM	In Stock
MODULE, RELAY IAM	In Stock
SUP RELEASE PERIPH & ENCLOSURE	In Stock
MODULE, SIGNAL IAM	In Stock
MODULE, 8 AMP RELAY IAM	In Stock
MODULE-ISOLATOR, ADDRESS	In Stock
BASE, CO SENSOR EXTENDED LIFE	In Stock
BASE W/ISOLATOR, SENSOR	In Stock
STATION-LED	In Stock
STATION-LED	In Stock
KIT, OVERHALL PACK PS5410	In Stock
KIT, PACKING REPAIR	In Stock
MODULE,TRUE ALERT ISOLATOR	In Stock
STROBE, MC WHITE	In Stock
HORN STROBE	In Stock
HORN STROBE, WEATHER PROOF	Procurement Ongoing



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
HORN STROBE	In Stock
STROBE	In Stock
STROBE	Procurement Ongoing
HORN STROBE, WEATHER PROOF	In Stock
HORN, WEATHER PROOF	In Stock
DETECTOR, HEAT 135F	Procurement Ongoing
DETECTOR, 136RR MOISTURE PROOF	In Stock
DETECTOR, REFLECTIVE BEAM	Procurement Ongoing
RESISTOR, END-OF-LINE SS	In Stock
KIT, GPX FIRE PUMP CONTROLLERS	In Stock
COVER, PULL STATION	In Stock
DETECTOR, EXPL. PROOF SMOKE	In Stock
SWITCH, 2" VSR FLOW	In Stock
SWITCH, 2.5" VSR FLOW	In Stock
SWITCH, 3" VSR FLOW	In Stock
SWITCH, 4" VSR FLOW	In Stock
SWITCH, 6" VSR FLOW	In Stock
COUPLING, 12" VICTAULIC STYLE	In Stock
COUPLING, 10" VICTAULIC STYLE	In Stock
COUPLING, 8" VICTAULIC STYLE	In Stock
COUPLING, 6" VICTAULIC STYLE	In Stock
COUPLING, 6" SS VICTAULIC STY	In Stock
COUPLING, 4" SS VICTAULIC STY	In Stock
COUPLING, 3" SS VICTAULIC STY	In Stock
COUPLING, 2.5" SS VICTAULIC S	In Stock
COUPLING, 2" SS VICTAULIC STY	In Stock
CONTROLLER, 4100 MASTER	Procurement Ongoing
BAY, 4100 EXPANSION	In Stock
MODULE, 4100 ALARM RELAY	In Stock
MODULE, 4100 232	In Stock
MODULE, 4100 IDNET 2+2	In Stock
MODULE, 4100 ETHERNET	In Stock
MODULE, 4100 16 LED	In Stock
MODULE, 4100 64 LED/SW	In Stock
ANNUNCIATOR, 4100 REMOTE	Procurement Ongoing
CONTROLLER, 4007 MAIN INERGEN	In Stock
MODULE, 4007 RELAY	In Stock
BOOSTER/REPEATER, 4009	In Stock



Critical Spares Stock Status
Muskrat Falls Generation
25-Sep-25

Critical Spare Component	Stock Status
FIELD DEVICES, POWER SUPPLY	In Stock
SWITCH,DISCHARGE PRESSURE 3PDT	In Stock
BOLT,COUNTERSINK,M16X70	Procurement Ongoing
SHEAVE,TYPE:MOD. D/GOSAN, S.A	In Stock
BEARING, BALL,SINGLE 6005 2RSR	Procurement Ongoing
BEARING,DWS 630 EA,DEMAG	In Stock
BEARING,ROTATING UNIT	Procurement Ongoing
CONNECTOR,HYD QUICK,SV-MU	In Stock
CONNECTOR,HYD QUICK,SV-ST	In Stock
PUMP,AXIAL PISTON VARIABLE	In Stock
SCRAPER,PLASTIC,100X1000(925)	In Stock
SCRAPER,PLASTIC,100X1000(650)	In Stock
BEARING,WHEEL, DWS 500 EA	Procurement Ongoing
BEARING,FLANGE,40MM,UCFC208	Procurement Ongoing
BEARING,SINGLE 6308 2RSR	Procurement Ongoing
MOTOR, 3-PHASE,SQUIRREL CAGE	In Stock
MOTOR,DEMAG,CYLINDRICAL	In Stock
REDUCER,RATIO: 784.75	Procurement Ongoing
REDUCER,SHAFT POS: 123	Procurement Ongoing
REDUCER,SHAFT POS: 124	Procurement Ongoing
MOTOR,100HP F1 JUNCTION BOX	Procurement Ongoing
MOTOR,100HP F2 JUNCTION BOX	Procurement Ongoing
REDUCER,KH167 RATIO 109.83	Procurement Ongoing
GUIDE VANE, ASSEMBLY, TURBINE	In Stock
RING,THRUST ROTATING,	In Stock
XFMR,GSU MFA 230MVA 315/15kV	In Stock
CHAMBER, ARCHING ABB	Procurement Ongoing
DRIVE, MOTOR HECS ABB	Procurement Ongoing
BREAKER, CIRCUIT (MDS-616)	Procurement Ongoing
BREAKER, CIRCUIT (MDS-632)	Procurement Ongoing
BREAKER, CIRCUIT (MDS-612)	Procurement Ongoing

Appendix I

Status of Winter Readiness Testing of Plant and Equipment for Muskrat Falls Generation





Muskrat Falls Hydroelectric Generating Station
2-Oct-25

	Status of Test				
	Unit 1	Unit 2	Unit 3	Unit 4	Spillway
Following Annual Outages, Unit is Run Up, Synchronized and all Systems Verified Before Operating Status Determined, as per Energy Control Centre, Prior to Coming Winter Operating Season to Ensure Preparedness. A Unit Load Test is Performed at this Time.	S/U	✓	✓	S/U	N/A
All Alternate Sources of Station Service Tested and Available	S/U	✓	✓	S/U	Nov-25
Service Air and Instrument Air Systems Compressors					
All Stationary Air Compressors Available	N/A	N/A	N/A	N/A	✓
Air Compressor Operational Checks Performed (e.g., Oil Levels, etc.)	N/A	N/A	N/A	N/A	✓
Air Compressor Sequencing Capability Available	N/A	N/A	N/A	N/A	✓
High Pressure Compressors Available	N/A	N/A	N/A	N/A	✓
Low Pressure Compressor Available	N/A	N/A	N/A	N/A	✓
Brake air pressure system & Alternate source's functional	✓	✓	✓	✓	✓
Instrumentation Control's functional and Alarms Operational	✓	✓	✓	✓	✓
Turbine/Generator ("TG") Cooling Water Systems					
Service Water Pumps Available	N/A	N/A	N/A	N/A	✓
Shaft seal sand filter skids functional	N/A	N/A	N/A	N/A	✓
Shaft Seal System Available	✓	✓	✓	✓	✓
Cooling Water System Available	✓	✓	✓	✓	✓
Cooling Water Strainers Inspected and Available	✓	✓	✓	✓	✓
Raw water Bypass strainer function tested	✓	✓	✓	✓	N/A
TG Governor System					
Unit HMI's functional & alarms cleared	✓	✓	✓	✓	N/A
Hydraulic System Accumulators Operational	✓	✓	✓	✓	N/A
Governor System Annual PM Complete	S/U	✓	✓	S/U	N/A
Governor System Available	✓	✓	✓	✓	N/A
Hydraulic Pump(s) Available	✓	✓	✓	✓	N/A
Generator					
Generator Exciter Operation Checked Offline and Online	S/U	✓	✓	S/U	N/A
Generator Exciter Available	✓	✓	✓	✓	N/A
Brush Condition Verified	✓	✓	✓	✓	N/A
Excitation ground fault monitor operational & clear	S/U	✓	✓	S/U	N/A

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
✓ - Test completed
N/A - Not Applicable



Muskrat Falls Hydroelectric Generating Station
2-Oct-25

Status of Test					
Unit 1	Unit 2	Unit 3	Unit 4	Balance of Plant System	Spillway
Lubricating System					
Portable Oil Pump (Jacking)	✓	✓	✓	N/A	N/A
Generator Oil Level System Metering Available	✓	✓	✓	N/A	N/A
Turbine Oil Level System Metering Available	✓	✓	✓	N/A	N/A
Alternating Current High Pressure Jacking Oil Pump Available Automatic	✓	✓	✓	N/A	N/A
Switchyard/Terminal Station					
Unit Breakers and Disconnects Operational	✓	✓	S/U	N/A	N/A
Unit Breaker PM Complete	✓	✓	S/U	N/A	N/A
Intake					
Water elevation monitoring functional	✓	✓	✓	N/A	N/A
Trashrack System	✓	✓	✓	N/A	N/A
Gate Operation	✓	✓	✓	N/A	N/A
Gate Heating System	✓	✓	✓	N/A	N/A
Alarm Systems	✓	✓	✓	N/A	N/A
Upstream Ice boom removed	N/A	N/A	N/A	N/A	✓
Spillway					
Water Elevation	N/A	N/A	N/A	N/A	✓
Gate Heating	N/A	N/A	N/A	N/A	✓
Gate Operation	N/A	N/A	N/A	N/A	✓
Emergency (Backup) Diesel Generator	N/A	N/A	N/A	N/A	✓
Emergency Lift Operation and Tested	N/A	N/A	N/A	N/A	✓
Battery Banks Chargers					
Plant 48V System					
48 V Battery Banks Checked	✓	✓	✓	✓	✓
48 V Battery Chargers functional	✓	✓	✓	✓	✓
48 V Battery Charger alternate sources available	✓	✓	✓	✓	✓
Plant 125 V System					
125 V Battery Banks Checked	✓	✓	✓	✓	✓
125 V Battery Chargers functional	✓	✓	✓	✓	✓
125 V Battery Charger alternate sources available	✓	✓	✓	✓	✓
Plant Uninterrupted Power Supplies ("UPS")					
Emergency Light UPS	N/A	N/A	N/A	✓	✓
UPS Power Supplies (Inverter #1)	N/A	N/A	N/A	✓	✓
UPS Power Supplies (Inverter #2)	N/A	N/A	N/A	✓	✓

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.

✓ - Test completed

N/A - Not Applicable



Muskrat Falls Hydroelectric Generating Station
2-Oct-25

Status of Test					
Unit 1	Unit 2	Unit 3	Unit 4	Balance of Plant System	Spillway
Emergency Diesel Generators					
Emergency Diesel Generators Tested for Emergency Stop	N/A	N/A	N/A	✓	✓
Emergency Diesel Generators Tested for Manual and Auto-Start Operation along with Auto Breaker Closure as well as Emergency Manual Closing of Breakers	N/A	N/A	N/A	✓	✓
Alternate Alternating Current Sources Available	✓	✓	✓	✓	✓
Station Services Available	✓	✓	✓	✓	✓
Transfer Alternate Source	✓	✓	✓	✓	✓
Plant Air Conditioning/Cooling System					
Mezzanine 2	N/A	N/A	N/A	✓	N/A
Mezzanine 1	N/A	N/A	N/A	✓	N/A
Control room	N/A	N/A	N/A	✓	N/A
Generation floor/ Mimic panel functional	N/A	N/A	N/A	✓	N/A
Turbine floor	N/A	N/A	N/A	✓	N/A
Dewatering gallery	N/A	N/A	N/A	✓	N/A
Plant Heating Steam					
All Systems Operational for when Required	✓	✓	✓	✓	✓
Heat recovery units operational	✓	✓	✓	N/A	N/A
Stairwell heaters operational	✓	✓	✓	✓	✓
Trench heat trace operational	N/A	N/A	N/A	N/A	✓
Gear box heaters operational	N/A	N/A	N/A	✓	✓

S/U - Final confirmation completed during Start-Up. When possible, test also completed during annual outage.
✓ - Test completed
N/A - Not Applicable